

# TABLE OF CONTENTS

	<b>PAGE</b>
<b>Section One - Introduction</b>	<b>1</b>
Company Profile	2
Sustainability Statement	3
Technical Service and Support	4
Quality Assurance	5
Notes	6
<b>Section Two - General Technical Information</b>	<b>1</b>
Installation Information	2
Installation Methods	4
Single Core Cables in Parallel	7
Rating Factors	8
Bending Radii and Duct Sizes	10
Pulling Tension	11
Short Circuit Ratings	12
Conductor Short Circuit Ratings	13
Stranded Conductor Max DC Resistances	14
Flexible Conductor Max DC Resistances	15
Conductor Dimensions	16
Wire and Cable Size Comparison	17
<b>Section Three – Low Voltage Cables (Stranded and Flexible conductors)</b>	<b>1</b>
Explanatory Information - Construction	3
- Fire Rated Performance	4
- Current Ratings	5
- Rating Factors	6
- Voltage Drops	8
- Selection Procedures	10
- Minimum Copper Earthing Conductor Size	11
Product Sheets (See Section Three Contents Page 1 for Product Sheets Listing)	12
Tabulated Electrical Data - Current Ratings	110
- Voltage Drops	133
- AC Resistances	135
- Reactances	139
- Volt Drop Graphs	143
- Notes	158

<b>Section Four – Medium Voltage TR-XLPE Cables</b>	<b>1</b>
Explanatory Information	
- History of Long-life Cables	2
- Constructing Long-life Cables	3
- Screen Designs	4
- Testing	5
- Test Voltage Levels	6
- Installation Tests	7
- Current Ratings	10
- Rating Factors	11
Notes	13
Product Sheets (See Section Four Contents Page 1 for Product Sheets Listing)	14
Notes	58
<b>Section Five – Aerials</b>	<b>1</b>
Explanatory Information	
- Thermal Characteristics	2
- Electrical Characteristics	4
- Physical and Mechanical Characteristics	5
- Bare Overhead Conductors	7
Product Sheets (See Section Five Contents Page 1 for Product Sheets Listing)	8
Notes	22

# SECTION ONE - INTRODUCTION

	<b>PAGE</b>
<b>Company Profile</b>	<b>2</b>
<b>Sustainability Statement</b>	<b>3</b>
<b>Technical Service and Support</b>	<b>4</b>
<b>Quality Assurance</b>	<b>5</b>
<b>Notes</b>	<b>6</b>

# COMPANY PROFILE

As New Zealand's largest power cable supplier, Nexans New Zealand manufactures a wide range of quality electrical cable. We have been manufacturing and distributing power cables from our New Plymouth facility since 1967 and are committed to providing our customers in New Zealand and the Pacific with superior products and leading expertise.



We are a vibrant and dynamic company, providing comprehensive cable solutions to all markets including energy, infrastructure, industry, building and construction. We provide high quality cable and consulting services to hundreds of projects around New Zealand and the Pacific every year, ranging in size from relatively small residential and commercial works to major multimillion dollar infrastructure projects.

Over 145 staff are employed at our NZ business. Our manufacturing facility and head office is based in New Plymouth with sales and distribution warehouses in Christchurch and Auckland. Our factory produces a wide range of electrical cables, ranging from low voltage through to medium voltage power cables with ratings up to 33kV, all of which are quality and environmentally certified to ISO9001 and ISO14001.

As part of the global Nexans group, we have access to an extensive range of world-leading cable products and solutions suitable for energy projects of any size and scope. We have a robust supply chain network which allows us to source quality specialist products from any of our verified supply partners around the globe.

Our team of experts can also provide technical consultancy, bespoke cable design, and comprehensive logistics services. These value-added benefits are based on our extensive experience in the electrical distribution industry.

Local expertise, global capabilities – with the very best of both worlds Nexans brings energy to life.

For more information please visit our website @ [www.nexans.co.nz](http://www.nexans.co.nz) or call our sales team on 0508 NEXANS.

# SUSTAINABILITY STATEMENT

For Nexans New Zealand, sustainability means ensuring as individuals and as a company we have the ability to develop our business over the long-term, by integrating beliefs and practices that have lasting benefits for our four key priorities: people, partners, products and our planet. We consider our social, economic and environmental impact with every business decision we make.

## Our People

We commit to a supportive workplace, valuing individuals and diversity across all levels of our business and continuously empowering employees on all issues of social responsibility. We build people who build business and we pledge workplace safety through our Health and Safety systems on all sites. Our employees have access to a number of benefits, including health insurance, the 'Be Well' wellness programme, a superannuation scheme and a 25-year club that boasts 18 members.

## Our Partners

We maintain a sustainable stakeholder relationship by embedding leadership based on compliance.

All vendors to Nexans must agree to, and sign, our corporate social responsibility charter which covers all areas of sustainability and ethical trade. We proudly have the GreenStar accreditation for "PVC best practice" which means that our PVC components comply with global and local legislation. As a member of the New Zealand Green Building Council (NZGBC), we aim to work together to accelerate the development and adoption of market-based green buildings in NZ. The Nexans Foundation supports initiatives that help bring electrical power to disadvantaged communities. Here in New Zealand, we regularly donate our cable to foundations such as Habitat for Humanity. We care about our happy and healthy community in which we operate and live. We are the major sponsor of the Nexans Fun Run/Walk series in Taranaki and donate to charities across the country throughout the year. Our employees are actively involved in these community initiatives and donations, helping raise both awareness and funds.

## Our Products

The experienced teams within our business work together with both our customers and suppliers to enable, learn about and contribute to a sustainable economy whilst operating within a competitive market. We guarantee collaboration with stakeholders, with the view of optimising resource efficiency.

## Our Planet

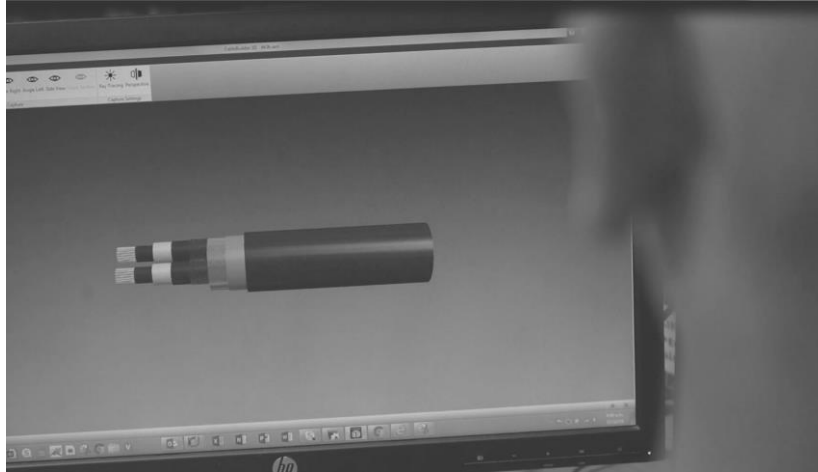
We consider the effects of our operations on the environment and strive to reduce our environmental footprint in all activities, such as sourcing materials, our manufacturing processes and office activities. We have purchase specifications in place for our raw materials, that detail our strict requirements for the quality of the materials, including the packaging for shipment. We have an end-of-life management system that incorporates our promise to accept back cables that are no longer serviceable, for recycling. Manufacturing processes at Nexans naturally have an element of waste generation, but our electronic measuring systems, including alarms, at each stage of production, mitigate against over-use. We harvest rain water to run our cooling system and recycle where possible all wastes that come onto site, such as wood, plastics and metals.

Ask for our Sustainability Framework 2019-2020 for specifics around how we bring this statement to life.



# TECHNICAL SERVICE AND SUPPORT

Nexans' extensive technical resources mean that a cable can be designed to meet the exact needs of a customer. The standard range of cables may contain a product that will do the required job, but Nexans' commitment is to ensure that a cable's capabilities meet the precise requirements of the installation and the customer's specification.



This may mean that a standard design needs to be modified for optimum performance or have a new feature added - this is simply a normal part of the Nexans service.

Nexans' technical support does not finish with the successful design and production of the cable. A comprehensive cable advisory service is also offered, and our experienced and respected technical staff, both within New Zealand and globally, are available to assist in providing expert solutions to all types of cable problems and inquiries.



# QUALITY ASSURANCE

Nexans has a strong history as New Zealand's leading manufacturer for quality cable products and services.

For us, quality assurance means understanding the desired level of quality our customers, employees and stakeholders expect, and giving attention to every stage of both the manufacturing process and the delivery of our products and services.

We developed and implemented our quality management system three decades ago and have been ISO AS/NZS 9001 quality accredited since 1990. We have further extended our scope and are now proudly IANZ certified, having ISO AS/NZS 17025 quality accreditation for our laboratory. This means that our in-process and final product testing is externally and independently audited, allowing us to issue test certificates and reports prepared by our experienced technicians.

Being part of the world's largest cable manufacturing brand means we are part of a team with subsequent access to a multitude of electrical cables, designs, research, material, education and technology. This also enables us to have access to world best practices in securing contracts with high quality raw materials and suppliers.

Our people and our quality systems are the foundations of our business. They allow us to be agile when it comes to our products and services in an ever-changing environment, ensuring our company, and the future of cable manufacturing in New Zealand, continues to be sustainable whilst remaining competitive.



# NOTES



# SECTION TWO

## GENERAL TECHNICAL INFORMATION

	<b>PAGE</b>
<b>Installation Information</b>	<b>2</b>
<b>Installation Methods</b>	<b>4</b>
<b>Single Core Cables in Parallel</b>	<b>7</b>
<b>Rating Factors</b>	<b>8</b>
<b>Bending Radii and Duct Sizes</b>	<b>10</b>
<b>Pulling Tension</b>	<b>11</b>
<b>Short Circuit Ratings</b>	<b>12</b>
<b>Conductor Short Circuit Ratings</b>	<b>13</b>
<b>Stranded Conductor Max DC Resistances</b>	<b>14</b>
<b>Flexible Conductor Max DC Resistances</b>	<b>15</b>
<b>Conductor Dimensions (Stranded)</b>	<b>16</b>
<b>Wire and Cable Size Comparison</b>	<b>17</b>

# INSTALLATION INFORMATION

## General

All cables must be installed to comply with the latest New Zealand Wiring Regulations.

## Moisture

Nexans cables are manufactured in conditions that exclude moisture, as it is difficult to remove from a finished cable. It is important that precautions are taken during installation to ensure that moisture is not permitted to enter the cable. Cut ends or opened areas must be protected from moisture at all times, including during pulling in. Cables, after cutting, must be re-sealed for storage, by an effective method such as a heat shrinkable cable cap.

## Single Core Cables

The following points relating to single core cables should be noted:

1. Single core cables carrying the phase currents of a single circuit must be installed as closely as possible together, to minimise inductive reactance and voltage drop. The preferred formation for three phase conductors is a "trefoil" or cloverleaf pattern although flat touching formation is also acceptable. Sheaths should be in contact with one another in either case.
2. A single core cable generates an alternating magnetic field around itself which can cause large increases in voltage drop and power loss due to "transformer effect" when ferrous metal (iron and steel) is allowed to encircle the cable. Steel racking or ladder will not induce this effect, but the following must be observed:
  - a. Cable cleats may be of wood, plastic, or non-ferrous metal but steel saddles should not be used on single cores.
  - b. Where three single phase cables pass through a steel bulkhead, they must all pass through the same hole. Where glanding is required, it is usual to cut out a panel and replace this with a non-ferrous (metal or plastic) plate in which the three or four glands are mounted.

## Cable Support

Under fault conditions, single core cables used as phase conductors in a multi-phase system may be subjected to large electromechanical forces which tend to drive them apart. Generally, properly designed cleats spaced at 1500 mm intervals will provide adequate support to the cable under normal operating conditions. However special consideration may be required if fault currents in excess of 15 kA are anticipated.

## Green Goo

Also known as "Green Slime", this phenomenon is characterised by the appearance of a sticky green exudate leaking out of PVC-insulated wiring at locations such as switches, hot points and light fittings. It is a common occurrence in both Australia and New Zealand.

The green goo problem is predominantly associated with older (25+ years) TPS-type cables operating in a warm environment. The exudate comprises a plasticiser that has migrated out of the PVC insulation, coloured due to reaction with the copper conductor, and that has subsequently travelled - by capillary action and/or gravity - along the conductor to emerge at a termination point.

Due to its stickiness and unsightly colour, the goo has a high nuisance value, however it poses no significant health hazard. It may be cleaned from surfaces by wiping with a rag soaked in a petroleum- or alcohol-based solvent (such as methaltd spirits).

The long-term consequence of the exudate is that it represents a de-plasticising of the insulation, meaning that as the process continues, the PVC will eventually become brittle, and crack.

# INSTALLATION INFORMATION (CONT.)

## TPS Cables in Polystyrene Thermal Insulation

With the increasing use of polystyrene block insulation in houses, caravans and portable buildings, it is important to explain the potential problem that arises when PVC sheathed and insulated cables come into direct contact with this material.

The plasticiser that is added to PVC to make it flexible, has a tendency to migrate out of the PVC and into materials with which it is in contact, particularly where those materials – such as polystyrene and polyurethane - have a great affinity for the plasticiser. This will lead to the PVCs becoming progressively harder and more brittle, while in contrast the polystyrene will appear to “melt” as it absorbs the plasticiser.

The rate of migration is dependent upon the relative thickness of the materials, the temperature, and the amount of surface area in direct contact. Accordingly, the rate of deterioration of the PVC cable can vary considerably under different circumstances.

To mitigate the problem, it is recommended that the amount of direct contact between the cable and the polystyrene be reduced as much as possible. Effective ways of achieving this include positioning the cable with an air gap between the sheath and the polystyrene or installing the cable within a rigid PVC or PE conduit.

## UV Resistance

Many polymers, due to their molecular structure, are prone to attack by UV radiation, and because of this will degrade upon continued exposure to sunlight, eventually cracking and splitting. The polyolefin family of materials, such as PE (including XLPE or X-90) and PP is particularly susceptible to deterioration in this manner. PVC is also at risk but noticeably less so, partly because of its structure but also due to the mitigating effects of the fillers, plasticisers and stabilisers that are compounded with it.

A simple, effective and cheap material that can be added to plastic compounds to absorb UV radiation is carbon black. However, while this approach is appropriate for sheathing materials, it is not necessarily so for insulating materials as the carbon masks the core colour.

Nexans recommends that the insulation of its cables be protected (covered) from solar radiation at all times, except in those instances where the material has been deliberately modified to guard against the effects of UV, eg, Aerial Bundled Cables (ABC). This covering may simply be the sheath of the cable.

## Lugs and Links


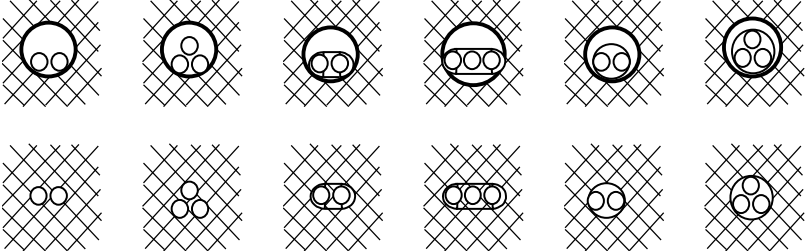
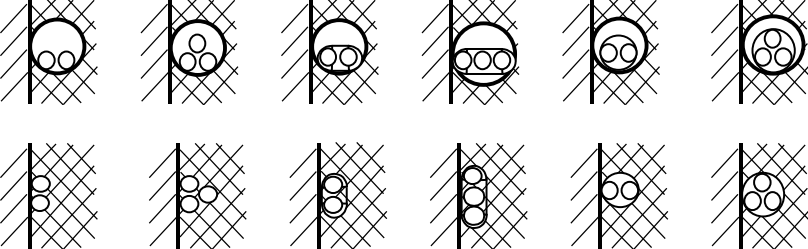
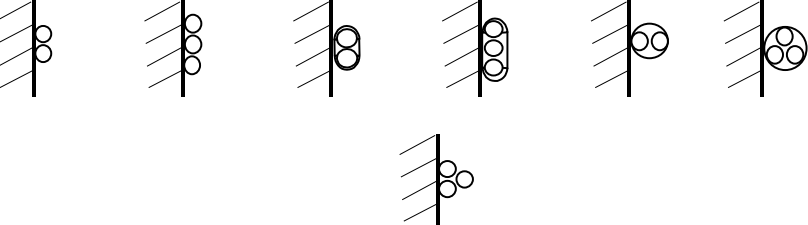
Stranded compacted conductors, either round or sector shaped, must have lugs and links fitted that are manufactured for the same nominal cross-sectional area as the conductor. For example, a 150 mm<sup>2</sup> conductor must have a 150 mm<sup>2</sup> lug or link fitted, and the correct dies, as stated by the manufacturer, used to compress it.

Although the lug or link will appear to be loose on the conductor, this is simply because the initial compression of the joint has already taken place during the manufacture of the conductor; the final compression of the joint will be correct.

If, for example, a 120 mm<sup>2</sup> lug or link was fitted to a 150 mm<sup>2</sup> conductor, the joint would be over-compressed and likely to fail in service. In addition, the smaller lug in itself would be unable to carry the same maximum current as the larger conductor, particularly with respect to fault currents.

Nexans manufactures conductors to be compatible with lugs and links normally available in New Zealand.

# INSTALLATION METHODS

<b>Figure 2.1 Graphical Representations of Methods of Installation</b>	
<p>a) Enclosed</p> 	<p>Cables installed in conduit or trunking or other similar enclosure.</p>
<p>b) Completely Surrounded by Thermal Insulation</p> 	<p>Cables either within an enclosure or unenclosed, completely surrounded by thermal insulation</p>
<p>c) Partially Surrounded by Thermal Insulation</p> 	<p>Cables either within an enclosure or unenclosed, partially surrounded by thermal insulation</p>
<p>d) Unenclosed, Clipped Directly to a Surface</p> 	<p>Cables installed directly in air, fixed to a wall, floor, ceiling<sup>1</sup> or similar surface where air circulation around the cables is restricted.</p>

Note: Refer to Table 2.1 for derating factors which apply for single circuits of cables installed under a ceiling or similar horizontal surface.

# INSTALLATION METHODS (CONT.)

<b>Figure 2.1 (cont.) Graphical Representations of Methods of Installation</b>	
<p><b>e) Unenclosed, Spaced Away from a Surface<sup>1</sup></b></p>	<p>Cables installed with minimum spacings as shown directly in air, and supported on ladders<sup>2</sup>, racks, perforated<sup>3</sup> or unperforated trays<sup>4</sup> etc, or suspended from a catenary wire.</p>
<p><b>f) Buried Direct in the Ground</b></p>	<p>Cables buried directly in the ground. The depth of burial is measured from the surface to the centre of the cable or group of cables.</p>
<p><b>g) Laid in Underground Ducts, Pipes or Conduits</b></p>	<p>Cables installed in underground enclosures. The depth of burial is measured from the surface to the centre of the duct or group of ducts.</p>

**Notes:**

1. D = Cable OD (or Width, in the case of a flat cable).
2. Ladder support is one where the supporting metalwork which provides impedance to air flow occupies less than 10% of the plan area under the cables.
3. Perforated trays are those in which not less than 30% of the surface area is removed by perforation.
4. Refer to Table 2.2 for derating factors which apply even for single circuits of cables installed on perforated or unperforated trays.
5. Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standards for full details.

# INSTALLATION METHODS (CONT.)


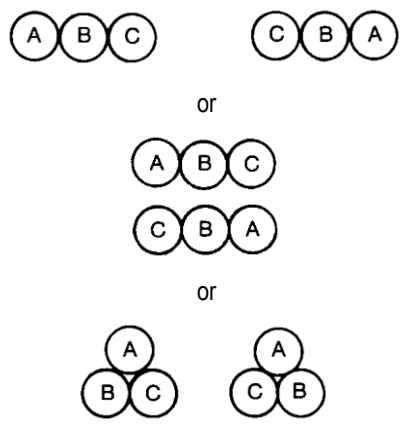

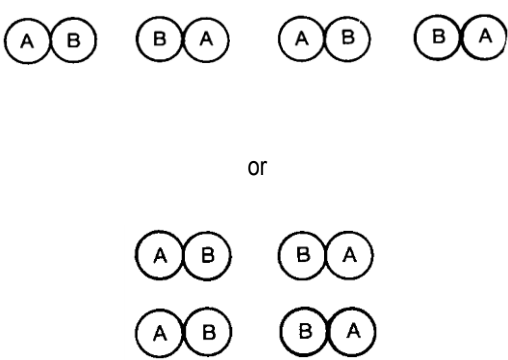
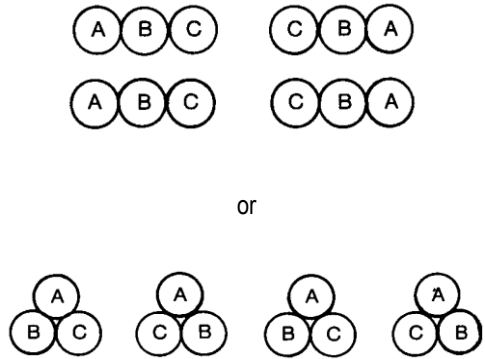
<b>Figure 2.2 Minimum Spacings in Air to Avoid Derating</b>		
<b>Method of Installation</b>	<b>Horizontal Spacings</b>	<b>Vertical Spacings</b>
<b>a) Single Core Cables</b>		
Cables spaced away from surfaces and supported on ladders, racks, etc. or suspended from a catenary wire, such that impedance to air flow around the cables is not greater than 10%.		
Cables spaced away from surfaces and supported on perforated or unperforated trays such that air flow around the cables is partially restricted.		
Cables fixed directly to a wall, floor, ceiling or similar surface such that air circulation is restricted.		
<b>b) Multicore Cables</b>		
Cables spaced away from surfaces and supported on ladders, racks, etc. or suspended from a catenary wire, such that impedance to air flow around the cables is not greater than 10%.		
Cables spaced away from surfaces and supported on perforated or unperforated trays such that air flow around the cables is partially restricted.		
Cables fixed directly to a wall, floor, ceiling or similar surface such that air circulation is restricted.		

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standards for full details.

# SINGLE CORE CABLES IN PARALLEL

The following are the recommended arrangements of single core cables in parallel. Non-symmetrical arrangements result in different impedances and hence unequal current sharing between parallel legs of the same phase. This should be avoided as it could lead to overheating of some cables.

Neutral conductors of Three phase circuits should be located so as not to disturb the symmetry of the groups.

Figure 2.3 Arrangements for Equal Current Sharing of Single Core Cables in Parallel		
	Single Phase	Three Phase
Two Conductors per Phase		
Three Conductors per Phase	Not Recommended	
Four Conductors per Phase		

# RATING FACTORS

**Table 2.1 Bunched Circuits of Single Core or Multicore Cables in Air or in Wiring Enclosures**





























No of Circuits <sup>1</sup>	Arrangement of Cables					
	Bunched in Air	Bunched on a Surface or Enclosed	Single Layer on Wall or Floor		Single Layer under a Ceiling	
			Touching	Spaced <sup>2,3</sup>	Touching	Spaced <sup>2,3</sup>
1	1.00	1.00	1.00	1.00	0.95	0.95
2	0.87	0.80	0.85	0.94	0.81	0.85
3	0.75	0.70	0.79	0.90	0.72	0.85
4	0.72	0.65	0.75	0.90	0.68	0.85
5	0.70	0.60	0.73	0.90	0.66	0.85
6	0.67	0.57	0.72	0.90	0.64	0.85
7	-	0.54	0.72	0.90	0.63	0.85
8	-	0.52	0.71	0.90	0.62	0.85
9	-	0.50	0.70	0.90	0.61	0.85
10	-	0.48	0.70	0.90	0.61	0.85
12	-	0.45	0.70	0.90	0.61	0.85
14	-	0.43	0.70	0.90	0.61	0.85
16	-	0.41	0.70	0.90	0.61	0.85
18	-	0.39	0.70	0.90	0.61	0.85
20 or more	-	0.38	0.70	0.90	0.61	0.85

Notes:

1. Where a bunch of cables consist of n loaded conductors, it may be considered as n/2 circuits of two loaded conductors or n/3 circuits of three loaded conductors.
2. Spaced refers to a clearance of one cable diameter between adjacent cables.
3. Refer to Figure 2.2 for spacings which avoid derating.



## RATING FACTORS (CONT.)

<b>Table 2.2 Cables on Trays, Racks or Other Supports</b>													
Type of Support	Single Core Cables					Multicore Cables							
	Arrangement	No. of Trays or Racks	No. of Circuits <sup>1</sup> per Tray or Rack			Arrangement	No. of Trays or Racks	No of Cables <sup>1</sup> per Tray or Rack					
			1	2	3			1	2	3	4	6	9
Unperforated Trays <sup>2</sup>		1	0.95	0.85	0.84		1	0.97	0.85	0.78	0.75	0.71	0.68
		2	0.92	0.83	0.79		2	0.97	0.84	0.76	0.73	0.68	0.63
		3	0.91	0.82	0.76		3	0.97	0.83	0.75	0.72	0.66	0.61
		1	0.98	0.96	0.94		1	0.97	0.96	0.94	0.93	0.90	-
		2	0.95	0.91	0.87		2	0.97	0.95	0.92	0.90	0.86	-
		3	0.94	0.90	0.85		3	0.97	0.94	0.91	0.89	0.84	-
Perforated Trays <sup>2</sup>		1	0.97	0.89	0.87		1	1.0	0.88	0.82	0.78	0.76	0.73
		2	0.94	0.85	0.81		2	1.0	0.87	0.80	0.76	0.73	0.68
		3	0.93	0.84	0.79		3	1.0	0.86	0.79	0.75	0.71	0.66
		1	1.0	0.98	0.96		1	1.0	1.0	0.98	0.95	0.91	-
		2	0.97	0.93	0.89		2	1.0	0.99	0.96	0.92	0.87	-
		3	0.96	0.92	0.86		3	1.0	0.98	0.95	0.91	0.85	-
Vertical Perforated Trays <sup>3</sup>		1	0.94	0.85	-		1	1.0	0.88	0.82	0.77	0.73	0.72
		2	0.92	0.83	-		2	1.0	0.88	0.81	0.76	0.72	0.70
		1	1.0	0.91	0.89		1	1.0	0.91	0.89	0.88	0.87	-
		2	1.0	0.90	0.86		2	1.0	0.91	0.88	0.87	0.86	-
Ladder Racks, Cleats etc <sup>2</sup>		1	1.0	0.95	0.94		1	1.0	0.87	0.82	0.80	0.79	0.78
		2	0.95	0.90	0.88		2	1.0	0.86	0.80	0.78	0.76	0.73
		3	0.95	0.89	0.85		3	1.0	0.85	0.79	0.76	0.73	0.70
		1	1.0	1.0	1.0		1	1.0	1.0	1.0	1.0	1.0	-
		2	0.97	0.95	0.93		2	1.0	0.99	0.98	0.97	0.96	-
		3	0.97	0.94	0.90		3	1.0	0.98	0.97	0.96	0.93	-

The factors are to be applied to “spaced from surface in air” current ratings.

Notes:

1. The factors given apply to circuits consisting of groups of two or three loaded single core cables or multicore cables having two or three loaded conductors.
2. Trays or ladder type supports shall have a vertical spacing of not less than 300 mm.
3. Back to back vertical trays shall have a horizontal spacing of not less than 230 mm.
4. Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standards for full details.

# BENDING RADII AND DUCT SIZES

## Recommended Bending Radius Factors

The safe bending radius for an electric cable is limited by the flexibility of its insulation and sheathing material. When a cable is being installed it may be pulled around several curves in different directions and subjected to dynamic stresses which could cause damage. Consequently, the bending radius around which a cable may be pulled is greater than that into which it can be set in its final position.

The following recommended minimum bending radii are expressed as a function of the cable diameter and refer to the inside of the curve. In all cases, bending radii should be as large as practicable.

<b>Recommended Minimum Bending Radii</b>			
<b>Cable Type (choose the highest value of all relevant construction features)</b>		<b>During Installation (F)</b>	<b>Set (F)</b>
<b>All Cable Types</b>	Nylon Covered	30	20
	HDPE Sheath	25	15
	Helical Copper or Brass taped	18	12
	Steel Wire Armoured	18	12
	Solid Aluminium Conductors	12	8
	Compacted or Shaped Stranded Conductors	12	8
<b>MV XLPE Cables</b>	Single Core and Multicore Cables	18	12
<b>LV (0.6/1 kV) Cables</b>	PVC/XLPE Insulation (Stranded conductor)	9	6
<b>LV (0.6/1 kV) Cables</b>	PVC/XLPE Insulation (Flexible conductor)	6	4

## Minimum Bending Radius

$R = F * D$  where,  $R$  = Bending Radius (mm),  $D$  = Cable Diameter (mm), and  $F$  = Factor from above table.

## Duct Sizes

Ducts are another important consideration affecting the pulling operation. Selection of the appropriate duct should be based on internal duct diameter to suit a cable size and wall thickness to prevent deformation during duct installation. The internal finish of the installed ducting should be smooth to prevent cable sheath damage during installation. During cable installation, the use of graphite or other commercially available pulling lubricants can also prevent sheath damage and reduce pulling tensions. The following duct sizes are recommended:

<b>Duct Selection</b>			
<b>Heavy Duty Rigid PVC Conduit Nominal Size (mm)</b>	<b>Cable Diameter</b>		
	<b>Single Cable (mm)</b>	<b>Three Cables (mm)</b>	<b>Four Cables (mm)</b>
50	Up to 30	-	-
63	30 to 38	-	-
65	38 to 47	Up to 24	Up to 21
80	47 to 52	24 to 27	21 to 23
100	52 to 69	27 to 35	23 to 31
150	69 to 99	35 to 51	31 to 44
200	99 to 142	51 to 73	44 to 63
250	Above 142	Above 73	Above 63

# PULLING TENSION

Where a cable is to be pulled in using a winch and steel wire rope, the rope may be secured to the cable by any of the following:

1. A cable stocking of steel wire braid
2. A pulling eye attached to the cable conductor
3. A pulling eye over the complete cable end
4. A pulling eye formed from the armour wires

The maximum tension which may be used is limited by the tensile strength of the conductors or armour wires, or by the gripping capability of the cable stocking, depending on the method used.

<b>Stress Limits for Cable Materials</b>	
<b>Material</b>	<b>Maximum Safe Tensile Stress (S) kN/mm<sup>2</sup></b>
<b>Stranded Copper Conductor</b>	0.07
<b>Stranded Aluminium Conductor</b>	0.05
<b>Solid Aluminium Conductor</b>	0.03
<b>Galvanised Mild Steel Armour</b>	0.13
<b>Aluminium Wire Armour</b>	0.04

## Method of Calculation

Using values of S from table above:

### Limited by Conductor

$$T_c = N * A_c * S$$

Where  $T_c$  = Maximum Pulling Tension (kN),  $N$  = No. of Conductors,  $A_c$  = Cross-sectional Area of one Conductor (mm<sup>2</sup>), and  $S$  = Maximum Safe Tensile Stress for Conductor (kN/mm<sup>2</sup>).

### Limited by Armour

$$T_a = 2.47 * d_a * (D_a + d_a) * S$$

Where  $T_a$  = Maximum Pulling Tension (kN),  $S$  = Maximum Safe Tensile Stress for Armour (kN/mm<sup>2</sup>),  $d_a$  = Nominal Diameter of Armour Wire (mm), and  $D_a$  = Nominal Diameter under Armour (mm).

### Limited by Stocking

$$T_s = 0.120 * D$$

Where  $T_s$  = Maximum Pulling Tension (kN), and  $D$  = the Overall Diameter of the Cable (mm).

<b>Overall Limiting Tension</b>	
<b>Cable OD (mm)</b>	<b>Maximum Pulling Tension (kN)</b>
<b>0 to 15</b>	5
<b>15 to 25</b>	10
<b>25 to 50</b>	15
<b>50 and over</b>	25

The safe pulling tension is the smallest of the calculated values.

## SHORT CIRCUIT RATINGS

The short circuit capacity of a current carrying component of a cable is determined by the following factors:

1. The temperature prior to the short circuit, generally taken to be that corresponding with the maximum conductor operating temperature under normal conditions.
2. The energy produced by the short circuit, a function of both the magnitude and the duration of the current.
3. The limiting final temperature, generally determined by all materials in contact with the conducting component.

The adiabatic (no heat loss) equation for the temperature rise during a short circuit is as follows:

$$I^2 * t = k^2 * S^2$$

Where  $I$  = Short Circuit Current {r.m.s. over duration} (A.),  $t$  = Duration of Short Circuit (s),  $k$  = Constant depending on the material and the initial and final temperatures, and  $S$  = Cross-sectional Area of Current Carrying Component (mm<sup>2</sup>).

Rearrangement of the general equation gives the formulae for  $I_{SC}$ , the Short Circuit Rating for a particular Conductor Size, and for calculation of  $S_C$ , the Minimum Conductor Size to meet a specified short circuit level.

$$I_{SC} = \frac{k * S}{\sqrt{t}} \text{ (A)}$$

$$S_C = \frac{I * \sqrt{t}}{k} \text{ (mm}^2\text{)} \quad \text{(Round up to the nearest standard conductor size.)}$$

Values of  $k$  for Copper and Aluminium conductors and PVC and XLPE insulation materials, based on initial temperatures corresponding to the maximum continuous conductor operating temperatures are as follows:

<b>Values of k for Cu and Al Conductors with PVC or XLPE Insulation</b>				
Insulation Type	Copper Conductor		Aluminium Conductor	
	Up to 300 mm <sup>2</sup>	Over 300 mm <sup>2</sup>	Up to 300 mm <sup>2</sup>	Over 300 mm <sup>2</sup>
PVC*	111	98.7	73.6	65.3
XLPE#	143	143	94.5	94.5

\* Insulation material temperature limits for PVC of 75°C to 160°C up to 300 mm<sup>2</sup> and 75°C to 140°C above 300 mm<sup>2</sup> apply.

# Insulation material temperature limits for XLPE of 90°C to 250°C apply.

These values are based on the limits imposed by the insulation material alone. Note that soldered joints impose an upper temperature limit of 160°C, while for mechanical (bolted) joints the manufacturer's recommendations should be observed. The above temperature limits are appropriate for durations of up to 5 seconds only.

### One Second Short Circuit Ratings

In practice it is often convenient to work with short circuit ratings converted to a one second basis. Reference may then be made to Table 2.3 which gives one second short circuit ratings for Copper and Aluminium conductors with PVC and XLPE insulation materials respectively.

To convert a one second rating to a rating for  $t$  seconds, divide by  $\sqrt{t}$ , eg, 34 kA for 1s equals 20 kA for 3s.

To convert a  $t$  second rating to a one second rating, multiply by  $\sqrt{t}$ , eg, 10 kA for 0.04s equals 2 kA for 1s.

### Other Considerations

In addition to the temperature rise, consideration should also be given to the thermomechanical (longitudinal) and electromechanical (lateral) forces which can be generated under short circuit conditions.

# CONDUCTOR SHORT CIRCUIT RATINGS

**Table 2.3 Conductor Short Circuit Ratings (kA) for 1s Duration**

Conductor Size (mm <sup>2</sup> )	Copper Conductors		Aluminium Conductors	
	PVC Insulation	XLPE Insulation	PVC Insulation	XLPE Insulation
1	0.111	0.143	-	-
1.5	0.167	0.215	-	-
2.5	0.278	0.358	-	-
4	0.444	0.572	-	-
6	0.666	0.858	-	-
10	1.11	1.43	-	-
16	1.78	2.29	1.18	1.51
25	2.78	3.58	1.84	2.36
35	3.89	5.01	2.58	3.31
50	5.55	7.15	3.68	4.73
70	7.77	10.0	5.15	6.62
95	10.5	13.6	6.99	8.98
120	13.3	17.2	8.83	11.3
150	16.7	21.5	11.0	14.2
185	20.5	26.5	13.6	17.5
240	26.6	34.3	17.7	22.7
300	33.3	42.9	22.1	28.4
400	39.5	57.2	26.1	37.8
500	49.4	71.5	32.7	47.3
630	62.2	90.1	41.1	59.5
800	-	-	-	75.6
1000	-	-	-	94.5
1200	-	-	-	113.4

Note: Short circuit ratings for durations other than one second may be obtained by dividing the one second ratings by  $\sqrt{t}$ , where  $t$  is the required duration in seconds.

# STRANDED CONDUCTOR MAX DC RESISTANCES

<b>Table 2.4 Stranded Conductor Maximum DC Resistances at 20°C (Ω/km)</b>			
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Plain Annealed Copper</b>	<b>Tinned Annealed Copper</b>	<b>Aluminium</b>
1	18.1	18.2	-
1.5	13.6	13.8	-
2.5	7.41	7.56	-
4	4.61	4.70	-
6	3.08	3.11	-
10	1.83	1.84	-
16	1.15	1.16	1.91
25	0.727	0.734	1.20
35	0.524	0.529	0.868
50	0.387	0.391	0.641
70	0.268	0.270	0.443
95	0.193	0.195	0.320
120	0.153	0.154	0.253
150	0.124	0.126	0.206
185	0.0991	0.100	0.164
240	0.0754	0.0762	0.125
300	0.0601	0.0607	0.100
400	0.0470	0.0475	0.0778
500 *	0.0366	0.0369	0.0605
630 *	0.0283	0.0286	0.0469
800	-	-	0.0367
1000	-	-	0.0291
1200	-	-	0.0247

## Notes:

1. Content from AS/NZS 1125:2001 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standards for full details.
2. Values for hard drawn plain or hard drawn tinned copper conductors may be obtained by **dividing** the values for annealed conductors by 0.97.
3. The above values are for Class 2 stranded conductors except for 1 mm<sup>2</sup> which is Class 1.
4. Conductor sizes marked with an \* are for single core cables only. For multi core cables multiply value by 1.02.
5. 1200mm<sup>2</sup> Aluminium resistance value taken from IEC 60228.

# FLEXIBLE CONDUCTOR MAX DC RESISTANCES

<b>Table 2.5 Flexible Conductor Maximum DC Resistances at 20°C (Ω/km)</b>				
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Plain Annealed Copper</b>	<b>Tinned Annealed Copper</b>	<b>Maximum Diameter of wires Class 5</b>	<b>Maximum Diameter of wires Class 6</b>
0.5	39.0	40.1	0.21	0.16
0.75	26.0	26.7	0.21	0.16
1	19.5	20.0	0.21	0.16
1.5	13.3	13.7	0.26	0.16
2.5	7.98	8.21	0.26	0.16
4	4.95	5.09	0.31	0.16
6	3.30	3.39	0.31	0.21
10	1.91	1.95	0.41	0.21
16	1.21	1.24	0.41	0.21
25	0.780	0.795	0.41	0.21
35	0.554	0.565	0.41	0.21
50	0.386	0.393	0.41	0.31
70	0.272	0.277	0.51	0.31
95	0.206	0.210	0.51	0.31
120	0.161	0.164	0.51	0.31
150	0.129	0.132	0.51	0.31
185	0.106	0.108	0.51	0.41
240	0.0801	0.0817	0.51	0.41
300	0.0641	0.0654	0.51	0.41
400	0.0486	0.0495	0.51	-
500	0.0384	0.0391	0.61	-
630	0.0287	0.0292	0.61	-

Notes:

1. Content from AS/NZS 1125:2001 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standards for full details.

# STRANDED CONDUCTOR DIMENSIONS

<b>Table 2.6 Copper Conductor Dimensions</b>						
Nominal Cross Sectional Area (mm <sup>2</sup> )	Circular Nominal Diameter (mm)	Compacted Minimum Diameter (mm)	Three Core, 120° Sectedored		Four Core, 90° Sectedored	
			Nominal Depth (mm)	Max Width (mm)	Nominal Depth (mm)	Max Width (mm)
16	4.95	4.85	-	-	-	-
25	6.30	5.90	5.22	8.48	5.87	7.68
35	7.55	6.95	5.97	9.85	6.91	9.20
50	8.75	8.20	7.02	11.51	7.97	10.50
70	10.50	9.69	8.50	14.40	9.37	13.09
95	12.40	11.40	10.02	17.00	10.97	15.55
120	14.10	12.81	11.22	18.90	12.25	17.10
150	15.55	14.22	12.17	20.90	13.62	18.92
185	17.40	15.97	13.65	23.10	15.37	21.30
240	20.00	18.25	15.57	26.75	17.48	24.50
300	22.35	20.47	17.67	29.85	19.57	27.60
400	25.25	23.40	19.84	33.96	22.29	31.21
500	28.30	26.76	-	-	-	-
630	-	30.44	-	-	-	-

<b>Table 2.7 Aluminium Conductor Dimensions</b>						
Nominal Cross Sectional Area (mm <sup>2</sup> )	Circular Nominal Diameter (mm)	Compacted Minimum Diameter (mm)	Three Core, 120° Sectedored		Four Core, 90° Sectedored	
			Nominal Depth (mm)	Max Width (mm)	Nominal Depth (mm)	Max Width (mm)
16	5.15	-	-	-	-	-
25	6.30	5.99	5.22	8.48	5.87	7.68
35	7.60	6.88	5.97	9.85	6.91	9.20
50	8.80	8.20	7.02	11.51	7.97	10.50
70	10.45	9.69	8.50	14.40	9.37	13.09
95	12.40	11.40	10.02	17.00	10.97	15.55
120	14.15	12.81	11.22	18.90	12.25	17.10
150	15.60	14.22	12.17	20.90	13.62	18.92
185	17.35	15.90	13.65	23.10	15.17	21.30
240	20.25	18.15	15.57	26.75	17.48	24.50
300	22.50	20.30	17.67	29.85	19.57	27.60
400	25.40	22.90	19.84	33.96	22.29	31.21
500	28.55	26.10	-	-	-	-
630	-	29.70	-	-	-	-
800	-	33.80	-	-	-	-
1000	-	38.10	-	-	-	-
1200	-	41.20	-	-	-	=

Note: Lugs and links must always be selected to match the nominal cross-sectional area of the conductor. A lug or link for a 185mm<sup>2</sup> circular conductor may fit on a 240 mm<sup>2</sup> compacted conductor but may not be rated to carry the load current associated with the larger conductor size; nor will it compress correctly if it is of the compression type.



## WIRE AND CABLE SIZE COMPARISON

British Imperial		Equivalent Metric	Metric Size	American Wire
Number/Diameter of Wires N°/inch	Nominal C/S Area sq inch	C/S Area mm <sup>2</sup>	mm <sup>2</sup>	Gauge AWG
		0.205		24
		0.324	0.22	22
			0.35	
		0.519	0.5	20
			0.75	
1/0.044	0.0015	0.826		18
		0.97		
3/0.029	0.0019	1.25	1	
		1.31		16
			1.5	
3/0.036	0.003	1.93		14
		2.08		
			2.5	
7/0.029	0.0045	2.93		12
		3.31		
			4	
7/0.036	0.007	4.52		10
		5.26		
			6	
7/0.044	0.010	6.63		9
		6.75		
		8.37		8
7/0.052	0.0146	9.43		
			10	
		10.6		7
		13.3		6
7/0.064	0.0225	14.3		
		16.8		5
			16	
19/0.044	0.03	18.3		4
		21.1		
			25	
19/0.052	0.04	25.5		3
		26.7		
		33.6		2
			35	
19/0.064	0.06	38.7		1
		42.4		
			50	
19/0.083	0.10	53.5		1/0
		65.1		
		67.4		2/0
			70	
37/0.064	0.12	75.3		3/0
		85.0		
			95	
37/0.072	0.15	95.3		4/0
		107		
			120	
37/0.083	0.20	127		

## WIRE AND CABLE SIZE COMPARISON (CONTINUED)

British Imperial		Equivalent Metric C/S Area mm <sup>2</sup>	Metric Size mm <sup>2</sup>	American Wire Gauge kcmil
Number/Diameter of Wires N <sup>o</sup> /inch	Nominal C/S Area sq inch			
37/0.083	0.20	127	120	250
		127		
37/0.093	0.25	152	150	300
		159		
		177		
37/0.103	0.30	195	185	350
		203		
		228		
61/0.093	0.40	253	240	400
		262		
		279		
61/0.103	0.50	304	300	450
		322		
		329		
91/0.093	0.60	355	400	500
		380		
		391		
91/0.103	0.75	405	500	600
		456		
		480		
127/0.103	1.00	507	630	700
		669		

Note: 1 mm<sup>2</sup> = 1,973.5 circular mils = 1.9735 kcmils.

# SECTION THREE - LOW VOLTAGE CABLES

	<b>PAGE</b>
<b>Explanatory Information</b>	<b>3-11</b>
Construction	3
Fire Rated Performance	4
Current Ratings	5
Rating Factors	6
Voltage Drops	8
Selection Procedures	10
Minimum Copper Earthing Conductor Size	11
<b>Product Sheets</b>	<b>12-109</b>
Conduit Wires	12
Single Core Cu TPS Cables	14
Two Core Cu TPS Cables	16
Two Core & Earth Cu TPS Cables	18
Three Core Cu TPS Cables	20
Three Core & Earth Cu TPS Cables	22
Four Core Cu TPS Cables	24
Four Core & Earth Cu TPS Cables	26
Two Core & Earth Cu Envirolex TPS Cables	28
Single Core Cu PVC Neutral Screen Cables	30
Two Core Cu PVC Neutral Screen Cables	32
Three Core Cu PVC Neutral Screen Cables	34
Four Core Cu PVC Neutral Screen Cables	36
Three Core Cu XLPE Neutral Screen Cables	38
Four Core Cu XLPE Neutral Screen Cables	40
Single Core Al XLPE Neutral Screen Cables	42
Three Core Al XLPE Neutral Screen Cables	44
Single Core Cu Vintol Cables	46
Single Core Al Vintol Cables	48
Single Core Cu Cantol Cables	50
Single Core Al Cantol Cables	52
Two Core & Earth Cu Remolex Cables	54
Three Core & Earth Cu Remolex Cables	56
Four Core & Earth Cu Remolex Cables	58
Two Core & Earth Cu Cempex Cables	60
Three Core & Earth Cu Cempex Cables	62
Four Core & Earth Cu Cempex Cables	64

# SECTION THREE - LOW VOLTAGE CABLES

	<b>PAGE</b>
<b>Product Sheets</b>	<b>12-109</b>
Two Core Cu PVC Armoured Mains Cables	66
Three Core Cu PVC Armoured Mains Cables	68
Four Core Cu PVC Armoured Mains Cables	70
Four Core Cu XLPE Armoured Mains Cables	72
Multicore Control Cables	74
Multicore Armoured Control Cables	76
Varolex Cables	78
Four Core Al XLPE URD Cables	80
Single Core Cu Alsecure Cables (Flexible)	82
Two Core & Earth Cu Alsecure Cables (Flexible)	84
Four Core & Earth Cu Alsecure Cables (Flexible)	86
Single Core Cu Envirolex Cables (Flexible)	88
Two Core & Earth Cu Envirolex Cables (Flexible)	90
Three Core & Earth Cu Envirolex Cables (Flexible)	92
Four Core & Earth Cu Envirolex Cables (Flexible)	94
Varolex Cables (Flexible)	96
Single Core Cu Versolex Cables (Flexible)	98
Two Core & Earth Cu Versolex Cords/Cables (Flexible)	100
Three Core & Earth Cu Versolex Cords/Cables (Flexible)	102
Four Core & Earth Cu Versolex Cords/Cables (Flexible)	106
<b>Tabulated Electrical Data</b>	<b>110-157</b>
Current Ratings	110
Voltage Drops	133
AC Resistances	135
Reactances	139
Voltage Drop Graphs	143
Notes	158

# CONSTRUCTION

Nexans low voltage cables are designed in accordance with relevant New Zealand, Australian or British Standards and specific customer requirements (where applicable) to provide optimum performance for the end application.

The standards referred to for PVC insulation are:

- AS/NZS 4961
- AS/NZS 5000.1
- AS/NZS 5000.2
- BS 6346

The standards referred to for XLPE and Cross-linked halogen-free Polyolefin insulation are:

- AS/NZS 3191
- AS/NZS 5000.1
- AS/NZS 4026
- AS/NZS 4961

© Copyright Standards New Zealand 2012. Content from <AS/NZS 3008.1.2:2017 Electrical installations – Selection of cables – Cables for alternating voltages up to and including 0.6/1kV – Typical New Zealand Conditions> or <AS/NZS 1125:2001 Conductors in insulated electric cables and flexible cords> and has been reproduced or adapted with permission from Standards New Zealand under Copyright Licence 000926. Please refer to the complete Standard for full details available for purchase from [www.standards.co.nz](http://www.standards.co.nz).

## Component Detail

### Conductor

Conductors are made from either plain or tinned copper or solid or stranded aluminium. Depending on the cable construction, conductors may be either bunched, circular, compacted or shaped.

<b>Conductor Data</b>								
<b>Cross Sectional Area</b>	1.5	2.5	4	6	10	16	25	35
<b>Nominal Diameter and No. of Wires</b>	3/0.75	7/0.67	7/0.85	7/1.04	7/1.35	7/1.70	7/2.14	19/1.53

<b>Flexible Conductor Data</b>								
<b>Cross Sectional Area</b>	1.5	2.5	4	6	10	16	25	35
<b>Wire Diameter and No. of Wires</b>	30/0.25	49/0.25	80/0.25	119/0.25	77/0.40	119/0.40	189/0.40	266/0.4

### Insulation

The insulation materials used are as follows:

1. PVC (Polyvinyl Chloride), meeting the requirements of: V-75 (AS/NZS 3808), V-90 (AS/NZS 3808), and T11 (BS EN 50363-3.).
2. XLPE (Cross-linked Polyethylene), meeting the requirements of: X-90 (AS/NZS 3808, AS 3560) and GP8 (BS 7655: Section 1.3.).
3. A Cross-linked halogen-free Polyolefin, meeting the requirements of: X-HF-90 (AS/NZS 3808).
4. A Cross-linked halogen-free Polyolefin, meeting the requirements of: X-HF-110 (AS/NZS 3808).

### Core Assembly

The cores of cables having flat profiles are laid side by side during the subsequent process. In circular cables, the cores are laid up and the interstices filled with a non-hygroscopic material where necessary to achieve a circular cable cross-section. The laid-up core assembly may be bound with helically applied non-hygroscopic tapes.

### Neutral Screen

In neutral screened cables, a screen of plain annealed copper or tinned annealed copper wires is helically applied over the core of a single core cable or the core assembly of a multicore cable.

### Bedding and Armour (Multicore cables)

In multicore armoured cables, a bedding of PVC is extruded over the core assembly followed by a layer of helically applied galvanised mild steel wires.

### Outer Sheath

A sheath of PVC or a X-HF thermoplastic, halogen-free polymeric with suitable temperature rating is extruded over the underlying components.

Additional protective coverings may be applied depending on the environment in which the cable is installed, e.g., a nylon over sheath and an additional sacrificial PVC layer are often specified for protection against termite attack.

### Fire Rated Fire Performance

When a cable type is assigned a wiring system code it means that a cable, representative of its group as defined by AS/NZS 3013, has satisfied the test criteria for that rating.

As an example, of a WS52W rating, all components of the Wiring System are capable of resisting exposure to fire for 120 min and have a mechanical damage comparable to 15 Joule impact and 1.0 kN of cutting force when tested to methods of AS/NZS 3013 and passed the water spray test within 30 minutes of fire test.

To understand what a WS rating means, reference to section 3 of AS/NZS 3013 is recommended, however the table below gives a brief overview of how the WS ratings relate to the electrical and mechanical performance of fire rated cables and elements in both normal service and fire conditions.

WS	1 <sup>st</sup> Numeral Electrical performance		2 <sup>nd</sup> Numeral Mechanical performance		Supplementary letter
	Number	Level of circuit integrity in fire condition	Number	Level of protection against mechanical damage	Water spray test applied
Characteristic lettering "WS"	1	15 min	1	Light	The letter "W" shall be applied as appropriate
	2	30 min	2	Moderate	
	3	60 min	3	Heavy	
	4	90 min	4	Very heavy	
	5	120min	5	Extremely heavy	

AS/NZS 3000 – The wiring rules contains an informative section which can be found in Appendix H – WS classification of wiring systems. This section gives guidance about designation, application and mechanical protection classifications that result in compliant installations and suitable alternatives.

# CURRENT RATINGS

The current carrying capacity of a cable is determined by the following factors:

1. Current flowing in a conductor generates heat and causes the conductor temperature to rise above the ambient temperature.
2. Different methods of installation or the presence of external heat sources such as adjacent cables vary the rate of heat dissipation.
3. The insulation material determines the maximum conductor temperature which can be sustained continuously over the expected life of the cable.

In all cases, the ratings given are the single circuit ratings, corresponding to continuous loading at the maximum conductor temperature appropriate to the insulation material.

## Environmental Conditions

The current ratings are based on the following operational conditions: ambient air temperature of 30°C, soil temperature of 15°C, soil thermal resistivity of 1.2 K.m/W and depth of burial of 0.5 m. Where conditions vary from those on which the ratings are based, appropriate rating factors from Tables 3.1 to 3.4 need to be applied.

## Methods of Installation

The methods of installation for which the ratings are applicable are shown graphically in Figure 2.1 (Section 2 General Technical Information). Arrangements which are shown one above the other for the same installation method are deemed to have the same current carrying capacity.

Earthing conductors and lightly loaded neutral conductors of three phase circuits are ignored for current rating purposes and are generally not shown in the graphical representations of the cable and installation methods. Thus, where two single core cables or a two-core cable is shown the current rating applies to single phase operation; where three single core cables or a three-core cable is shown the current rating applies to two or three phase operation.

## Groups of Circuits

For groups of circuits unenclosed in air, the spacings and arrangements which need to be maintained to prevent derating are given in Figure 2.2 (Section 2 General Technical Information). Where underground circuits are spaced by more than 2 m from adjacent circuits, no derating applies. Also, if adjacent circuits are operated at less than 35% of their current carrying capacity they may be excluded from considerations as their contribution to mutual heating will be small. Where a number of circuits are installed in close proximity in such a way that they are not thermally independent, the appropriate rating factors from Tables 3.5, 3.6, (Section 3 Low Voltage  $\geq 0.6/1$  kV Cables) and Tables 2.1, 2.2 (Section 2 General Technical Information) need to be applied.

## Cables in Parallel

For cables operated in parallel, each parallel leg is regarded as a separate circuit for current rating purposes and the appropriate rating factors for grouping are applicable. Refer also to Figure 2.3 (Section 2 General Technical Information) for the arrangements of single core cables so as to ensure equal current sharing between parallel legs of the same phase.

## Solar Radiation

For cables exposed to direct sunlight, the effect of solar radiation is to increase the surface temperature of the cable and hence limit the temperature rise due to the load in the conductors. Where possible, cables should be shielded from the direct rays of the sun without restricting ventilation. Otherwise, the effect of solar radiation should be taken into account, either by calculation in accordance with IEC 60287, or as an approximation by adding 20°C to the ambient air temperature and applying the appropriate rating factor.

## LOW VOLTAGE RATING FACTORS

**Table 3.1 Ambient Air Temperature Variation**

Insulation Type	Air Temperature (°C)								
	15	20	25	30	35	40	45	50	55
PVC	1.18	1.12	1.06	1.00	0.94	0.88	0.80	0.72	0.63
XLPE	1.15	1.09	1.05	1.00	0.95	0.91	0.85	0.80	0.74






**Table 3.2 Soil Temperature Variation**

Insulation Type	Soil Temperature (°C)						
	10	15	20	25	30	35	40
PVC	1.04	1.00	0.95	0.91	0.86	0.81	0.75
XLPE	1.04	1.00	0.96	0.93	0.91	0.87	0.83

**Table 3.3 Depth of Burial Variation**

Depth of Burial	Laid Direct			In Underground Ducts	
	Up to 50mm <sup>2</sup>	Above 50mm <sup>2</sup> Up to 300mm <sup>2</sup>	Above 300mm <sup>2</sup>	Single Core	Multicore
0.5	1.00	1.00	1.00	1.00	1.00
0.6	0.99	0.98	0.97	0.98	0.99
0.8	0.97	0.96	0.94	0.95	0.97
1.0	0.95	0.94	0.92	0.93	0.96
1.25	0.94	0.92	0.90	0.90	0.95
1.5	0.93	0.91	0.89	0.89	0.94
1.75	0.92	0.89	0.87	0.88	0.94
2.0	0.91	0.88	0.86	0.87	0.93
2.5	0.90	0.87	0.85	0.86	0.93
3.0 (or deeper)	0.89	0.86	0.83	0.85	0.92

**Table 3.4 Soil Thermal Resistivity Variation**

Soil Thermal Resistivity (K.m/W)					
	0.8	1.09	1.16	1.03	1.06
0.9	1.07	1.11	1.02	1.04	1.06
1.0	1.04	1.07	1.02	1.03	1.04
1.2	1.00	1.00	1.00	1.00	1.00
1.5	0.92	0.90	0.95	0.94	0.92
2.0	0.81	0.80	0.88	0.86	0.83
2.5	0.74	0.72	0.83	0.80	0.77
3.0	0.69	0.66	0.78	0.75	0.71

Note: The above content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.



# LOW VOLTAGE RATING FACTORS

<b>Table 3.5 Groups of Circuits Laid Direct</b>											
No. of Circuits	Single Core Cables						Multicore Cables				
	Touching		Spacing (m)				Touching	Spacing (m)			
Trefoil	Flat	0.15	0.30	0.45	0.60	0.15		0.30	0.45	0.60	
2	0.78	0.81	0.83	0.88	0.91	0.93	0.81	0.87	0.91	0.93	0.95
3	0.66	0.70	0.73	0.79	0.84	0.87	0.70	0.78	0.84	0.88	0.90
4	0.61	0.64	0.68	0.74	0.81	0.85	0.63	0.74	0.81	0.86	0.89
5	0.56	0.60	0.64	0.73	0.79	0.83	0.59	0.70	0.78	0.84	0.87
6	0.53	0.57	0.61	0.71	0.78	0.82	0.55	0.68	0.77	0.83	0.87
7	0.50	0.54	0.59	0.69	0.76	0.82	0.52	0.66	0.75	0.82	0.86
8	0.49	0.53	0.57	0.68	0.76	0.81	0.50	0.64	0.75	0.81	0.86
9	0.47	0.51	0.56	0.67	0.75	0.81	0.48	0.63	0.74	0.81	0.85
10	0.46	0.50	0.55	0.67	0.75	0.80	0.47	0.62	0.73	0.80	0.85
11	0.44	0.49	0.54	0.66	0.74	0.80	0.45	0.61	0.73	0.80	0.85
12	0.43	0.48	0.53	0.66	0.74	0.80	0.44	0.60	0.72	0.80	0.84

<b>Table 3.6 Groups of Circuits In Underground Ducts</b>							
No. of Circuits	Single Core Cables in Multiway Ducts or Multicore Cables in Single-way Ducts					Single Core Cables in Single-way Ducts	
	Touching	Spacing (m)			Touching	Spacing (m)	
0.30		0.45	0.60	0.45		0.60	
2	0.90	0.93	0.95	0.96	0.87	0.91	0.93
3	0.83	0.88	0.91	0.93	0.78	0.84	0.87
4	0.79	0.85	0.89	0.92	0.74	0.81	0.85
5	0.75	0.83	0.88	0.91	0.70	0.79	0.83
6	0.73	0.82	0.87	0.90	0.69	0.78	0.82
7	0.71	0.81	0.86	0.89	0.67	0.76	0.82
8	0.70	0.80	0.85	0.89	0.66	0.76	0.81
9	0.68	0.79	0.85	0.89	0.65	0.75	0.81
10	0.67	0.79	0.85	0.89	0.64	0.75	0.80
11	0.66	0.78	0.84	0.88	0.63	0.74	0.80
12	0.66	0.78	0.84	0.88	0.63	0.74	0.80

Note: The above content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

# VOLTAGE DROPS

In order to ensure satisfactory operation of electrical equipment, it is necessary to maintain the voltage at which it is supplied within certain limits.

## Voltage Drop Limitations

In New Zealand, the nominal supply system is 230/400 volts. The maximum voltage drop from the point of supply to any point in the installation is required to be no more than 5% of the nominal supply voltage, ie, 11.5 V for 230 V phase to earth or 20 V for 400 V phase to phase.

The voltage drop limitation applying to a circuit needs to be assessed taking account of the function of the circuit and its relationship with other circuits. For example, other voltage drop limits may apply in ELV circuits or may be dictated by motor starting considerations.

Also, the voltage drop in mains and submains circuits should take account of the voltage drop in final sub-circuits (and vice versa) to ensure the total voltage drop in the installation is within the required limits.

## Use of Tabulated mV/A.m Figures

The voltage drop (mV/A.m) values given in this publication have been obtained from AS/NZS 3008.1.2. They represent the worst-case conditions, whereby it is assumed that the cable is operating at maximum rated temperature and is supplying a load having a power factor equal to the power factor of the cable. For three phase circuits, balanced loading is assumed.

On this basis, where the cable size and type, load current and length of run are known, the voltage drop can be calculated from the following:

$$V_d = \frac{V_t * I * L}{1000} \text{ (V)}$$

Where:  $V_t$  = the Tabulated Voltage Drop Figure for the Cable (mV/A.m),  $I$  = the Load Current (A), and  $L$  = the Length of Run (m). This formula is used to calculate the voltage drop in a circuit when the cable size is known. Rearrangement of this equation gives the maximum mV/A.m value for compliance with a specific voltage drop.

$$V_c = \frac{1000 * V_d}{I * L} \text{ (mV/A.m)}$$

This formula should be used to select the cable size necessary to meet a specific voltage drop limitation. The size selected should have a tabulated mV/A.m figure not greater than the calculated value of  $V_c$ .

## Unbalanced Three Phase Circuits

In many three phase circuits the loading on each phase is not equal. In these cases, current will flow in the neutral conductor and the tabulated three phase mV/A.m values will not strictly apply.

Where the imbalance is known to be small, a conservative method of voltage drop assessment is to assume balanced three phase load conditions but use the current flowing in the most heavily loaded phase.

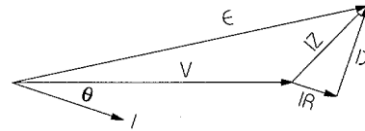
However, where the imbalance is significant, or not readily determined, it may be necessary to revert to a single-phase basis. The single-phase voltage drop limit and the tabulated single-phase mV/A.m should be used unless more precise calculations are performed using vector methods to calculate the neutral current and then geometrically summing the voltage drops in the phase and neutral conductors.

# VOLTAGE DROPS

Instances can arise where it is desired to make a more precise determination than would arise from the use of tabulated mV/A.m figures. The following methods can be used in these cases.

## Phasor Diagram

The relationships between the various current and voltage elements in a cable circuit are shown in the following phasor diagram (lagging power factor).



Where: **I** = Current Flowing in Cable, **E** = Voltage at Supply, **V** = Voltage at Load, **V<sub>d</sub> = E - V**, **IZ** = Voltage Drop associated with Cable Impedance, and **cos θ** = Power Factor of Load.

Given values for **E**, **I**, **R**, **X** and **θ**, the magnitude of **V** can be determined vectorially and subtracted from **E** to give the difference in voltage between the supply and load ends of the circuit. As the magnitude of the permissible voltage drop is very much smaller than the supply and load voltages, the difference between **E** and **V** is approximately equal to the magnitude of **IZ**. The following formulae make use of this simplification. For additional information refer to AS/NZS 3008.1.2.

## Circuit Impedance and Load Power Factor

In the cases where the load power factor is not known, the load power factor is assumed to be equal to the cable power factor and the voltage drop calculated in terms of the cable impedance as follows:

$$V_{d1f} = 2 * I * L * Z \text{ (V/m) Single phase}$$

$$V_{d3f} = \sqrt{3} * I * L * Z \text{ (V/m) Three phase}$$

Where: **I** = Load Current (A), **L** = Length of Run (m), **Z** (Cable Impedance) =  $\sqrt{R_c^2 + X_L^2}$  ( $\Omega/m$ ), **R<sub>c</sub>** = Conductor Resistance ( $\Omega/m$ ), and **X<sub>L</sub>** = Cable Inductive Reactance ( $\Omega/m$ ) at operating temperature and frequency. (**X<sub>L</sub> = 0** for direct current operation) and values of **R<sub>c</sub>** and **X<sub>L</sub>** are given in Tables 3.32 to 3.39.

Where the load power factor **cos θ** is known, the relevant formulae are:

$$V_{d1f} = 2 * I * L * (R_c * \cos \theta \pm X_L * \sin \theta) \text{ (V/m)}$$

$$V_{d3f} = \sqrt{3} * I * L * (R_c * \cos \theta \pm X_L * \sin \theta) \text{ (V/m)}$$

In these formulae, the second term in brackets is added for lagging power factors and subtracted for leading power factors. For unity power factor, **sin θ = 0** so the second term disappears.

## Cables Operated Below Full Load

In many situations, cables are operated at loads considerably less than their full rated current. The conductor temperature in such cases will be less than the maximum figure on which the tabulated mV/A.m values are based. For a given load current, the actual conductor temperature **θ<sub>o</sub>** ( $^{\circ}\text{C}$ ) can be calculated from the following:

$$\theta_o = \theta_a + (\theta_r - \theta_a) \times \left\{ \frac{I_o}{I_r} \right\}^2$$

Where: **I<sub>o</sub>** = Actual Load Current (A), **I<sub>r</sub>** = Rated Current (A), **θ<sub>r</sub>** = Rated Conductor Temperature ( $^{\circ}\text{C}$ ), and **θ<sub>a</sub>** = Ambient Temperature ( $^{\circ}\text{C}$ ) corresponding to rated current.

The value of **R<sub>c</sub>** to be used in the voltage drop calculations can then be obtained from Table 3.32 or 3.35 using the next higher value of conductor temperature. Special computer programs are commercially available to calculate voltage drop allowing for cables that are not loaded at their full rated current.

# SELECTION PROCEDURES

In accordance with AS/NZS 3008.1.2:2017 and AS/NZS 3000:2018, the four main factors which affect the minimum size of cable required for a particular installation are:

1. The cable current-carrying capacity, which is influenced by the cable materials and construction, the conditions of the cable environment and the method of installation due to their effects on the dissipation of heat from the conductors.
2. The voltage drop in the cable circuit, which is a function of load current, load power factor, and length of the cable run.
3. The temperature rise under short-circuit conditions, which is a function of both the magnitude and duration of the short-circuit current and is limited by the cable materials.
4. The maximum fault loop impedance which will still allow the protective device to trip within the specified time.

## Procedures

To select the cable size required, based on the above considerations, follow the steps listed:

### Current-Carrying Capacity

1. Determine the minimum current for which the cable is to be rated, taking account of the maximum demand of the circuit and the type and rating of the overcurrent protection device.
2. Ascertain how the cables are to be installed, and the conditions in the cable environment. From the tables of rating factors, select any rating factor(s) which are applicable.
3. Divide the rating from step 1. by the appropriate factor(s).
4. From the current rating tables, select a cable which, for the appropriate method of installation, has a tabulated rating not less than the value obtained from 3.

### Voltage Drop

1. Determine the Load Current  $I$  (A) to be carried by the cable, and the Route Length  $L$  (m) of the circuit.
2. Establish the maximum voltage drop  $V_d$  (V) permitted in the circuit (taking account of any other voltage drops in series).

3. Evaluate the equation  $V_c = \frac{1000 \cdot V_d}{I \cdot L}$  (mV/A.m). This value is the maximum mV/A.m figure which will give the required voltage drop.
4. From the voltage drop tables, select a cable for the appropriate method of installation which has a tabulated mV/A.m figure not greater than this value.

### Short Circuit Temperature

1. Determine the Maximum Duration  $t$  (s) and Magnitude  $I_{sc}$  (A) of the prospective Short Circuit Current.
2. Evaluate the equation  $I_1 = I_{sc} \cdot \sqrt{t}$  (A). This is the required short circuit rating converted to a one second basis.
3. From the conductor short-circuit ratings tables, select a cable with a rating no less than the value obtained from 2.

### Fault Loop Impedance

1. Determine the maximum fault loop impedance which will still allow the protective device to trip within the specified time.
2. From the above calculate the maximum length of cable run to comply with the maximum fault loop impedance. Refer to AS/NZS 3000:2018, Clause 1.5.5.3 and Appendix B.

### General

For any circuit, the cable size selected should not be less than the largest of the sizes calculated to meet the above limitations (this is the smallest size which will meet all of the requirements).

In practice, the current-carrying capacity will be found to prevail in short-run/high-current circuits while voltage drop considerations will usually prevail in long-run/low-current circuits. It is unusual for short-circuit temperature requirements to determine the conductor size required for low voltage cable circuits.

# MINIMUM COPPER EARTHING CONDUCTOR SIZE

Nominal Size of Active Conductor mm <sup>2</sup>	Nominal Size of Copper Earthing Conductor	
	With Copper Active Conductors mm <sup>2</sup>	With Aluminium Active Conductors mm <sup>2</sup>
1	1 *	-
1.5	1.5 *	-
2.5	2.5	-
4	2.5	-
6	2.5	-
10	4	-
16	6	4
25	6	6
35	10	6
50	16	10
70	25	10
95	25	16
120	35	25
150	50	25
185	70	35
240	95	50
300	120	70
400	≥120†	≥95†
500	≥120†	≥95†
630	≥120†	≥120†
>630	≥25% of active size†	≥25% of active size†

\* These earthing conductors may be used only where incorporated in a multicore cable or flexible cord, other than a lift travelling cable, in accordance with Clause 5.3.3.4 (b) and (c) of AS/NZS 3000:2018.

† A larger earthing conductor may be required to satisfy Clause 5.3.3.1.1 of AS/NZS 3000:2018.

### Disclaimer

Nexans has taken every precaution to ensure that the information contained in the above table is in line with the requirements of the appropriate New Zealand Standards and correct electrical practice. However, we accept no liability of any kind with respect to the information presented here.

**It is the responsibility of the Electrician signing the Certificate of Compliance to ensure that all the requirements of the Wiring Regulations are met.**

# CONDUIT WIRES

Circular construction

Copper conductor

PVC insulation

<b>Product Sheet No. 010-01 A</b>			
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Nominal Overall Diameter (mm)</b>	<b>Linear Mass (kg/m)</b>
<b>V90 Insulation</b>			
1.0*	0.8	2.8	0.017
1.5	0.8	3.3	0.022
2.5	0.8	3.8	0.034
4	1.0	4.7	0.055
<b>V75 Insulation</b>			
6	1.0	5.3	0.076
10	1.0	6.2	0.12
16	1.0	7.2	0.18
25	1.2	8.9	0.28
35	1.2	10.1	0.38
50	1.4	11.7	0.51
70	1.4	13.5	0.72
95	1.6	15.8	1.0
120	1.6	17.5	1.2
150	1.8	19.4	1.7
<b>GN/YE Earthing Conductors</b>			
1.5	0.6	2.8	0.020
2.5	0.7	3.6	0.032
<b>Issue: June 2019</b>			
<b>0.6/1 kV. Made to AS/NZS 5000.1</b>			

\* Solid conductor

Notes:

1. Conductors 1.5 mm<sup>2</sup> and above are circular stranded.
2. Standard colours: Red, White, Blue, Black, Green/Yellow (other colours can be supplied if required).
3. Subject to confirmation, similar cables can be manufactured to other specifications.



# CONDUIT WIRES

Circular construction

Copper conductor

PVC insulation

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 010-01 B</b>				
Conductor Size  (mm <sup>2</sup> )				
	(A)	(mV/A.m)	(A)	(mV/A.m)
1.0	15	51.6	14	44.7
1.5	21	33.0	17	28.6
2.5	27	18.0	24	15.6
4	36	11.2	32	9.71
6	47	7.50	40	6.49
10	62	4.46	54	3.86
16	80	2.81	71	2.43
25	107	1.78	92	1.54
35	128	1.29	114	1.12
50	157	0.963	136	0.834
70	194	0.680	173	0.589
95	242	0.507	209	0.439
120	276	0.415	247	0.359
150	321	0.352	278	0.305

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-  
Ambient Air Temperature 30°C

# SINGLE CORE CU TPS CABLES

Circular construction

Copper conductor

PVC insulation

PVC sheath

<b>Product Sheet No. 020-01 A</b>				
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Thickness of Sheath (mm)</b>	<b>Nominal Overall Diameter (mm)</b>	<b>Linear Mass (kg/m)</b>
<b>1.0*</b>	0.6	0.8	3.8	0.026
<b>1.5#</b>	0.6	0.8	4.3	0.034
<b>2.5</b>	0.7	0.8	4.9	0.048
<b>4</b>	0.8	0.9	6.0	0.073
<b>6</b>	0.8	0.9	6.5	0.096
<b>10</b>	1.0	0.9	7.8	0.15
<b>16</b>	1.0	1.0	9.3	0.22

**Issue: June 2019**  
**450/750 V. Made to AS/NZS 5000.2**

\* Solid conductor

# 3 wire conductor

Notes:

1. Conductors 2.5 mm<sup>2</sup> and above are circular stranded.
2. Standard colours: Insulation - Red or Black; Sheath - White. Other colours can be supplied if required.
3. Subject to confirmation, similar cables can be manufactured to other specifications.



# SINGLE CORE CU TPS CABLES








Circular construction

Copper conductor

PVC insulation

PVC sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 020-01 B</b>														
Conductor Size (mm <sup>2</sup> )														
	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)
1.0	15	51.6	15	44.7	16	44.7	24	51.6	18	44.7	20	51.6	18	44.7
1.5	18	33.0	18	28.6	19	28.6	31	33.0	22	28.6	25	33.0	22	28.6
2.5	26	18.0	26	15.6	29	15.6	43	18.0	30	15.6	35	18.0	30	15.6
4	35	11.2	35	9.71	38	9.71	56	11.2	40	9.71	45	11.2	40	9.71
6	46	7.50	46	6.49	48	6.49	71	7.50	50	6.49	57	7.50	50	6.49
10	62	4.46	62	3.86	66	3.86	94	4.46	65	3.86	76	4.46	65	3.86
16	82	2.81	82	2.43	88	2.43	134	2.81	114	2.43	98	2.81	86	2.43

**Issue: June 2019**  
**450/750 V. Made to AS/NZS 5000.2**

Notes:

1. Refer to Product Sheet 010-01 B for current ratings and voltage drops for these cables enclosed in conduit or trunking.
2. Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# TWO CORE CU TPS CABLES

Flat construction  
Copper conductor  
PVC insulation  
PVC sheath

<b>Product Sheet No. 020-02 A</b>				
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Thickness of Sheath (mm)</b>	<b>Nominal Overall Size (mm)</b>	<b>Linear Mass (kg/m)</b>
1.0*	0.6	0.9	6.3 x 4.0	0.050
1.5#	0.6	0.9	7.3 x 4.6	0.065
2.5	0.7	1.0	8.7 x 5.3	0.096
4	0.8	1.1	10.5 x 6.3	0.15
6	0.8	1.1	11.6 x 7.0	0.20
10	1.0	1.2	14.3 x 8.4	0.31
16	1.0	1.3	17.2 x 10.0	0.46

**Issue: June 2019**  
**450/750 V. Made to AS/NZS 5000.2**

<b>Product Sheet No. 020-02 A (with Pilot)</b>				
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Thickness of Sheath (mm)</b>	<b>Nominal Overall Size (mm)</b>	<b>Linear Mass (kg/m)</b>
2 x 16 + 2.5	1.0	1.3	9.9 x 20.4	0.50

**Issue: June 2019**  
**450/750 V. Made to AS/NZS 5000.2**

\* Solid conductor  
# 3 wire conductor

Notes:

1. Conductors 2.5 mm<sup>2</sup> and above are circular stranded.
2. Standard colours: Insulation - Red, Black, Orange (pilot); Sheath - White. Other colours can be supplied if required.
3. Subject to confirmation, similar cables can be manufactured to other specifications.

# TWO CORE CU TPS CABLES



Flat construction

Copper conductor

PVC insulation

PVC sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 020-02 B</b>				
Conductor Size  (mm <sup>2</sup> )				
	(A)	(mV/A.m)	(A)	(mV/A.m)
1.0	15	51.6	16	51.6
1.5	18	33.0	21	33.0
2.5	26	18.0	30	18.0
4	34	11.2	39	11.2
6	44	7.50	50	7.50
10	59	4.46	68	4.46
16	78	2.81	91	2.81
25	103	1.78	122	1.78

**Issue: June 2019**  
**450/750 V. Made to AS/NZS 5000.2**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-  
 Ambient Air Temperature                      30°C

## TWO CORE & EARTH CU TPS CABLES

Flat construction  
Copper conductor  
PVC insulation  
PVC sheath

<b>Product Sheet No. 020-03 A</b>				
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Thickness of Sheath (mm)</b>	<b>Nominal Overall Size (mm)</b>	<b>Linear Mass (kg/m)</b>
<b>1.0*</b>	0.6	0.9	8.6 x 4.0	0.070
<b>1.5#</b>	0.6	0.9	10.1 x 4.6	0.090
<b>2.5</b>	0.7	1.0	11.9 x 5.3	0.14
<b>4 (2.5)</b>	0.8	1.1	14.8 x 6.4	0.19
<b>6 (2.5)</b>	0.8	1.1	16.4 x 6.9	0.24
<b>10 (4)</b>	1.0	1.2	18.8 x 8.4	0.37
<b>16 (6)</b>	1.0	1.3	24.0 x 9.8	0.59

**Issue: June 2019**  
**450/750 V. Made to AS/NZS 5000.2**

\* Solid conductor  
# 3 wire conductor

Notes:

1. Conductors 2.5 mm<sup>2</sup> and above are circular stranded.
2. Standard colours: Insulation - Black, Red, Green/Yellow (earth); Sheath - White. Other colours can be supplied if required.
3. Reduced earth size shown in brackets ( ).
4. Subject to confirmation, similar cables can be manufactured to other specifications.

## TWO CORE & EARTH CU TPS CABLES



Flat construction

Copper conductor

PVC insulation

PVC sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 020-03 B</b>				
Conductor Size  (mm <sup>2</sup> )				
	(A)	(mV/A.m)	(A)	(mV/A.m)
1.0	15	51.6	16	51.6
1.5	18	33.0	21	33.0
2.5	26	18.0	30	18.0
4	34	11.2	39	11.2
6	44	7.50	50	7.50
10	59	4.46	68	4.46
16	78	2.81	91	2.81

**Issue: June 2019**  
**450/750 V. Made to AS/NZS 5000.2**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature                      30°C

## THREE CORE CU TPS CABLES

Flat construction  
Copper conductor  
PVC insulation  
PVC sheath

<b>Product Sheet No. 020-04 A</b>				
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Thickness of Sheath (mm)</b>	<b>Nominal Overall Size (mm)</b>	<b>Linear Mass (kg/m)</b>
1.0*	0.6	0.9	8.6 x 4.0	0.071
1.5#	0.6	0.9	10.1 x 4.6	0.090
2.5	0.7	1.0	12.0 x 5.3	0.14

**Issue: June 2019**  
**450/750 V. Made to AS/NZS 5000.2**

\* Solid conductor

# 3 wire conductor

Notes:

1. Conductors 2.5 mm<sup>2</sup> and above are circular stranded.
2. Standard colours: Insulation - Red, White, Blue; Sheath – Light Yellow. Other colours can be supplied if required.
3. Subject to confirmation, similar cables can be manufactured to other specifications.

# THREE CORE CU TPS CABLES



Flat construction

Copper conductor

PVC insulation

PVC sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 020-04 B</b>				
Conductor Size  (mm <sup>2</sup> )				
	(A)	(mV/A.m)	(A)	(mV/A.m)
1.0	13	44.7	14	44.7
1.5	16	28.6	17	28.6
2.5	23	15.6	25	15.6

**Issue: June 2019**  
**450/750 V. Made to AS/NZS 5000.2**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-  
Ambient Air Temperature                      30°C

# THREE CORE & EARTH CU TPS CABLES

Flat construction  
Copper conductor  
PVC insulation  
PVC sheath

<b>Product Sheet No. 020-05 A</b>				
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Thickness of Sheath (mm)</b>	<b>Nominal Overall Size (mm)</b>	<b>Linear Mass (kg/m)</b>
<b>1.0*</b>	0.6	0.9	10.9 x 4.0	0.093
<b>1.5#</b>	0.6	0.9	13.0 x 4.6	0.12
<b>2.5</b>	0.7	1.0	15.4 x 5.3	0.18
<b>4 (2.5)</b>	0.8	1.1	18.2 x 6.4	0.26
<b>6 (2.5)</b>	0.8	1.1	19.9 x 7.1	0.33
<b>10 (4)</b>	1.0	1.2	24.8 x 8.4	0.51
<b>16 (6)</b>	1.0	1.3	31.0 x 9.7	0.80

**Issue: June 2019**  
**450/750 V. Made to AS/NZS 5000.2**

\* Solid conductor  
# 3 wire conductor

Notes:

1. Conductors 2.5 mm<sup>2</sup> and above are circular stranded.
2. Standard colours: Insulation - Red, White, Blue, Green/Yellow (earth); Sheath - Blue. Other colours can be supplied if required.
3. Reduced earth size shown in brackets ( ).
4. Subject to confirmation, similar cables can be manufactured to other specifications.



# THREE CORE & EARTH CU TPS CABLES



Flat construction

Copper conductor

PVC insulation

PVC sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 020-05 B</b>				
Conductor Size  (mm <sup>2</sup> )				
	(A)	(mV/A.m)	(A)	(mV/A.m)
1.0	13	44.7	14	44.7
1.5	16	28.6	17	28.6
2.5	23	15.6	25	15.6
4	29	9.71	33	9.71
6	38	6.49	42	6.49
10	50	3.86	58	3.86
16	66	2.43	78	2.43

**Issue: June 2019**  
**450/750 V. Made to AS/NZS 5000.2**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature                      30°C

# FOUR CORE CU TPS CABLES

Flat construction  
Copper conductor  
PVC insulation  
PVC sheath

<b>Product Sheet No. 020-06 A</b>				
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Thickness of Sheath (mm)</b>	<b>Nominal Overall Size (mm)</b>	<b>Linear Mass (kg/m)</b>
2.5	0.7	1.0	15.4 x 5.3	0.18
4	0.8	1.1	19.1 x 6.5	0.29
<b>Issue: June 2019</b>				
<b>450/750 V. Made to AS/NZS 5000.2</b>				

Notes:

1. Conductors 2.5 mm<sup>2</sup> and above are circular stranded.
2. Standard colours: Insulation - Red, White, Blue, Black; Sheath - White. Other colours can be supplied if required.
3. Subject to confirmation, similar cables can be manufactured to other specifications.

# FOUR CORE CU TPS CABLES



Flat construction

Copper conductor

PVC insulation

PVC sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 020-06 B</b>				
Conductor Size  (mm <sup>2</sup> )				
	(A)	(mV/A.m)	(A)	(mV/A.m)
2.5	23	15.6	25	15.6
4	39	9.71	33	9.71
<b>Issue: June 2019</b> <b>450/750 V. Made to AS/NZS 5000.2</b>				

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-  
 Ambient Air Temperature                      30°C

## FOUR CORE & EARTH CU TPS CABLES

Flat construction  
Copper conductor  
PVC insulation  
PVC sheath

<b>Product Sheet No. 020-07 A</b>				
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Thickness of Sheath (mm)</b>	<b>Nominal Overall Size (mm)</b>	<b>Linear Mass (kg/m)</b>
<b>1.0*</b>	0.6	0.9	13.2 x 4.1	0.11
<b>1.5#</b>	0.6	0.9	16.6 x 4.5	0.15
<b>2.5</b>	0.7	1.0	18.0 x 5.3	0.71

**Issue: January 2018**  
**450/750 V. Made to AS/NZS 5000.2**

\* Solid conductor  
# 3 wire conductor

Notes:

1. Conductors 2.5 mm<sup>2</sup> and above are circular stranded.
2. Standard colours: Insulation - Red, White, Blue, Black, Green/Yellow (earth); Sheath – Light Yellow.  
Other colours can be supplied if required.
3. Subject to confirmation, similar cables can be manufactured to other specifications.

## FOUR CORE & EARTH CU TPS CABLES



Flat construction

Copper conductor

PVC insulation

PVC sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 020-07 B</b>					
Conductor Size  (mm <sup>2</sup> )					
	(A)	(mV/A.m)	(A)	(mV/A.m)	
1.0	13	44.7	14	44.7	
1.5	16	28.6	17	28.6	
2.5	23	15.6	25	15.6	

**Issue: January 2018**  
**450/750 V. Made to AS/NZS 5000.2**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-  
Ambient Air Temperature                      30°C

# TWO CORE & EARTH CU ENVIROLEX TPS CABLES

Flat construction  
Copper conductor  
XLPE insulation  
HFS-90-TP sheath

<b>Product Sheet No. 020-08 A</b>				
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Thickness of Sheath (mm)</b>	<b>Nominal Overall Size (mm)</b>	<b>Linear Mass (kg/m)</b>
1.0*	0.6	0.9	8.7 x 4.1	0.070
1.5	0.6	0.9	10.0 x 4.6	0.087
2.5	0.7	1.0	11.2 x 5.0	0.11
4 (2.5)	0.8	1.1	13.5 x 6.2	0.16
6 (2.5)	0.8	1.1	14.5 x 6.8	0.21

**Issue: January 2018**  
**450/750 V. Made to AS/NZS 5000.2**

\* Solid conductor

Notes:

1. Conductors 2.5 mm<sup>2</sup> and above are circular stranded.
2. Standard colours: Insulation - Black, Red, Green/Yellow (earth); Sheath - Green. Other colours can be supplied if required.
3. Reduced earth size shown in brackets ( ).
4. Subject to confirmation, similar cables can be manufactured to other specifications.

# TWO CORE & EARTH CU ENVIROLEX TPS CABLES



Flat construction

Copper conductor

XLPE insulation

HFS-90-TP sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 020-08 B</b>				
Conductor Size  (mm <sup>2</sup> )				
	(A)	(mV/A.m)	(A)	(mV/A.m)
1.0	18	54.0	19	54.0
1.5	22	34.6	24	34.6
2.5	31	18.9	34	18.9
4	41	11.8	46	11.8
6	51	7.85	58	7.85

**Issue: January 2018**  
**450/750 V. Made to AS/NZS 5000.2**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-  
Ambient Air Temperature                      30°C

# SINGLE CORE CU PVC NEUTRAL SCREEN CABLES

Circular construction  
Copper conductor  
PVC insulation  
Copper neutral screen  
PVC sheath

<b>Product Sheet No. 080-01 A</b>						
Conductor Size (mm <sup>2</sup> )	Thickness of Insulation (mm)	Neutral Screen		Thickness of Sheath (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
		Physical Area (mm <sup>2</sup> )	Nominal No. & Size (mm)			
2.5	0.8	4	20x 0.53	1.8	8.7	0.14
2.5	0.8	4	20x 0.53	3.2	11.5	0.20
4	1.0	6	25 x 0.53	3.2	12.5	0.24
6	1.0	6	27 x 0.53	3.2	13.1	0.28
10	1.0	10	29 x 0.67	3.2	14.2	0.38
16	1.0	16	20 x 1.01	3.2	15.9	0.51
25	1.2	25	25 x 1.13	3.2	17.9	0.73
35	1.2	35	24 x 1.36	3.2	19.5	0.93
50	1.4	48	21 x 1.70	3.2	21.8	1.2

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 4961**

<b>Product Sheet No. 080-01 A (with Pilot)</b>						
Conductor Size (mm <sup>2</sup> )	Thickness of Insulation (mm)	Neutral Screen		Thickness of Sheath (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
		Physical Area (mm <sup>2</sup> )	Nominal No. & Size (mm)			
16 + 4P	1.0	16	46 x 0.67	3.2	22.2 x 15.2	0.67
25 + 4P	1.2	26	44 x 0.86	3.2	26.2 x 17.3	0.93

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 4961**

Notes:

1. Conductors are circular stranded.
2. Standard colours: Insulation – Red, Orange (pilot); Sheath – Black.
3. Subject to confirmation, similar cables can be manufactured to other specifications.
4. Only Neutral Screen cable with a 3.2 mm sheath can be direct buried in accordance with AS/NZS 3000 without further mechanical protection.



# SINGLE CORE CU PVC NEUTRAL SCREEN CABLES

Circular construction





Copper conductor

PVC insulation

Copper neutral screen

PVC sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 080-01 B</b>								
Conductor Size (mm <sup>2</sup> )								
	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)
2.5	30	18.0	31	18.0	33	18.0	33	18.0
4	39	11.2	42	11.2	43	11.2	43	11.2
6	50	7.50	52	7.50	55	7.50	55	7.50
10	68	4.46	73	4.46	73	4.46	73	4.46
16	91	2.81	97	2.81	125	2.81	95	2.81
25	122	1.78	129	1.78	162	1.78	123	1.78
35	149	1.28	158	1.28	196	1.28	150	1.28
50	181	0.958	194	0.958	232	0.958	178	0.958

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 4961**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# TWO CORE CU PVC NEUTRAL SCREEN CABLES

Circular construction

Copper conductor

PVC insulation

Copper neutral screen

PVC sheath

<b>Product Sheet No. 080-02 A</b>						
Conductor Size (mm <sup>2</sup> )	Thickness of Insulation (mm)	Neutral Screen		Thickness of Sheath (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
		Physical Area (mm <sup>2</sup> )	Nominal No. & Size (mm)			
2.5	0.8	5	24 x 0.53	1.8	12.4 x 8.6	0.19
2.5	0.8	5	24 x 0.53	3.2	15.2 x 11.6	0.28
4	1.0	6	29 x 0.53	3.2	17.2 x 12.5	0.35
6	1.0	7	32 x 0.53	3.2	18.0 x 13.0	0.42
10	1.0	10	47 x 0.53	3.2	20.1 x 14.0	0.56
16	1.0	16	46 x 0.67	3.2	22.2 x 15.2	0.76
25	1.2	26	44 x 0.86	3.2	26.1 x 17.3	1.1
35	1.2	35	44 x 1.01	3.2	28.9 x 18.8	1.4

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 4961**

<b>Product Sheet No. 080-02 A (with Pilot)</b>						
Conductor Size (mm <sup>2</sup> )	Thickness of Insulation (mm)	Neutral Screen		Thickness of Sheath (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
		Physical Area (mm <sup>2</sup> )	Nominal No. & Size (mm)			
2 x 16 + 4P	1.0	16	46 x 0.67	3.2	23.3	0.92

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 4961**

Notes:

1. Conductors are circular stranded.
2. Standard colours: Insulation – Red, White, Orange (pilot); Sheath – Black.
3. Subject to confirmation, similar cables can be manufactured to other specifications.
4. Only Neutral Screen cable with a 3.2 mm sheath can be direct buried in accordance with AS/NZS 3000 without further mechanical protection.

# TWO CORE CU PVC NEUTRAL SCREEN CABLES

Circular construction





Copper conductor

PVC insulation

Copper neutral screen

PVC sheath

Current ratings (A) and voltage drops (mV/A.m) \*

<b>Product Sheet No. 080-02 B</b>									
Conductor Size (mm <sup>2</sup> )									
	(A)	(mV/A.m)	(A)	(mV/Am)	(A)	(mV/A.m)	(A)	(mV/A.m)	
2.5	25	15.6	26	15.6	28	15.6	28	15.6	
4	33	9.71	35	9.71	36	9.71	36	9.71	
6	42	6.49	46	6.49	46	6.49	46	6.49	
10	58	3.86	62	3.86	61	3.86	61	3.86	
16	78	2.43	82	2.43	106	2.43	80	2.43	
25	104	1.54	111	1.54	138	1.54	103	1.54	
35	128	1.11	137	1.11	165	1.11	125	1.11	

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 4961**

\* This table relates to two and three phase operations - for single phase operation Product Sheet 080-01B is applicable

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature	30 °C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# THREE CORE CU PVC NEUTRAL SCREEN CABLES

Circular construction  
Copper conductor  
PVC insulation  
Copper neutral screen  
PVC sheath

<b>Product Sheet No. 080-03 A</b>						
Conductor Size (mm <sup>2</sup> )	Thickness of Insulation (mm)	Neutral Screen		Thickness of Sheath (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
		Physical Area (mm <sup>2</sup> )	Nominal No. & Size (mm)			
2.5	0.8	7	30 x 0.53	1.8	12.9	0.36
2.5	0.8	7	30 x 0.53	3.2	16.0	0.36
4	1.0	8	37 x 0.53	3.2	18.1	0.47
6	1.0	9	42 x 0.53	3.2	19.1	0.56
10	1.0	11	48 x 0.53	3.2	21.0	0.74
16	1.0	16	46 x 0.67	3.2	23.6	1.01

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 4961**

Notes:

1. Conductors are circular stranded.
2. Standard Colours: Insulation - Red, White, Blue; Sheath – Black.
3. Subject to confirmation, similar cables can be manufactured to other specifications.
4. Only Neutral Screen cable with a 3.2 mm sheath can be direct buried in accordance with AS/NZS 3000 without further mechanical protection.

# THREE CORE CU PVC NEUTRAL SCREEN CABLES

Circular construction





Copper conductor

PVC insulation

Copper neutral screen

PVC sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 080-03 B</b>									
Conductor Size (mm <sup>2</sup> )									
	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	
2.5	25	15.6	26	15.6	28	15.6	28	15.6	
4	33	9.71	35	9.71	36	9.71	36	9.71	
6	42	6.49	46	6.49	46	6.49	46	6.49	
10	58	3.86	62	3.86	61	3.86	61	3.86	
16	78	2.43	82	2.43	106	2.43	80	2.43	

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 4961**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# FOUR CORE CU PVC NEUTRAL SCREEN CABLES

Circular construction  
Copper conductor  
PVC insulation  
Copper neutral screen  
PVC sheath

<b>Product Sheet No. 080-04 A</b>						
Conductor Size (mm <sup>2</sup> )	Thickness of Insulation (mm)	Neutral Screen		Thickness of Sheath (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
		Physical Area (mm <sup>2</sup> )	Nominal No. & Size (mm)			
2.5	0.8	8	34 x 0.53	1.8	14.1	0.31
2.5	0.8	8	34 x 0.53	3.2	17.0	0.41
4	1.0	9	42 x 0.53	3.2	19.3	0.55
6	1.0	10	46 x 0.53	3.2	20.6	0.66
10	1.0	12	54 x 0.53	3.2	22.6	0.88
16	1.0	17	47 x 0.67	3.2	25.4	1.22

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 4961**

Notes:

1. Circular stranded conductor.
2. Standard colours: Insulation - Red, White, Blue, Black; Sheath – Black.
3. Subject to confirmation, similar cables can be manufactured to other specifications.
4. Only Neutral Screen cable with a 3.2 mm sheath can be direct buried in accordance with AS/NZS 3000 without further mechanical protection.

# FOUR CORE CU PVC NEUTRAL SCREEN CABLES

Circular construction





Copper conductor

PVC insulation

Copper neutral screen

PVC sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 080-04 B</b>								
Conductor Size (mm <sup>2</sup> )								
	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)
2.5	25	15.6	26	15.6	28	15.6	28	15.6
4	33	9.71	35	9.71	36	9.71	36	9.71
6	42	6.49	46	6.49	46	6.49	46	6.49
10	58	3.86	62	3.86	61	3.86	61	3.86
16	78	2.43	82	2.43	106	2.43	80	2.43

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 4961**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# THREE CORE CU XLPE NEUTRAL SCREEN CABLES

Circular construction  
Copper conductor  
XLPE insulation  
Copper neutral screen  
PVC sheath

<b>Product Sheet No. 081-01 A</b>						
Conductor Size (mm <sup>2</sup> )	Thickness of Insulation (mm)	Neutral Screen		Thickness of Sheath (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
		Physical Area (mm <sup>2</sup> )	Nominal No. & Size (mm)			
16	0.7	16	46 x 0.67	3.2	23.0	0.97
25	0.9	26	44 x 0.86	3.2	25.6	1.3
35	0.9	35	44 x 1.01	3.2	26.0	1.7
50	1.0	48	48 x 1.13	3.2	29.0	2.2
70	1.1	68	47 x 1.36	3.2	33.1	3.1
95	1.1	95	42 x 1.70	3.2	37.0	4.1

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 4961**

<b>Product Sheet No. 081-01 A (with Pilot)</b>						
Conductor Size (mm <sup>2</sup> )	Thickness of Insulation (mm)	Neutral Screen		Thickness of Sheath (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
		Physical Area (mm <sup>2</sup> )	Nominal No. & Size (mm)			
3 x 16 + 4P	0.7	17	48 x 0.67	3.2	24.8	1.1

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 4961**

Notes:

1. Conductors 50 mm<sup>2</sup> and above are shaped stranded.
2. Standard colours: Insulation - Red, White, Blue, Orange (pilot); Sheath – Black.
3. Subject to confirmation, similar cables can be manufactured to other specifications.
4. Only Neutral Screen cable with a 3.2 mm sheath can be direct buried in accordance with AS/NZS 3000 without further mechanical protection.



# THREE CORE CU XLPE NEUTRAL SCREEN CABLES

Circular construction





Copper conductor

XLPE insulation

Copper neutral screen

PVC sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 081-01 B</b>								
Conductor Size (mm <sup>2</sup> )								
	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)
16	91	2.55	97	2.55	118	2.55	87	2.55
25	122	1.61	131	1.61	153	1.61	114	1.61
35	151	1.17	162	1.17	184	1.17	139	1.17
50	185	0.868	198	0.868	218	0.868	166	0.868
70	234	0.609	252	0.609	269	0.609	207	0.609
95	289	0.450	311	0.450	323	0.450	249	0.450

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 4961**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# FOUR CORE CU XLPE NEUTRAL SCREEN CABLES

Circular construction  
Copper conductor  
XLPE insulation  
Copper neutral screen  
PVC sheath

<b>Product Sheet No. 081-02 A</b>						
Conductor Size (mm <sup>2</sup> )	Thickness of Insulation (mm)	Neutral Screen		Thickness of Sheath (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
		Physical Area (mm <sup>2</sup> )	Nominal No. & Size (mm)			
16	0.7	16	46 x 0.67	3.2	24.1	1.1
25	0.9	26	44 x 0.86	3.2	28.0	1.6
35	0.9	35	44 x 1.01	3.2	29.4	2.1
50	1.0	48	48 x 1.13	3.2	32.3	2.7
70	1.1	68	47 x 1.36	3.2	36.7	3.8
95	1.1	94	65 x 1.36	3.2	40.3	5.2

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 4961**

Notes:

1. Conductors 50 mm<sup>2</sup> and above are shaped stranded.
2. Standard colours: Insulation - Red, White, Blue, Black; Sheath – Black.
3. Subject to confirmation, similar cables can be manufactured to other specifications.
4. Only Neutral Screen cable with a 3.2 mm sheath can be direct buried in accordance with AS/NZS 3000 without further mechanical protection.

# FOUR CORE CU XLPE NEUTRAL SCREEN CABLES

Circular construction





Copper conductor

XLPE insulation

Copper neutral screen

PVC sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 081-02 B</b>								
Conductor Size (mm <sup>2</sup> )								
	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)
16	91	2.55	97	2.55	118	2.55	87	2.55
25	122	1.61	131	1.61	153	1.61	114	1.61
35	151	1.17	162	1.17	184	1.17	139	1.17
50	185	0.868	198	0.868	218	0.868	166	0.868
70	234	0.609	252	0.609	269	0.609	207	0.609
95	289	0.450	311	0.450	323	0.450	249	0.450
<b>Issue: June 2019</b>								
<b>0.6/1 kV. Made to AS/NZS 4961</b>								

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# SINGLE CORE AL XLPE NEUTRAL SCREEN CABLES

Circular construction  
Aluminium conductor  
XLPE insulation  
Copper neutral screen  
PVC sheath

<b>Product Sheet No. 082-01 A</b>						
Conductor Size (mm <sup>2</sup> )	Thickness of Insulation (mm)	Neutral Screen		Thickness of Sheath (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
		Physical Area (mm <sup>2</sup> )	Nominal No. & Size (mm)			
70	1.1	41	28 x 1.36	3.2	21.5	0.87
95	1.1	57	25 x 1.70	3.2	23.9	1.1
120	1.2	71	22 x 2.03	3.2	26.1	1.4
185	1.6	110	22 x 2.52	3.2	31.1	2.0

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 4961**

<b>Product Sheet No. 082-01 A (with Pilot)</b>						
Conductor Size (mm <sup>2</sup> )	Thickness of Insulation (mm)	Neutral Screen		Thickness of Sheath (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
		Physical Area (mm <sup>2</sup> )	Nominal No. & Size (mm)			
70 + 4P	1.1	42	29 x 1.36	3.2	28.6 x 21.2	1.1

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 4961**

Notes:

1. Conductors are compacted stranded.
2. Standard colours: Insulation - Red, Orange (pilot); Sheath – Black.
3. Subject to confirmation, similar cables can be manufactured to other specifications.
4. Only Neutral Screen cable with a 3.2 mm sheath can be direct buried in accordance with AS/NZS 3000 without further mechanical protection.

# SINGLE CORE AL XLPE NEUTRAL SCREEN CABLES

Circular construction





Aluminium conductor

XLPE insulation

Copper neutral screen

PVC sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 082-01 B</b>								
Conductor Size (mm <sup>2</sup> )								
	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)
70	213	1.15	229	1.15	249	1.15	189	1.15
95	263	0.835	283	0.835	299	0.835	231	0.835
120	307	0.666	329	0.666	341	0.666	264	0.666
185	406	0.448	436	0.448	433	0.448	345	0.448
<b>Issue: June 2019</b>								
<b>0.6/1 kV. Made to AS/NZS 4961</b>								

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# THREE CORE AL XLPE NEUTRAL SCREEN CABLES

Circular construction  
Aluminium conductor  
XLPE insulation  
Copper neutral screen  
PVC sheath

<b>Product Sheet No. 082-03 A</b>						
Conductor Size (mm <sup>2</sup> )	Thickness of Insulation (mm)	Neutral Screen		Thickness of Sheath (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
		Physical Area (mm <sup>2</sup> )	Nominal No. & Size (mm)			
35*	0.9	26	44 x 0.86	3.2	28.1	1.0
50*	1.0	29	50 x 0.86	3.2	31.0	1.2
70	1.1	42	52 x 1.01	3.2	32.4	1.6
95	1.1	57	57 x 1.13	3.2	35.9	2.0
185	1.6	116	50 x 1.70	3.2	47.0	3.7

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 4961**

<b>Product Sheet No. 082-03 A (With Pilot)</b>						
Conductor Size (mm <sup>2</sup> )	Thickness of Insulation (mm)	Neutral Screen		Thickness of Sheath (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
		Physical Area (mm <sup>2</sup> )	Nominal No. & Size (mm)			
95 + 10P	1.1	57	57 x 1.13	3.2	39.0	2.2
120 + 10P	1.2	73	50 x 1.36	3.2	39.6	2.5
185 + 10P	1.6	114	50 x 1.70	3.2	48.0	3.7
300 + 10P	1.8	185	57 x 2.03	3.2	57.4	5.6

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 4961**

\* Circular compacted conductor

Notes:

1. Conductors 70 mm<sup>2</sup> and above are shaped stranded conductor.
2. Standard colours: Insulation - Red, White, Blue; Sheath – Black.
3. Subject to confirmation, similar cables can be manufactured to other specifications.
4. Only Neutral Screen cable with a 3.2 mm sheath can be direct buried in accordance with AS/NZS 3000 without further mechanical protection.

# THREE CORE AL XLPE NEUTRAL SCREEN CABLES

Circular construction





Aluminium conductor

XLPE insulation

Copper neutral screen

PVC sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 082-03 B</b>								
Conductor Size (mm <sup>2</sup> )								
	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)
35	117	1.93	125	1.93	142	1.93	108	1.93
50	143	1.43	154	1.43	170	1.43	128	1.43
70	182	0.993	196	0.993	209	0.993	161	0.993
95	224	0.723	242	0.723	250	0.723	194	0.723
120	262	0.577	282	0.577	286	0.577	225	0.577
185	347	0.388	374	0.388	364	0.388	291	0.388
300	475	0.258	514	0.258	477	0.258	391	0.258

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 4961**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# SINGLE CORE CU VINTOL CABLES

Circular construction

Copper conductor

PVC insulation

PVC sheath

<b>Product Sheet No. 110-01 A</b>				
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Thickness of Sheath (mm)</b>	<b>Nominal Overall Diameter (mm)</b>	<b>Linear Mass (kg/m)</b>
4	1.0	1.4	7.7	0.10
16	1.0	1.4	10.0	0.23
25	1.2	1.4	11.8	0.35
35	1.2	1.4	13.0	0.45
50	1.4	1.4	14.6	0.57
70	1.4	1.4	16.4	0.82

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

Notes:

1. Conductors are circular stranded.
2. Standard colours: Insulation - Natural; Sheath – Red, White, Blue, Black.
3. Subject to confirmation, similar cables can be manufactured to other specifications.



# SINGLE CORE CU VINTOL CABLES








Circular construction

Copper conductor

PVC insulation

PVC sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 110-01 B</b>														
Conductor Size (mm <sup>2</sup> )														
	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)
4	35	11.2	35	9.71	38	9.71	56	11.2	40	9.71	45	11.2	40	9.71
16	82	2.81	82	2.43	88	2.43	134	2.81	114	2.43	98	2.81	86	2.43
25	111	1.78	111	1.55	117	1.54	174	1.78	147	1.54	128	1.78	110	1.54
35	136	1.29	136	1.12	145	1.12	209	1.29	176	1.12	153	1.29	134	1.12
50	166	0.963	166	0.840	178	0.834	248	0.963	209	0.834	185	0.963	158	0.834
70	210	0.680	210	0.597	225	0.589	305	0.680	256	0.589	227	0.680	198	0.589

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# SINGLE CORE AL VINTOL CABLES

Circular construction  
Aluminium conductor  
PVC insulation  
PVC sheath

<b>Product Sheet No. 110-01 A</b>				
<b>Conductor Size</b> (mm <sup>2</sup> )	<b>Thickness of Insulation</b> (mm)	<b>Thickness of Sheath</b> (mm)	<b>Nominal Overall Diameter</b> (mm)	<b>Linear Mass</b> (kg/m)
25	1.2	1.4	11.7	0.18
35	1.2	1.4	13.4	0.24
50	1.4	1.4	14.7	0.29
70	1.4	1.4	16.4	0.39
95	1.6	1.5	19.0	0.52
120	1.6	1.5	20.7	0.62
150	1.8	1.6	22.8	0.75
185	2.0	1.7	25.1	0.92
240	2.2	1.8	26.8	1.1

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

Notes:

1. Conductors are circular stranded.
2. Standard colours: Insulation - Natural; Sheath – Red, White, Blue, Black.
3. Subject to confirmation, similar cables can be manufactured to other specifications.

# SINGLE CORE AL VINTOL CABLES








Circular construction

Aluminium conductor

PVC insulation

PVC sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 110-01 B</b>														
Conductor Size (mm <sup>2</sup> )														
	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)
25	86	2.95	86	2.55	91	2.55	135	2.95	114	2.55	99	2.95	86	2.55
35	105	2.14	105	1.85	112	1.85	162	2.14	136	1.85	119	2.14	103	1.85
50	129	1.58	129	1.37	138	1.37	191	1.58	162	1.37	143	1.58	123	1.37
70	163	1.10	163	0.956	174	0.952	237	1.10	199	0.952	176	1.10	154	0.952
95	203	0.804	203	0.702	218	0.696	283	0.811	238	0.696	215	0.811	185	0.696
120	237	0.645	237	0.565	254	0.558	323	0.653	272	0.558	245	0.653	216	0.558
150	272	0.535	272	0.472	292	0.463	362	0.545	304	0.463	281	0.545	242	0.463
185	318	0.439	317	0.391	341	0.380	411	0.452	344	0.380	320	0.452	278	0.380
240	381	0.352	381	0.319	408	0.305	477	0.368	400	0.305	376	0.368	325	0.305

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# SINGLE CORE CU CANTOL CABLES

Circular construction

Copper conductor

XLPE insulation

PVC sheath

<b>Product Sheet No. 120-01 A</b>				
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Thickness of Sheath (mm)</b>	<b>Nominal Overall Diameter (mm)</b>	<b>Linear Mass (kg/m)</b>
16	0.7	1.4	9.4	0.21
25	0.9	1.4	10.9	0.31
35	0.9	1.4	11.9	0.41
50	1.0	1.4	13.4	0.54
70	1.1	1.4	15.0	0.75
95	1.1	1.5	16.9	1.0
120	1.2	1.5	18.6	1.3
150	1.4	1.6	20.6	1.6
185	1.6	1.6	22.8	1.9
240	1.7	1.7	25.5	2.5
300	1.8	1.8	28.1	3.1
400	2.0	1.9	31.8	4.0
500	2.2	2.0	35.7	5.0
630	2.4	2.2	40.1	6.4

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

Notes:

1. Conductors are compact circular stranded.
2. Standard colours: Insulation - Natural; Sheath - Black. Other colours can be supplied if required.
3. Subject to confirmation, similar cables can be manufactured to other specifications.

# SINGLE CORE CU CANTOL CABLES









Circular construction

Copper conductor

XLPE insulation

PVC sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 120-01 B</b>															
Conductor Size (mm <sup>2</sup> )															
	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)
16	95	2.95	95	2.55	101	2.55	149	2.95	125	2.55	107	2.95	925	2.55	
25	129	1.87	129	1.62	138	1.62	192	1.87	162	1.62	140	1.87	121	1.62	
35	158	1.35	158	1.18	169	1.17	230	1.35	193	1.17	168	1.35	147	1.17	
50	194	1.01	194	0.878	207	0.872	273	1.01	229	0.872	202	1.01	174	0.872	
70	246	0.710	246	0.623	264	0.615	335	0.710	280	0.615	249	0.710	217	0.615	
95	306	0.528	306	0.467	328	0.457	401	0.528	335	0.457	305	0.528	261	0.457	
120	358	0.431	358	0.385	384	0.373	457	0.431	381	0.373	348	0.431	304	0.373	
150	413	0.365	413	0.330	443	0.316	514	0.365	428	0.316	391	0.365	342	0.316	
185	480	0.311	479	0.285	515	0.269	581	0.311	484	0.269	453	0.311	388	0.269	
240	574	0.262	573	0.245	616	0.227	674	0.262	560	0.227	532	0.262	456	0.227	
300	666	0.233	662	0.222	713	0.202	761	0.233	630	0.202	601	0.233	525	0.202	
400	779	0.211	772	0.205	832	0.183	865	0.211	715	0.183	699	0.211	596	0.183	
500	903	0.196	893	0.193	961	0.170	977	0.196	805	0.170	791	0.196	693	0.170	
630	1045	0.184	1032	0.182	1111	0.159	1098	0.184	902	0.159	916	0.184	778	0.159	

**Issue: June 2019**

**0.6/1 kV. Made to AS/NZS 5000.1**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# SINGLE CORE AL CANTOL CABLES

Circular construction  
Aluminium conductor  
XLPE insulation  
PVC sheath

<b>Product Sheets No. 130-01 A</b>				
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Thickness of Sheath (mm)</b>	<b>Nominal Overall Diameter (mm)</b>	<b>Linear Mass (kg/m)</b>
25	0.9	1.4	10.9	0.15
35	0.9	1.4	11.8	0.18
50	1.0	1.4	13.3	0.24
70	1.1	1.4	15.0	0.32
95	1.1	1.5	16.9	0.42
120	1.2	1.5	18.5	0.51
150	1.4	1.6	20.6	0.62
185	1.6	1.6	22.7	0.76
240	1.7	1.7	25.5	0.97
300	1.8	1.8	27.9	1.2
400	2.0	1.9	31.3	1.5
500	2.2	2.0	35.0	1.9
630	2.4	2.2	39.4	2.4
800	2.6	2.3	44.7	3.0

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

Notes:

1. Conductors are compact circular stranded.
2. Standard colours: Insulation - Natural; Sheath - Black. Other colours can be supplied if required.
3. Subject to confirmation, similar cables can be manufactured to other specifications.

# SINGLE CORE AL CANTOL CABLES









Circular construction

Aluminium conductor

XLPE insulation

PVC sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 130-01 B</b>														
Conductor Size (mm <sup>2</sup> )														
	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)
25	100	3.08	100	2.67	107	2.67	149	3.08	125	2.67	109	3.08	93	2.67
35	122	2.24	122	1.94	131	1.94	179	2.24	150	1.94	131	2.24	113	1.94
50	150	1.65	150	1.44	161	1.43	212	1.65	178	1.43	157	1.65	135	1.43
70	191	1.15	191	1.00	205	0.997	260	1.15	217	0.997	194	1.15	169	0.997
95	238	0.840	238	0.733	255	0.727	311	0.840	260	0.727	236	0.840	203	0.727
120	278	0.672	278	0.589	298	0.582	355	0.672	296	0.582	270	0.672	236	0.582
150	320	0.557	320	0.491	344	0.482	398	0.557	332	0.482	303	0.557	266	0.482
185	374	0.455	373	0.404	402	0.394	453	0.455	377	0.394	352	0.455	303	0.394
240	449	0.363	448	0.327	482	0.314	526	0.363	438	0.314	415	0.363	356	0.314
300	520	0.307	519	0.281	559	0.266	595	0.307	495	0.266	471	0.307	412	0.266
400	615	0.261	613	0.243	659	0.226	683	0.261	567	0.226	552	0.261	473	0.226
500	722	0.228	717	0.216	773	0.197	780	0.228	646	0.197	631	0.228	556	0.197
630	849	0.204	842	0.198	906	0.177	891	0.204	736	0.177	744	0.204	635	0.177
800	-	-	964	0.182	1037	0.161	-	-	825	0.161	-	-	706	0.161

**Issue: June 2019**

**0.6/1 kV. Made to AS/NZS 5000.1**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# TWO CORE & EARTH CU REMOLEX CABLES

Circular construction

Copper conductor

PVC insulation

PVC sheath

<b>Product Sheet No. 021-02 A</b>				
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Thickness of Sheath (mm)</b>	<b>Nominal Overall Diameter (mm)</b>	<b>Linear Mass (kg/m)</b>
1.5*	0.6	1.2	8.8	0.12
2.5	0.7	1.2	9.7	0.16
4 (2.5)	0.8	1.3	11.3	0.21
6 (2.5)	0.8	1.3	12.2	0.26
10 (4)	1.0	1.3	16.1	0.44

**Issue: June 2019**  
**450/750 V. Made to AS/NZS 5000.2**

\* 3 wire conductor

Notes:

1. Conductors 2.5 mm<sup>2</sup> and above are circular stranded.
2. Standard colours: Insulation - Red, Black, Green/Yellow (earth); Sheath – Black.
3. Reduced earth size shown in brackets ( ).
4. Subject to confirmation, similar cables can be manufactured to other specifications.



## TWO CORE & EARTH CU REMOLEX CABLES



Circular construction

Copper conductor

PVC insulation

PVC sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 021-02 B</b>				
Conductor Size  (mm <sup>2</sup> )				
	(A)	(mV/A.m)	(A)	(mV/A.m)
1.5	21	33.0	22	33.0
2.5	30	18.0	31	18.0
4	39	11.2	42	11.2
6	50	7.50	52	7.50
10	68	4.46	73	4.46

**Issue: June 2019**  
**450/750 V. Made to AS/NZS 5000.2**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature                      30°C

# THREE CORE & EARTH CU REMOLEX CABLES

Circular construction

Copper conductor

PVC insulation

PVC sheath

<b>Product Sheet No. 021-03 A</b>				
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Thickness of Sheath (mm)</b>	<b>Nominal Overall Diameter (mm)</b>	<b>Linear Mass (kg/m)</b>
1.5*	0.6	1.2	9.6	0.15
2.5	0.7	1.3	10.8	0.20
4 (2.5)	0.8	1.3	12.4	0.27
6 (2.5)	0.8	1.3	13.5	0.34
10 (4)	1.0	1.4	16.6	0.54
16 (6)	1.0	1.5	19.0	0.76

**Issue: June 2019**  
**450/750 V. Made to AS/NZS 5000.2**

\* 3 wire conductor

Notes:

1. Conductors 2.5 mm<sup>2</sup> and above are circular stranded.
2. Standard colours: Insulation - Red, White, Blue, Green/Yellow (earth); Sheath - Black.
3. Reduced earth size shown in brackets ( ).
4. Subject to confirmation, similar cables can be manufactured to other specifications.

# THREE CORE & EARTH CU REMOLEX CABLES



Circular construction

Copper conductor

PVC insulation

PVC sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 021-03 B</b>				
Conductor Size  (mm <sup>2</sup> )				
	(A)	(mV/A.m)	(A)	(mV/A.m)
1.5	17	28.6	18	28.6
2.5	25	15.6	26	15.6
4	33	9.71	35	9.71
6	42	6.49	46	6.49
10	58	3.86	62	3.86
16	78	2.43	82	2.43

**Issue: June 2019**  
**450/750 V. Made to AS/NZS 5000.2**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-  
Ambient Air Temperature                      30°C

# FOUR CORE & EARTH CU REMOLEX CABLES

Circular construction

Copper conductor

PVC insulation

PVC sheath

<b>Product Sheet No. 021-04 A</b>				
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Thickness of Sheath (mm)</b>	<b>Nominal Overall Diameter (mm)</b>	<b>Linear Mass (kg/m)</b>
1.5	0.6	1.2	10.4	0.17
2.5	0.7	1.3	11.8	0.24
4 (2.5)	0.8	1.4	13.9	0.34

**Issue: June 2019**  
**450/750 V. Made to AS/NZS 5000.2**

Notes:

1. Conductors 2.5 mm<sup>2</sup> and above are circular stranded.
2. Standard colours: Insulation - Red, White, Blue, Black, Green/Yellow (earth); Sheath – Black.
3. Reduced earth size shown in brackets ( ).
4. Subject to confirmation, similar cables can be manufactured to other specifications.

# FOUR CORE & EARTH CU REMOLEX CABLES



Circular construction

Copper conductor

PVC insulation

PVC sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 021-04 B</b>				
Conductor Size (mm <sup>2</sup> )				
	(A)	(mV/A.m)	(A)	(mV/A.m)
1.5	17	28.6	18	28.6
2.5	25	15.6	26	15.6
4	33	9.71	35	9.71

**Issue: June 2019**  
**450/750 V. Made to AS/NZS 5000.2**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-  
 Ambient Air Temperature                      30°C

# TWO CORE & EARTH CU CEMPEX CABLES

Circular construction

Copper conductor

XLPE insulation

PVC sheath

<b>Product Sheet No. 161-02 A</b>				
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Thickness of Sheath (mm)</b>	<b>Nominal Overall Diameter (mm)</b>	<b>Linear Mass (kg/m)</b>
<b>10 (4)</b>	0.7	1.8	14.9	0.39
<b>16 (6)</b>	0.7	1.8	16.9	0.51
<b>25 (6)</b>	0.9	1.8	19.9	0.74

**Issue: January 2018**  
**0.6/1 kV. Made to AS/NZS 5000.1**

Notes:

1. Conductors 16 mm<sup>2</sup> and above are circular stranded.
2. Standard colours: Insulation - Red, Black, Green/Yellow (earth); Sheath – Black.
3. Reduced earth size shown in brackets ( ).
4. Subject to confirmation, similar cables can be manufactured to other specifications.

# TWO CORE & EARTH CU CEMPEX CABLES



Circular construction

Copper conductor

XLPE insulation

PVC sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 161-02 B</b>				
Conductor Size  (mm <sup>2</sup> )				
	(A)	(mV/A.m)	(A)	(mV/A.m)
10	80	4.68	86	4.68
16	107	2.96	114	2.96
25	144	1.86	154	1.86

**Issue: January 2018**  
**0.6/1 kV. Made to AS/NZS 5000.1**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-  
Ambient Air Temperature                      30°C

# THREE CORE & EARTH CU CEMPEX CABLES

Circular construction

Copper conductor

XLPE insulation

PVC sheath

<b>Product Sheet No. 161-03 A</b>				
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Thickness of Sheath (mm)</b>	<b>Nominal Overall Diameter (mm)</b>	<b>Linear Mass (kg/m)</b>
<b>4 (2.5)</b>	0.7 (0.7)	1.8	13.3	0.28
<b>6 (2.5)</b>	0.7 (0.7)	1.8	14.2	0.35
<b>10 (4)</b>	0.7 (0.7)	1.8	16.3	0.52
<b>16 (6)</b>	0.7 (0.7)	1.8	18.6	0.71
<b>25 (6)</b>	0.9 (0.7)	1.8	21.5	1.0
<b>35 (10)</b>	0.9 (0.7)	1.8	24.1	1.4
<b>50 (16)</b>	1.0 (0.7)	1.8	27.2	1.8
<b>70 (25)</b>	1.1 (0.9)	1.9	31.2	2.6
<b>95 (25)</b>	1.1 (0.9)	2.0	35.6	3.4

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

Notes:

1. Conductors are circular stranded, sizes 16 mm<sup>2</sup> and above are compacted.
2. Standard colours: Insulation - Red, White, Blue, Green/Yellow (earth); Sheath – Black.
3. Earth size and insulation thickness shown in brackets ( ).
4. Subject to confirmation, similar cables can be manufactured to other specifications.



# THREE CORE & EARTH CU CEMPEX CABLES





Circular construction

Copper conductor

XLPE insulation

PVC sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 161-03 B</b>								
Conductor Size (mm <sup>2</sup> )								
	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)
4	42	10.2	39	10.2	40	10.2	40	10.2
6	53	6.80	50	6.80	49	6.80	49	6.80
10	73	4.05	68	4.05	67	4.05	67	4.05
16	97	2.55	91	2.55	118	2.55	87	2.55
25	131	1.61	122	1.61	153	1.61	114	1.61
35	162	1.17	151	1.17	184	1.17	139	1.17
50	198	0.868	185	0.868	218	0.868	166	0.868
70	252	0.609	234	0.609	269	0.609	207	0.609
95	311	0.450	289	0.450	323	0.450	249	0.450

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

## FOUR CORE & EARTH CU CEMPEX CABLES

Circular construction

Copper conductor

XLPE insulation

PVC sheath

<b>Product Sheet No. 161-04 A</b>				
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Thickness of Sheath (mm)</b>	<b>Nominal Overall Diameter (mm)</b>	<b>Linear Mass (kg/m)</b>
2.5	0.7	1.8	14.5	0.30
4 (2.5)	0.7 (0.7)	1.8	15.6	0.37
6 (2.5)	0.7 (0.7)	1.8	15.7	0.43
10 (4)	0.7 (0.7)	1.8	19.2	0.66
16 (6)	0.7 (0.7)	1.8	20.5	0.90
25 (6)	0.9 (0.7)	1.8	23.9	1.3
35 (10)	0.9 (0.7)	1.8	26.6	1.7
50 (16)	1.0 (0.7)	1.8	30.3	2.3
70 (25)	1.1 (0.9)	2.0	34.9	3.3
95 (25)	1.1 (0.9)	2.1	39.0	4.4

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

Notes:

1. Conductors are circular stranded, sizes 16 mm<sup>2</sup> and above are compacted.
2. Standard colours: Insulation - Red, White, Blue, Black, Green/Yellow (earth); Sheath – Black.
3. Earth size and insulation thickness shown in brackets ( ).
4. Subject to confirmation, similar cables can be manufactured to other specifications.

## FOUR CORE & EARTH CU CEMPEX CABLES





Circular construction

Copper conductor

XLPE insulation

PVC sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 161-04 B</b>								
Conductor Size (mm <sup>2</sup> )								
	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)
2.5	29	16.4	31	16.4	31	16.4	31	16.4
4	39	10.2	42	10.2	40	10.2	40	10.2
6	50	6.80	53	6.80	49	6.80	49	6.80
10	68	4.05	73	4.05	67	4.05	67	4.05
16	91	2.55	97	2.55	118	2.55	87	2.55
25	122	1.61	131	1.61	153	1.61	114	1.61
35	151	1.17	162	1.17	184	1.17	139	1.17
50	185	0.868	198	0.868	218	0.868	166	0.868
70	234	0.609	252	0.609	269	0.609	207	0.609
95	289	0.450	311	0.450	323	0.450	249	0.450

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# TWO CORE CU PVC ARMoured MAINS CABLES

Circular construction

Copper conductor

PVC insulation

Extruded bedding

Galvanised steel wire armour

PVC sheath

<b>Product Sheet No. 140-02 A</b>							
Conductor Size (mm <sup>2</sup> )	Thickness of		Armour Wire Size (mm)	Thickness of Sheath (mm)	Nominal Diameters		Linear Mass (kg/m)
	Insulation (mm)	Bedding (mm)			Bedding (mm)	Overall (mm)	
2.5*	0.8	1.0	0.9	1.8	9.6	14.9	0.43
4*	1.0	1.0	0.9	1.8	11.5	17.1	0.58
6*	1.0	1.0	1.25	1.8	12.6	18.9	0.74

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

\* Circular stranded conductor

Notes:

1. Standard Colours: Insulation – Red, Black; Sheath – Black.
2. Subject to confirmation, similar cables can be manufactured to other specifications.

# TWO CORE CU PVC ARMoured MAINS CABLES

Circular construction

Copper conductor





PVC insulation

Extruded bedding

Galvanised steel wire armour

PVC sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 140-02 B</b>									
Conductor Size (mm <sup>2</sup> )									
	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	
2.5	30	18.0	31	18.0	33	18.0	33	18.0	
4	39	11.2	42	11.2	43	11.2	43	11.2	
6	50	7.50	52	7.50	55	7.50	55	7.50	
<b>Issue: June 2019</b>									
<b>0.6/1 kV. Made to AS/NZS 5000.1</b>									

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# THREE CORE CU PVC ARMoured MAINS CABLES

Circular construction

Copper conductor

PVC insulation

Extruded bedding

Galvanised steel wire armour

PVC sheath

<b>Product Sheet No. 140-03 A</b>							
Conductor Size (mm <sup>2</sup> )	Thickness of		Armour Wire Size (mm)	Thickness of Sheath (mm)	Nominal Diameters		Linear Mass (kg/m)
	Insulation (mm)	Bedding (mm)			Bedding (mm)	Overall (mm)	
2.5	0.8	1.0	0.9	1.8	10.2	15.8	0.48
4	1.0	1.0	1.25	1.8	12.2	18.5	0.71
6	1.0	1.0	1.25	1.8	13.4	19.7	0.83
10	1.0	1.0	1.25	1.8	15.3	21.6	1.0
16	1.0	1.0	1.25	1.8	17.5	23.8	1.3
25	1.2	1.0	1.6	1.8	19.0	26.0	1.8

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

Notes:

1. Standard Colours: Insulation – Red, White, Blue; Sheath – Black.
2. Subject to confirmation, similar cables can be manufactured to other specifications.

# THREE CORE CU PVC ARMoured MAINS CABLES

Circular construction

Copper conductor





PVC insulation

Extruded bedding

Galvanised steel wire armour

PVC sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 140-03 B</b>								
Conductor Size (mm <sup>2</sup> )								
	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)
2.5	25	15.6	26	15.6	28	15.6	28	15.6
4	33	9.71	35	9.71	36	9.71	36	9.71
6	42	6.49	46	6.49	46	6.49	46	6.49
10	58	3.86	62	3.86	61	3.86	61	3.86
16	78	2.43	82	2.43	106	2.43	80	2.43
25	104	1.54	111	1.54	138	1.54	103	1.54

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# FOUR CORE CU PVC ARMoured MAINS CABLES

Circular construction

Copper conductor

PVC insulation

Extruded bedding

Galvanised steel wire armour

PVC sheath

<b>Product Sheet No. 140-04 A</b>							
Conductor Size (mm <sup>2</sup> )	Thickness of		Armour Wire Size (mm)	Thickness of Sheath (mm)	Nominal Diameters		Linear Mass (kg/m)
	Insulation (mm)	Bedding (mm)			Bedding (mm)	Overall (mm)	
2.5	0.8	1.0	0.9	1.8	11.2	16.7	0.54
4	1.0	1.0	1.25	1.8	13.5	19.7	0.81
6	1.0	1.0	1.25	1.8	14.8	21.1	0.96
10	1.0	1.0	1.25	1.8	16.9	23.2	1.2

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

Notes:

1. Standard Colours: Insulation – Red, White, Blue, Black; Sheath – Black.
2. Subject to confirmation, similar cables can be manufactured to other specifications.



# FOUR CORE CU PVC ARMoured MAINS CABLES

Circular construction

Copper conductor





PVC insulation

Extruded bedding

Galvanised steel wire armour

PVC sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 140-04 B</b>								
Conductor Size (mm <sup>2</sup> )								
	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)
2.5	25	15.6	23	15.6	28	15.6	28	15.6
4	33	9.71	29	9.71	36	9.71	36	9.71
6	42	6.49	38	6.49	46	6.49	46	6.49
10	58	3.86	50	3.86	61	3.86	61	3.86

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# FOUR CORE CU XLPE ARMoured MAINS CABLES

Circular construction

Copper conductor

XLPE insulation

Extruded bedding

Galvanised steel wire armour

PVC sheath

<b>Product Sheet No. 160-04 A</b>							
Conductor Size (mm <sup>2</sup> )	Thickness of		Armour Wire Size (mm)	Thickness of Sheath (mm)	Nominal Diameters		Linear Mass (kg/m)
	Insulation (mm)	Bedding (mm)			Bedding (mm)	Overall (mm)	
16*	0.7	1.0	1.25	1.8	17.9	24.2	1.4
25*	0.9	1.0	1.6	1.8	21.3	28.3	2.0
35	0.9	1.0	1.6	1.9	22.7	29.9	2.5
50	1.0	1.0	1.6	2.0	25.6	33.0	3.1
70	1.1	1.2	2.0	2.2	29.7	38.3	4.4
95	1.1	1.2	2.0	2.3	33.4	42.3	5.6
120	1.2	1.4	2.5	2.5	37.2	47.5	7.2
150	1.4	1.4	2.5	2.6	43.7	54.1	8.9
185	1.6	1.4	2.5	2.8	46.7	57.6	11
240	1.7	1.6	2.5	3.0	52.2	63.5	13
300	1.8	1.6	2.5	3.2	57.5	69.2	16
400	2.0	1.8	3.15	3.5	65.0	78.5	21

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

\* Circular stranded conductor

Notes:

1. Conductors 25 mm<sup>2</sup> and above are shaped stranded.
2. Standard Colours: Insulation – Red, White, Blue, Black; Sheath – Black.
3. Subject to confirmation, similar cables can be manufactured to other specifications.

# FOUR CORE CU XLPE ARMoured MAINS CABLES

Circular construction

Copper conductor





XLPE insulation

Extruded bedding

Galvanised steel wire armour

PVC sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 160-04 B</b>								
Conductor Size (mm <sup>2</sup> )								
	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)
16	91	2.55	97	2.55	118	2.55	87	2.55
25	122	1.61	131	1.61	153	1.61	114	1.61
35	151	1.17	162	1.17	184	1.17	139	1.17
50	185	0.868	198	0.868	218	0.868	166	0.868
70	234	0.609	252	0.609	269	0.609	207	0.609
95	289	0.450	311	0.450	323	0.450	249	0.450
120	337	0.366	363	0.366	368	0.366	289	0.366
150	385	0.307	415	0.307	412	0.307	325	0.307
185	444	0.259	480	0.259	465	0.259	372	0.259
240	527	0.216	569	0.216	539	0.216	440	0.216
300	604	0.190	653	0.190	607	0.190	495	0.190
400	695	0.171	754	0.171	685	0.171	561	0.171

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# MULTICORE CONTROL CABLES

Circular construction

Copper conductor

PVC insulation

PVC sheath

<b>Product Sheet No. 050-01 A</b>				
<b>Number of Cores</b>	<b>Thickness of Insulation (mm)</b>	<b>Thickness of Sheath (mm)</b>	<b>Nominal Overall Diameter (mm)</b>	<b>Linear Mass (kg/m)</b>
<b>1.5mm<sup>2</sup> (3W) Conductor Size</b>				
2	0.6	1.2	8.5	0.11
3	0.6	1.2	8.9	0.12
4	0.6	1.2	9.7	0.15
7	0.6	1.3	11.7	0.23
12	0.6	1.4	15.3	0.38
19	0.6	1.5	18.1	0.56
27	0.6	1.6	22.0	0.75
37	0.6	1.6	24.6	0.99
<b>2.5mm<sup>2</sup> (7W) Conductor Size</b>				
2	0.7	1.2	9.6	0.14
3	0.7	1.2	10.2	0.17
4	0.7	1.3	11.3	0.21
7	0.7	1.3	13.3	0.32
12	0.7	1.5	17.9	0.55
19	0.7	1.6	21.1	0.80
27	0.7	1.7	25.7	1.07
37	0.7	1.8	28.9	1.43
<b>Issue: June 2019</b>				
<b>450/750 V. Made to AS/NZS 5000.3</b>				

Notes:

1. Other core configurations can be supplied if required.
2. Core identification is by the means of numbers.
3. Subject to confirmation, similar cables can be manufactured to other specifications.
4. Multicore Control Cables can also be manufactured with a Green/Yellow earth.

# MULTICORE CONTROL CABLES



Circular construction

Copper conductor

PVC insulation

PVC sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 050-01 B</b>				
Conductor Size (mm <sup>2</sup> )				
	(A)	(mV/A.m)	(A)	(mV/A.m)
1.5	21	33.0	17	28.6
2.5	30	18.0	25	15.6

**Issue: June 2019**  
**450/750 V. Made to NZS 5000.3**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-  
Ambient Air Temperature 30°C

## Multi Circuit Operation

The current ratings given above are single circuit ratings, i.e, they relate to a single set of 2 or 3 loaded conductors. Whilst these cables are not intended for use as power cables, if they are to be operated with more than one set of conductors loaded for significant periods, the ratings given above should be reduced by application of an appropriate rating factor from the following table:

<b>Rating Factors for No. of Circuits</b>												
No. of circuits	2	3	4	5	6	8	10	12	14	16	18	20 or more
Rating factor	0.80	0.70	0.65	0.60	0.57	0.52	0.48	0.45	0.43	0.41	0.39	0.38

A cable consisting of n loaded conductors should be considered as n/2 circuits of two loaded conductors or n/3 circuits of three loaded conductors as applicable.

# MULTICORE ARMoured CONTROL CABLES

Circular construction

Copper conductor

PVC insulation

Extruded bedding

Galvanised steel wire armour

PVC sheath

<b>Product Sheet No. Cables 060-01 A</b>							
Number of Cores	Thickness of		Armour Wire Size (mm)	Thickness of Sheath (mm)	Nominal Diameters		Linear Mass (kg/m)
	Insulation (mm)	Bedding (mm)			Bedding (mm)	Overall (mm)	
<b>1.5mm<sup>2</sup> (3W) Conductor Size</b>							
2	0.6	0.8	0.9	1.4	7.7	12.4	0.32
3	0.6	0.8	0.9	1.4	8.1	12.9	0.33
4	0.6	0.8	0.9	1.4	8.9	13.7	0.38
7	0.6	0.8	0.9	1.4	10.7	15.4	0.49
12	0.6	0.8	1.25	1.5	14.1	19.7	0.85
19	0.6	0.8	1.25	1.6	16.7	22.5	1.1
27	0.6	1.0	1.6	1.7	20.8	27.5	1.6
37	0.6	1.0	1.6	1.8	23.3	30.3	1.9
<b>2.5mm<sup>2</sup> (7W) Conductor Size</b>							
2	0.7	0.8	0.9	1.4	8.8	13.5	0.36
3	0.7	0.8	0.9	1.4	9.3	14.1	0.41
4	0.7	0.8	0.9	1.4	10.2	15.0	0.47
7	0.7	0.8	1.25	1.5	12.3	18.0	0.73
12	0.7	0.8	1.25	1.6	16.4	22.3	1.1
19	0.7	1.0	1.6	1.7	19.8	26.6	1.6
27	0.7	1.0	1.6	1.8	24.2	31.2	2.1
37	0.7	1.0	1.6	1.9	27.2	34.4	2.5
<b>Issue: June 2019</b>							
<b>0.6/1 kV. Made to BS 6346</b>							

Notes:

1. Other core configurations can be supplied if required.
2. Core identification is by the means of numbers.
3. Subject to confirmation, similar cables can be manufactured to other specifications.
4. Multicore Control Cables can also be manufactured with a Green/Yellow earth.

# MULTICORE ARMoured CONTROL CABLES

Circular construction

Copper conductor



PVC insulation

Extruded bedding

Galvanised steel wire armour

PVC sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. Cables 060-01 B</b>				
Conductor Size (mm <sup>2</sup> )				
	(A)	(mV/A.m)	(A)	(mV/A.m)
1.5	21	33.0	17	28.6
2.5	30	18.0	25	15.6

**Issue: June 2019**  
**0.6/1 kV. Made to BS 6346**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-  
Ambient Air Temperature 30°C

## Multi Circuit Operation

The current ratings given above are single circuit ratings, i.e they relate to a single set of 2 or 3 loaded conductors. Whilst these cables are not intended for use as power cables, if they are to be operated with more than one set of conductors loaded for significant periods, the ratings given above should be reduced by application of an appropriate rating factor from the following table:

<b>Rating Factors for No. of Circuits</b>												
No. of circuits	2	3	4	5	6	8	10	12	14	16	18	20 or more
Rating factor	0.80	0.70	0.65	0.60	0.57	0.52	0.48	0.45	0.43	0.41	0.39	0.38

A cable consisting of n loaded conductors should be considered as n/2 circuits of two loaded conductors or n/3 circuits of three loaded conductors as applicable.

# VAROLEX CABLES

Circular construction  
 Copper conductor  
 XLPE insulation  
 PVC bedding  
 Copper tape  
 PVC sheath

<b>Product Sheet No. 070-01 A</b>					
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Combined Earth Size (mm<sup>2</sup>)</b>	<b>Nominal Diameter Over Tape (mm)</b>	<b>Nominal Overall Diameter (mm)</b>	<b>Linear Mass (kg/m)</b>
2.5*	0.7	2.5*	10.9	14.6	0.32
4	0.7	4.5	13.0	16.6	0.44
6	0.7	4.5	13.8	17.5	0.51
10	0.7	4.5	14.8	18.5	0.62
16	0.8	7.5	17.0	20.6	0.86
25	0.9	12	19.2	22.8	1.2
35	0.9	18	21.9	25.6	1.6
50	1.0	30	25.1	28.8	2.1
70	1.1	30	28.1	32.0	2.8
95	1.1	48	33.9	38.0	3.9
120	1.2	48	38.9	43.2	4.7
150	1.4	75	42.6	47.3	5.9
185	1.6	75	47.5	52.0	7.1
240	1.7	105	53.6	58.9	9.2

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

\* Split earth not feasible, therefore a single earth conductor is utilised.

Notes:

1. Conductors are circular stranded.
2. Standard colours: Insulation - Red, White, Blue, Green/Yellow (earth); Sheath – Black.
3. These cables are specifically designed to suit the wide range of requirements of Variable Speed Drives. All features reducing the transmission of electromagnetic interference have been considered: the cable minimises capacitance of the power conductors, has an electrically balanced construction including split earths and has a copper screen.



# VAROLEX CABLES

Circular construction

Copper conductor





XLPE insulation

PVC bedding

Copper tape

PVC sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 070-01 B</b>								
Conductor Size (mm <sup>2</sup> )								
	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)
2.5	29	16.4	31	16.4	31	16.4	31	16.4
4	39	10.2	42	10.2	40	10.2	40	10.2
6	50	6.80	53	6.80	49	6.80	49	6.80
10	68	4.05	73	4.05	67	4.05	67	4.05
16	91	2.55	97	2.55	118	2.55	87	2.55
25	122	1.61	131	1.61	153	1.61	114	1.61
35	151	1.17	162	1.17	184	1.17	139	1.17
50	185	0.868	198	0.868	218	0.868	166	0.868
70	234	0.609	252	0.609	269	0.609	207	0.609
95	289	0.450	311	0.450	323	0.450	249	0.450
120	337	0.366	363	0.366	368	0.366	289	0.366
150	385	0.307	415	0.307	412	0.307	325	0.307
185	444	0.259	480	0.259	465	0.259	372	0.259
240	527	0.216	569	0.216	539	0.216	440	0.216

**Issue: June 2019**

**0.6/1 kV. Made to AS/NZS 5000.1**

Notes: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature	30°C	Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m	Soil Temperature	15°C

The cable size should be confirmed with the Drive manufacturer before installation due to the possible derating caused by Harmonics.

# FOUR CORE AL XLPE URD CABLES

Circular construction  
 Aluminium conductor  
 XLPE insulation  
 PVC sheath

<b>Product Sheet No. 171-04 A</b>				
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Thickness of Sheath (mm)</b>	<b>Nominal Overall Diameter (mm)</b>	<b>Linear Mass (kg/m)</b>
50	1.0	1.8	29.1	0.94
70	1.1	2.0	32.0	1.3
95	1.1	2.1	36.6	1.6
120	1.2	2.3	39.8	2.0
185	1.6	2.6	49.6	3.1
240	1.7	2.8	55.3	3.9
300	1.8	3.0	60.2	4.9

**Issue: June 2019**  
**0.6/1 kV. Made to AS 4026**

Notes:

1. Conductors 70 mm<sup>2</sup> and above are shaped stranded.
2. Standard Colours: Insulation – Red, White, Blue, Black; Sheath – Black.
3. Subject to confirmation, similar cables can be manufactured to other specifications.

# FOUR CORE AL XLPE URD CABLES





Circular construction

Aluminium conductor

XLPE insulation

PVC sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 171-04 B</b>								
Conductor Size (mm <sup>2</sup> )								
	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)
50	143	1.43	154	1.43	170	1.43	128	1.43
70	182	0.993	196	0.993	209	0.993	161	0.993
95	224	0.723	242	0.723	250	0.723	194	0.723
120	262	0.577	282	0.577	286	0.577	225	0.577
185	347	0.388	374	0.388	364	0.388	291	0.388
240	413	0.307	446	0.307	423	0.307	345	0.307
300	475	0.258	514	0.258	477	0.258	391	0.258
<b>Issue: June 2019</b>								
<b>0.6/1 kV. Made to AS 4026</b>								

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# SINGLE CORE CU ALSECURE CABLES (FLEXIBLE)

Circular construction

Flexible Copper conductor

Fibre Glass Tape (MICA Tape)

X-HF-110 insulation

HFS-110-TP sheath

<b>Product Sheet No. 181-01 A</b>				
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Thickness of Sheath (mm)</b>	<b>Nominal Overall Diameter (mm)</b>	<b>Linear Mass (kg/m)</b>
10	0.7	1.4	8.9	0.18
16	0.7	1.4	10.1	0.24
25	0.9	1.4	11.6	0.34
35	0.9	1.4	13.5	0.44
50	1.0	1.4	15.3	0.63
70	1.1	1.4	17.2	0.82
95	1.1	1.5	19.3	1.10
120	1.2	1.5	21.6	1.34
150	1.4	1.6	23.5	1.62
185	1.6	1.6	26.2	1.96
240	1.7	1.7	29.1	2.54
300	1.8	1.8	31.8	3.09
400	2.0	1.9	35.9	3.96
500	2.2	2.0	40.8	5.10
630	2.4	2.2	45.0	6.46

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

Notes:

1. Conductors are flexible circular stranded (Class 5).
2. Standard colours: Insulation - White; Sheath - Red.
3. Subject to confirmation, similar cables can be manufactured to other specifications.
4. AS/NZS 3013- WS525W rating (See explanatory information)

# SINGLE CORE CU ALSECURE CABLES (FLEXIBLE)

Circular construction








Flexible Copper conductor

Fibre Glass Tape (MICA Tape)

X-HF-110 insulation

HFS-110-TP sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 181-01 B</b>														
Conductor Size (mm <sup>2</sup> )														
	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)
10	86	4.97	86	4.30	76	4.30	93	4.97	82	4.30	91	4.97	81	4.30
16	112	3.13	112	2.70	100	2.70	163	3.13	138	2.70	119	3.13	103	2.70
25	149	1.99	149	1.72	133	1.72	210	1.99	178	1.72	152	1.99	133	1.72
35	184	1.44	184	1.24	166	1.24	252	1.44	213	1.24	187	1.44	160	1.24
50	233	1.07	232	0.924	210	0.924	299	1.07	251	0.924	228	1.07	199	0.924
70	292	0.759	292	0.650	265	0.650	367	0.759	308	0.650	282	0.759	243	0.650
95	352	0.567	352	0.481	319	0.481	441	0.567	369	0.481	331	0.567	284	0.481
120	417	0.465	417	0.392	381	0.392	501	0.465	420	0.392	381	0.465	335	0.392
150	482	0.397	482	0.331	440	0.331	563	0.397	472	0.331	439	0.397	378	0.331
185	552	0.342	552	0.280	505	0.280	637	0.342	533	0.280	492	0.342	428	0.280
240	664	0.291	663	0.235	608	0.235	740	0.291	618	0.235	581	0.291	510	0.235
300	766	0.262	764	0.208	701	0.208	836	0.262	696	0.208	669	0.262	575	0.208
400	920	0.240	915	0.187	840	0.187	952	0.240	791	0.187	778	0.240	687	0.187
500	1069	0.225	1059	0.172	972	0.172	1079	0.225	894	0.172	906	0.225	773	0.172
630	1250	0.213	1235	0.160	1133	0.160	1217	0.213	1004	0.160	1036	0.213	878	0.160

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Maximum operating Temperature	110°C
Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

## TWO CORE & EARTH CU ALSECURE CABLES (FLEXIBLE)

Circular construction

Flexible Copper conductor

Fibre Glass Tape (MICA Tape)

X-HF-110 insulation

HFS-110-TP sheath

<b>Product Sheet No. 182-01 A</b>				
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Thickness of Sheath (mm)</b>	<b>Nominal Overall Diameter (mm)</b>	<b>Linear Mass (kg/m)</b>
2.5	0.7	1.8	14.2	0.27
<b>Issue: January 2018</b> <b>0.6/1 kV. Made to AS/NZS 5000.1</b>				

Notes:

1. Standard colours: Insulation - Red, Black, Green/Yellow (earth); Sheath – RED.
2. Subject to confirmation, similar cables can be manufactured to other specifications.
3. AS/NZS 3013- WS525W rating (See explanatory information)

# TWO CORE & EARTH CU ALSECURE CABLES (FLEXIBLE)

Circular construction





Flexible Copper conductor

Fibre Glass Tape (MICA Tape)

X-HF-110 insulation

HFS-110-TP sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 182-01 B</b>									
Conductor Size (mm <sup>2</sup> )									
	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	
2.5	41	27.0	44	27.0	41	27.0	39	27.0	
<b>Issue: June 2019</b>									
<b>0.6/1 kV. Made to AS/NZS 5000.1</b>									

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Maximum operating Temperature	110°C
Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# FOUR CORE & EARTH CU ALSECURE CABLES (FLEXIBLE)

Circular construction

Flexible Copper conductor

Fibre Glass Tape (MICA Tape)

X-HF-110 insulation

HFS-110-TP sheath

<b>Product Sheet No. 181-03 A</b>				
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Thickness of Sheath (mm)</b>	<b>Nominal Overall Diameter (mm)</b>	<b>Linear Mass (kg/m)</b>
1.5	0.7	1.8	15.3	0.29
2.5	0.7	1.8	16.7	0.32
4 (2.5)	0.7 (0.7)	1.8	17.9	0.46
6 (2.5)	0.7 (0.7)	1.8	18.1	0.52
10 (4)	0.7 (0.7)	1.8	21.1	0.80
16 (6)	0.7 (0.7)	1.8	23.9	1.10
25 (6)	0.9 (0.7)	1.8	27.7	1.75
35 (10)	0.9 (0.7)	1.8	31.5	2.30
50 (16)	1.0 (0.7)	2.0	35.9	3.12
<b>Issue: June 2019</b>				
<b>0.6/1 kV. Made to AS/NZS 5000.1</b>				

Notes:

1. Note class 2 conductor 1.5mm<sup>2</sup> to 6mm<sup>2</sup>.
2. Standard colours: Insulation - Red, White, Blue, Black, Green/Yellow (earth); Sheath – Red.
3. Earth size and insulation thickness shown in brackets ( ).
4. Subject to confirmation, similar cables can be manufactured to other specifications.
5. AS/NZS 3013- WS525W rating (See explanatory information)



# FOUR CORE & EARTH CU ALSECURE CABLES (FLEXIBLE)

Circular construction





Flexible Copper conductor

Fibre Glass Tape (MICA Tape)

X-HF-110 insulation

HFS-110-TP sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 181-03 B</b>								
Conductor Size (mm <sup>2</sup> )								
	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)
1.5	26	31.9	28	31.9	25	31.9	25	31.9
2.5	34	17.4	36	17.4	35	17.4	33	17.4
4	45	10.8	48	10.8	46	10.8	43	10.8
6	58	7.22	61	7.22	56	7.22	54	7.22
10	80	4.29	86	4.29	75	4.29	75	4.29
16	106	2.70	113	2.70	129	2.70	96	2.70
25	140	1.71	150	1.71	167	1.71	125	1.71
35	173	1.24	185	1.24	201	1.24	152	1.24
50	218	0.920	233	0.920	240	0.920	189	0.920

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Maximum operating Temperature	110°C
Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# SINGLE CORE CU ENVIROLEX CABLES (FLEXIBLE)

Circular construction

Flexible Copper conductor

X-HF-110 insulation

HFS-110-TP sheath

<b>Product Sheet No. 183-01 A</b>				
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Thickness of Sheath (mm)</b>	<b>Nominal Overall Diameter (mm)</b>	<b>Linear Mass (kg/m)</b>
10	0.7	1.4	8.5	0.14
16	0.7	1.4	9.8	0.23
25	0.9	1.4	11.3	0.31
35	0.9	1.4	12.6	0.40
50	1.0	1.4	14.2	0.56
70	1.1	1.4	16.2	0.75
95	1.1	1.5	18.3	0.98
120	1.2	1.5	20.7	1.13
150	1.4	1.6	22.5	1.51
185	1.6	1.6	24.8	1.79
240	1.7	1.7	27.7	2.40
300	1.8	1.8	31.0	2.90
400	2.0	1.9	35.4	3.89
500	2.2	2.0	40.0	4.98
630	2.4	2.2	44.0	6.29

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

Notes:

1. Conductors are flexible circular stranded (Class 5).
2. Standard colours: Insulation - White; Sheath - Black.
3. Subject to confirmation, similar cables can be manufactured to other specifications.

# SINGLE CORE CU ENVIROLEX CABLES (FLEXIBLE)








Circular construction

Flexible Copper conductor

X-HF-110 insulation

HFS-110-TP sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 183-01 B</b>														
Conductor Size (mm <sup>2</sup> )														
	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)
10	86	4.97	86	4.30	76	4.30	93	4.97	82	4.30	91	4.97	81	4.30
16	112	3.13	112	2.70	100	2.70	163	3.13	138	2.70	119	3.13	103	2.70
25	149	1.99	149	1.72	133	1.72	210	1.99	178	1.72	152	1.99	133	1.72
35	184	1.44	184	1.24	166	1.24	252	1.44	213	1.24	187	1.44	160	1.24
50	233	1.07	232	0.924	210	0.924	299	1.07	251	0.924	228	1.07	199	0.924
70	292	0.759	292	0.650	265	0.650	367	0.759	308	0.650	282	0.759	243	0.650
95	352	0.567	352	0.481	319	0.481	441	0.567	369	0.481	331	0.567	284	0.481
120	417	0.465	417	0.392	381	0.392	501	0.465	420	0.392	381	0.465	335	0.392
150	482	0.397	482	0.331	440	0.331	563	0.397	472	0.331	439	0.397	378	0.331
185	552	0.342	552	0.280	505	0.280	637	0.342	533	0.280	492	0.342	428	0.280
240	664	0.291	663	0.235	608	0.235	740	0.291	618	0.235	581	0.291	510	0.235
300	766	0.262	764	0.208	701	0.208	836	0.262	696	0.208	669	0.262	575	0.208
400	920	0.240	915	0.187	840	0.187	952	0.240	791	0.187	778	0.240	687	0.187
500	1069	0.225	1059	0.172	972	0.172	1079	0.225	894	0.172	906	0.225	773	0.172
630	1250	0.213	1235	0.162	1133	0.162	1217	0.213	1004	0.162	1036	0.213	878	0.162

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Maximum operating Temperature	110°C
Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# TWO CORE & EARTH CU ENVIROLEX CABLES (FLEXIBLE)

Circular construction

Flexible Copper conductor

X-HF-90 insulation

HFS-90-TP sheath

<b>Product Sheet No. 184-01 A</b>				
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Thickness of Sheath (mm)</b>	<b>Nominal Overall Diameter (mm)</b>	<b>Linear Mass (kg/m)</b>
1.5	0.7	1.8	10.7	0.15
2.5	0.7	1.8	11.6	0.19
4 (2.5)	0.7 (0.7)	1.8	12.9	0.24
6 (2.5)	0.7 (0.7)	1.8	13.6	0.30

**Issue: June 2019**

**0.6/1 kV. Made to AS/NZS 5000.1**

Notes:

1. Standard colours: Insulation - Red, Black, Green/Yellow (earth); Sheath – Orange.
2. Reduced earth size shown in brackets ( ).
3. Subject to confirmation, similar cables can be manufactured to other specifications.

# TWO CORE & EARTH CU ENVIROLEX CABLES (FLEXIBLE)





Circular construction

Flexible Copper conductor

X-HF-90 insulation

HFS-90-TP sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 184-01 B</b>								
Conductor Size (mm <sup>2</sup> )								
	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)
1.5	25	34.7	26	34.7	26	34.7	27	34.7
2.5	33	25.4	35	25.4	36	25.4	35	25.4
4 (2.5)	44	11.8	47	11.8	48	11.8	46	11.8
6 (2.5)	56	7.87	61	7.87	60	7.87	58	7.87

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Maximum operating Temperature	90°C
Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# THREE CORE & EARTH CU ENVIROLEX CABLES (FLEXIBLE)

Circular construction

Flexible Copper conductor

X-HF-90 insulation

HFS-90-TP sheath

<b>Product Sheet No. 184-02 A</b>				
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Thickness of Sheath (mm)</b>	<b>Nominal Overall Diameter (mm)</b>	<b>Linear Mass (kg/m)</b>
1.5	0.7	1.8	11.5	0.18
2.5	0.7	1.8	12.2	0.24
4 (2.5)	0.7 (0.7)	1.8	13.0	0.29
6 (2.5)	0.7 (0.7)	1.8	14.9	0.35
10 (4)	0.7 (0.7)	1.8	17.7	0.52

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

Notes:

1. Standard colours: Insulation - Red, White, Blue, Black, Green/Yellow (earth); Sheath – Orange..
2. Earth size and insulation thickness shown in brackets ( ).
3. Subject to confirmation, similar cables can be manufactured to other specifications.

# THREE CORE & EARTH CU ENVIROLEX CABLES (FLEXIBLE)





Circular construction

Flexible Copper conductor

X-HF-90 insulation

HFS-90-TP sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 184-02 B</b>								
Conductor Size (mm <sup>2</sup> )								
	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)
1.5	21	30.0	22	30.0	21	30.0	22	30.0
2.5	29	16.4	30	16.4	31	16.4	30	16.4
4	37	10.2	40	10.2	40	10.2	39	10.2
6	47	6.81	51	6.81	49	6.81	48	6.81
10	67	4.05	73	4.05	67	4.05	66	4.05

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Maximum operating Temperature	90°C
Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# FOUR CORE & EARTH CU ENVIROLEX CABLES (FLEXIBLE)

Circular construction

Flexible Copper conductor

X-HF-90 insulation

HFS-90-TP sheath

<b>Product Sheet No. 184-03 A</b>				
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Thickness of Sheath (mm)</b>	<b>Nominal Overall Diameter (mm)</b>	<b>Linear Mass (kg/m)</b>
1.5	0.7	1.8	12.5	0.21
2.5	0.7	1.8	13.6	0.28
4 (2.5)	0.7 (0.7)	1.8	15.0	0.34
6 (2.5)	0.7 (0.7)	1.8	16.2	0.42
10 (4)	0.7 (0.7)	1.8	19.5	0.64
16 (6)	0.7 (0.7)	1.8	22.8	0.89
25 (6)	0.9 (0.7)	1.8	26.5	1.30
35 (10)	0.9 (0.7)	1.8	29.5	1.77

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

Notes:

1. Standard colours: Insulation - Red, White, Blue, Black, Green/Yellow (earth); Sheath – Orange..
2. Earth size and insulation thickness shown in brackets ( ).
3. Subject to confirmation, similar cables can be manufactured to other specifications.



# FOUR CORE & EARTH CU ENVIROLEX CABLES (FLEXIBLE)





Circular construction

Flexible Copper conductor

X-HF-90 insulation

HFS-90-TP sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 184-03 B</b>									
Conductor Size (mm <sup>2</sup> )									
	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	
1.5	21	30.0	22	30.0	21	30.0	22	30.0	
2.5	29	16.4	30	16.4	31	16.4	30	16.4	
4	37	10.2	40	10.2	40	10.2	39	10.2	
6	47	6.81	51	6.81	49	6.81	48	6.81	
10	67	4.05	73	4.05	67	4.05	66	4.05	
16	89	2.55	96	2.55	118	2.55	85	2.55	
25	119	1.61	128	1.61	153	1.61	110	1.61	
35	149	1.17	158	1.17	184	1.17	136	1.17	

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Maximum operating Temperature	90°C
Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# VAROLEX CABLES (FLEXIBLE)

Circular construction

Flexible Copper conductor

XLPE insulation

PVC bedding

Copper tape

PVC sheath

<b>Product Sheet No. 070-02 A</b>					
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Combined Earth Size (mm<sup>2</sup>)</b>	<b>Nominal Diameter Over Tape (mm)</b>	<b>Nominal Overall Diameter (mm)</b>	<b>Linear Mass (kg/m)</b>
2.5*	0.7	2.5*	11.0	14.6	0.32
4	0.7	4.5	13.2	16.8	0.44
6	0.7	4.5	15.1	18.7	0.51
10	0.7	4.5	15.7	19.3	0.62
16	0.8	7.5	18.0	21.6	0.86
25	0.9	12	20.9	24.5	1.2
35	0.9	18	23.5	27.1	1.6
50	1.0	30	27.8	31.4	2.1
70	1.1	30	32.0	35.8	2.8
95	1.1	48	36.1	40.3	3.9
120	1.2	48	40.9	45.3	4.7
150	1.4	75	45.6	50.2	5.9
185	1.6	75	50.4	55.2	7.1
240	1.7	105	56.5	61.7	9.2
300	1.8	150	63.2	69.0	12.07

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

\* Split earth not feasible, therefore a single earth conductor is utilised.

Notes:

1. Conductors are circular stranded. (Class 5 & 6)
2. Standard colours: Insulation - Red, White, Blue, Green/Yellow (earth); Sheath – Black.
3. These cables are specifically designed to suit the wide range of requirements of Variable Speed Drives. All features reducing the transmission of electromagnetic interference have been considered: the cable minimises capacitance of the power conductors, has an electrically balanced construction including split earths and has a copper screen.

## VAROLEX CABLES (FLEXIBLE)

Circular construction

Flexible Copper conductor





XLPE insulation

PVC bedding

Copper tape

PVC sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 070-02 B</b>								
Conductor Size  (mm <sup>2</sup> )								
	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)
2.5	29	16.4	30	16.4	31	16.4	30	16.4
4	37	10.2	40	10.2	40	10.2	39	10.2
6	47	6.80	51	6.80	49	6.80	48	6.80
10	67	4.05	73	4.05	67	4.05	66	4.05
16	89	2.55	96	2.55	118	2.55	85	2.55
25	119	1.61	128	1.61	153	1.61	110	1.61
35	149	1.17	158	1.17	184	1.17	136	1.17
50	187	0.868	200	0.868	218	0.868	166	0.868
70	235	0.609	253	0.609	269	0.609	207	0.609
95	282	0.450	303	0.450	323	0.450	242	0.450
120	333	0.366	360	0.366	368	0.366	284	0.366
150	383	0.307	413	0.307	412	0.307	321	0.307
185	436	0.259	471	0.259	465	0.259	363	0.259
240	519	0.216	562	0.216	539	0.216	430	0.216
300	593	0.190	642	0.190	607	0.190	484	0.190

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

Notes: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature	30°C	Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m	Soil Temperature	15°C

The cable size should be confirmed with the Drive manufacturer before installation due to the possible derating caused by Harmonics.

# SINGLE CORE CU VERSOLEX CABLES (FLEXIBLE)

Circular construction

Flexible Copper conductor

X-HF-90 insulation

TPE(5V-90) sheath

<b>Product Sheet No. 185-01 A</b>				
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Thickness of Sheath (mm)</b>	<b>Nominal Overall Diameter (mm)</b>	<b>Linear Mass (kg/m)</b>
10	0.7	1.4	9.2	0.16
16	0.7	1.4	10.2	0.22
25	0.9	1.4	11.8	0.32
35	0.9	1.4	13.1	0.43
50	1.0	1.4	14.9	0.58
70	1.1	1.4	16.9	0.81
95	1.1	1.5	18.9	1.04
120	1.2	1.5	21.4	1.28
150	1.4	1.6	22.9	1.56
185	1.6	1.6	26.0	1.85
240	1.7	1.7	29.2	2.43
300	1.8	1.8	32.3	3.01
400	2.0	1.9	36.4	3.95
500	2.2	2.0	41.0	5.04
630	2.4	2.2	46.8	6.56

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

Notes:

1. Conductors are flexible circular stranded (Class 5).
2. Standard colours: Insulation - White; Sheath - Black
3. Subject to confirmation, similar cables can be manufactured to other specifications.

# SINGLE CORE CU VERSOLEX CABLES (FLEXIBLE)









Circular construction

Flexible Copper conductor

X-HF-90 insulation

TPE(5V-90) sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 185-01 B</b>														
Conductor Size (mm <sup>2</sup> )														
	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)
10	70	4.68	70	4.05	76	4.05	83	4.68	72	4.05	82	4.68	71	4.05
16	94	2.95	94	2.55	100	2.55	149	2.95	125	2.55	105	2.95	91	2.55
25	125	1.87	125	1.62	133	1.62	192	1.87	162	1.62	136	1.87	117	1.62
35	155	1.35	155	1.17	166	1.17	230	1.35	193	1.17	165	1.35	143	1.17
50	196	1.01	196	0.872	210	0.872	273	1.01	229	0.872	203	1.01	174	0.872
70	248	0.710	248	0.615	265	0.615	335	0.710	280	0.615	248	0.710	217	0.615
95	298	0.528	298	0.457	319	0.457	401	0.528	335	0.457	295	0.528	254	0.457
120	354	0.431	354	0.373	381	0.373	457	0.431	381	0.373	341	0.431	299	0.373
150	410	0.365	409	0.316	440	0.316	514	0.365	428	0.316	394	0.365	338	0.316
185	471	0.311	470	0.269	505	0.269	581	0.311	484	0.269	441	0.311	382	0.269
240	567	0.262	565	0.227	608	0.227	674	0.262	560	0.227	520	0.262	445	0.227
300	653	0.233	650	0.202	701	0.202	761	0.233	630	0.202	586	0.233	513	0.202
400	787	0.211	780	0.183	840	0.183	865	0.211	715	0.183	696	0.211	593	0.183
500	913	0.196	903	0.170	972	0.170	977	0.196	805	0.170	784	0.196	687	0.170
630	1066	0.184	1052	0.159	1133	0.159	1098	0.184	902	0.159	920	0.184	780	0.159

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Maximum operating Temperature	90°C
Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# TWO CORE & EARTH CU VERSOLEX CORDS/CABLES (FLEXIBLE)

Circular construction

Flexible Copper conductor

X-90 insulation

TPE(5V-90) sheath

<b>Product Sheet No. 186-01 A</b>				
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Thickness of Sheath (mm)</b>	<b>Nominal Overall Diameter (mm)</b>	<b>Linear Mass (kg/m)</b>
1.5	0.7	1.6	10.2	0.10
2.5	0.7	1.8	11.5	0.19
4 (2.5)	0.7 (0.7)	1.9	12.9	0.25

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 3191**

Notes:

1. Conductors are flexible circular stranded (Class 5).
2. Standard cord colours: Insulation - Brown, Light Blue, Green/Yellow (earth); Sheath – Black.
3. Reduced earth size shown in brackets ( ).
4. Subject to confirmation, similar cables can be manufactured to other specifications.
5. Note this family conductor size up to 4mm<sup>2</sup> can be used as cord OR power cable.
6. For cord application AS/NZS 3191-“Heavy Duty” criteria apply.
7. For power cable application AS/NZS 5000.1 apply.

## TWO CORE & EARTH CU VERSOLEX CORDS/CABLES (FLEXIBLE)

Circular construction

Flexible Copper conductor

X-90 insulation

TPE(5V-90) sheath

Current ratings (A) and voltage drops (mV/A.m)

### Product Sheet No. 186-01 B – (Cord only)

#### - 60°C Maximum operating temperature





Conductor Size (mm <sup>2</sup> )	(A)	(mV/A.m)
1.5	16	30.8
2.5	20	18.4
4 (2.5)	25	11.4

Issue: June 2019

0.6/1 kV. Made to AS/NZS 3191

### Product Sheet No. 186-01 B – (Cable only)

#### - 90°C Maximum operating temperature

Conductor Size (mm <sup>2</sup> )								
	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)
1.5	30	34.7	32	34.7	30	34.7	27	34.7
2.5	41	25.4	44	25.4	41	25.4	35	25.4
4 (2.5)	54	11.8	57	11.8	54	11.8	46	11.8

Issue: June 2019

0.6/1 kV. Made to AS/NZS 3191

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Maximum operating Temperature	60°C or 90°C
Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

## THREE CORE & EARTH CU VERSOLEX CORDS/CABLES (FLEXIBLE)

Circular construction

Flexible Copper conductor

X-90 insulation

TPE(5V-90) sheath

<b>Product Sheet No. 186-02 A</b>				
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Thickness of Sheath (mm)</b>	<b>Nominal Overall Diameter (mm)</b>	<b>Linear Mass (kg/m)</b>
1.5	0.7	1.7	11.2	0.17
2.5	0.7	1.9	12.6	0.24
4 (2.5)	0.7 (0.7)	2.0	14.2	0.31

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 3191**

Notes:

1. Conductors are flexible circular stranded (Class 5).
2. Standard cord colours: Insulation - Brown, Light Blue, White, Green/Yellow (earth); Sheath – Black.
3. Reduced earth size shown in brackets ( ).
4. Subject to confirmation, similar cables can be manufactured to other specifications.
5. Note this family conductor size up to 4mm<sup>2</sup> can be used as cord OR power cable.
6. For cord application AS/NZS 3191-“Heavy Duty” criteria apply.
7. For power cable application AS/NZS 5000.1 apply.



## THREE CORE & EARTH CU VERSOLEX CORDS/CABLES (FLEXIBLE)

Circular construction

Flexible Copper conductor

X-90 insulation

TPE(5V-90) sheath

Current ratings (A) and voltage drops (mV/A.m)

### Product Sheet No. 186-02 B – (Cord only)

#### - 60°C Maximum operating temperature





Conductor Size (mm <sup>2</sup> )	(A)	(mV/A.m)
1.5	16	26.7
2.5	20	16.0
4 (2.5)	25	9.92

Issue: June 2019

0.6/1 kV. Made to AS/NZS 3191

### Product Sheet No. 186-02 B – (Cable only)

#### - 90°C Maximum operating temperature

Conductor Size (mm <sup>2</sup> )								
	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)
1.5	21	30.0	22	30.0	21	30.0	22	30.0
2.5	29	16.4	30	16.4	31	16.4	30	16.4
4	39	10.2	40	10.2	40	10.2	39	10.2

Issue: June 2019

0.6/1 kV. Made to AS/NZS 3191

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Maximum operating Temperature	60°C or 90°C
Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# THREE CORE & EARTH CU VERSOLEX CABLES (FLEXIBLE)

Circular construction

Flexible Copper conductor

X-HF-90 insulation

TPE(5V-90) sheath





<b>Product Sheet No. 187-02 A</b>				
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Thickness of Sheath (mm)</b>	<b>Nominal Overall Diameter (mm)</b>	<b>Linear Mass (kg/m)</b>
<b>6 (2.5)</b>	<b>0.7 (0.7)</b>	<b>1.8</b>	<b>14.9</b>	<b>0.35</b>
<b>Issue: June 2019</b>				
<b>0.6/1 kV. Made to AS/NZS 5000.1</b>				

Notes:

1. Conductors are flexible circular stranded (Class 5).
2. Standard cord colours: Insulation - Red, White, Blue, Green/Yellow (earth); Sheath – Black.
3. Reduced earth size shown in brackets ( ).
4. Subject to confirmation, similar cables can be manufactured to other specifications.
5. Note this family conductor size above 6mm<sup>2</sup> can be used as power cable only.

# THREE CORE & EARTH CU VERSOLEX CABLES (FLEXIBLE)

Circular construction  
 Flexible Copper conductor  
 X-HF-90 insulation  
 TPE(5V-90) sheath  
 Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 187-02 B</b>								
Conductor Size (mm <sup>2</sup> )								
	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)
6	37	6.8	51	6.8	49	10.2	48	6.8
<b>Issue: June 2019</b>								
<b>0.6/1 kV. Made to AS/NZS 5000.1</b>								

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Maximum operating Temperature	90°C
Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# FOUR CORE & EARTH CU VERSOLEX CORDS/CABLES (FLEXIBLE)

Circular construction

Flexible Copper conductor

X-90 insulation

TPE(5V-90) sheath

<b>Product Sheet No. 186-03 A</b>				
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Thickness of Sheath (mm)</b>	<b>Nominal Overall Diameter (mm)</b>	<b>Linear Mass (kg/m)</b>
1.5	0.7	1.8	12.3	0.21
2.5	0.7	2.0	13.9	0.29
4 (2.5)	0.7 (0.7)	2.2	15.9	0.40

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 3191**

Notes:

1. Conductors are flexible circular stranded (Class 5).
2. Standard cord colours: Insulation - Brown, Light Blue, White, Black, Green/Yellow (earth); Sheath – Black.
3. Reduced earth size shown in brackets ( ).
4. Subject to confirmation, similar cables can be manufactured to other specifications.
5. Note this family conductor size up to 4mm<sup>2</sup> can be used as cord OR power cable.
6. For cord application AS/NZS 3191-“Heavy Duty” criteria apply.
7. For power cable application AS/NZS 5000.1 apply.

## FOUR CORE & EARTH CU VERSOLEX CORDS/CABLES (FLEXIBLE)

Circular construction

Flexible Copper conductor

X-90 insulation

TPE(5V-90) sheath

Current ratings (A) and voltage drops (mV/A.m)

### Product Sheet No. 186-03 B – (Cord only)





#### - 60°C Maximum operating temperature

Conductor Size (mm <sup>2</sup> )		
	(A)	(mV/A.m)
1.5	16	26.7
2.5	20	16.0
4 (2.5)	25	9.92

Issue: June 2019  
0.6/1 kV. Made to AS/NZS 3191

### Product Sheet No. 186-03 B – (Cable only)

#### - 90°C Maximum operating temperature

Conductor Size (mm <sup>2</sup> )								
	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)
1.5	21	30.0	22	30.0	21	30.0	22	30.0
2.5	29	16.4	30	16.4	31	16.4	30	16.4
4	39	10.2	40	10.2	40	10.2	39	10.2

Issue: June 2019  
0.6/1 kV. Made to AS/NZS 3191

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Maximum operating Temperature	60°C or 90°C
Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# FOUR CORE & EARTH CU VERSOLEX CORDS/CABLES (FLEXIBLE)

Circular construction

Flexible Copper conductor

X-HF-90 insulation

TPE(5V-90) sheath

<b>Product Sheet No. 187-03 A</b>				
<b>Conductor Size (mm<sup>2</sup>)</b>	<b>Thickness of Insulation (mm)</b>	<b>Thickness of Sheath (mm)</b>	<b>Nominal Overall Diameter (mm)</b>	<b>Linear Mass (kg/m)</b>
<b>6 (2.5)</b>	0.7 (0.7)	1.8	16.2	0.42
<b>10 (4)</b>	0.7 (0.7)	1.8	19.5	0.64
<b>16 (6)</b>	0.7 (0.7)	1.8	22.8	0.89
<b>25 (6)</b>	0.9 (0.7)	1.8	26.5	1.30
<b>35 (10)</b>	0.9 (0.7)	1.8	29.8	1.77

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

Notes:

1. Conductors are flexible circular stranded (Class 5).
2. Standard cord colours: Insulation - Red, White, Blue, Black, Green/Yellow (earth); Sheath – Black.
3. Reduced earth size shown in brackets ( ).
4. Subject to confirmation, similar cables can be manufactured to other specifications.
4. Note this family conductor size above 6mm<sup>2</sup> can be used as power cable only.

# FOUR CORE & EARTH CU VERSOLEX CABLES (FLEXIBLE)





Circular construction

Flexible Copper conductor

X-HF-90 insulation

TPE(5V-90) sheath

Current ratings (A) and voltage drops (mV/A.m)

<b>Product Sheet No. 187-03 B</b>								
Conductor Size (mm <sup>2</sup> )								
	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)	(A)	(mV/A.m)
6	47	6.80	51	6.80	49	6.80	48	6.80
10	67	4.05	73	4.05	67	4.05	66	4.05
16	89	2.55	96	2.55	118	2.55	85	2.55
25	119	1.61	128	1.61	153	1.61	110	1.61
35	149	1.14	158	1.14	184	1.14	136	1.14

**Issue: June 2019**  
**0.6/1 kV. Made to AS/NZS 5000.1**

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Maximum operating Temperature	90°C
Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# CURRENT RATINGS

Copper conductor

PVC insulation

Unarmoured

Sheathed or unsheathed

**Table 3.7 Single Conductor Cu PVC Cables - Single Phase Ratings (A)**

Conductor Size (mm <sup>2</sup> )									
1	18	18	15	15	13	7	24	20	23
1.5	24	24	18	21	16	9	31	25	29
2.5	34	33	26	27	23	14	43	35	40
4	46	44	35	36	29	18	56	45	52
6	58	56	46	47	38	23	71	57	64
10	79	76	62	62	50	31	94	76	85
16	105	101	82	80	64	41	134	98	109
25	141	136	111	107	86	55	174	128	142
35	174	165	136	128	103	67	209	153	171
50	213	202	166	157	125	-	248	185	205
70	271	254	210	194	155	-	305	227	251
95	336	315	262	242	193	-	365	277	306
120	392	366	304	276	220	-	416	316	348
150	450	418	351	321	257	-	466	362	389
185	523	483	408	365	292	-	528	410	449
240	626	576	488	434	348	-	612	482	519
300	725	663	564	-	-	-	691	546	601
400	848	771	658	-	-	-	784	633	683
500	988	889	762	-	-	-	886	714	793
630	1156	1023	878	-	-	-	994	825	898

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.










The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature	30°C	Soil Thermal Resistivity	1.2 K.m/W
Soil Temperature	15°C	Depth of Burial	0.5 m



# CURRENT RATINGS

Aluminium conductor  
 PVC insulation  
 Unarmoured  
 Sheathed or unsheathed

<b>Table 3.8 Single Conductor Al PVC Cables – Single Phase Ratings (A)</b>									
Conductor Size (mm <sup>2</sup> )									
16	82	79	64	62	49	32	105	76	85
25	109	105	86	83	66	42	135	99	110
35	136	129	105	99	80	52	162	119	132
50	165	156	129	122	98	-	191	143	160
70	210	197	163	150	120	-	237	176	195
95	261	244	203	187	149	-	283	215	237
120	304	284	237	214	171	-	323	245	270
150	350	325	272	250	200	-	362	281	301
185	407	377	318	284	227	-	411	320	349
240	487	449	381	340	271	-	477	376	405
300	564	520	442	-	-	-	540	427	468
400	665	610	520	-	-	-	620	499	536
500	781	711	610	-	-	-	708	572	627
630	921	832	715	-	-	-	811	672	717
800									










Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature                      30°C  
 Soil Temperature                                      15°C  
 Soil Thermal Resistivity                      1.2 K.m/W  
 Depth of Burial                                      0.5 m

# CURRENT RATINGS

Copper conductor  
XLPE insulation (X-90)  
Unarmoured  
Sheathed or unsheathed

<b>Table 3.9 Single Conductor Cu XLPE Cables – Single Phase Ratings (A)</b>									
<b>Conductor Size (mm<sup>2</sup>)</b>									
1	22	22	18	18	14	9	21	21	26
1.5	29	28	22	23	18	11	28	28	32
2.5	40	40	31	33	26	15	39	39	44
4	53	52	41	42	33	21	49	49	57
6	67	66	52	52	42	26	62	62	71
10	92	90	72	72	57	35	83	83	93
16	123	119	95	92	74	47	149	107	120
25	166	160	129	124	99	64	192	140	156
35	205	195	158	149	119	79	230	168	187
50	251	238	194	183	146	-	273	202	226
70	320	300	246	224	180	-	335	249	276
95	397	372	306	281	224	-	401	305	331
120	464	432	358	321	256	-	457	348	383
150	535	496	413	362	289	-	514	391	429
185	622	574	480	426	340	-	581	453	495
240	746	684	574	507	406	-	674	532	574
300	866	790	666	-	-	-	761	601	663
400	1015	920	779	-	-	-	865	699	755
500	1186	1063	903	-	-	-	977	791	856
630	1387	1224	1045	-	-	-	1098	916	995

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.











The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature	30°C	Soil Thermal Resistivity	1.2 K.m/W
Soil Temperature	15°C	Depth of Burial	0.5 m

# CURRENT RATINGS

Aluminium conductor  
 XLPE insulation (X-90)  
 Unarmoured  
 Sheathed or unsheathed

**Table 3.10 Single Conductor Al XLPE Cables – Single Phase Ratings (A)**

Conductor Size (mm <sup>2</sup> )										
16	96	92	74	72	57	36	114	83	93	
25	129	123	100	96	77	50	149	109	122	
35	158	151	122	116	92	62	179	131	146	
50	195	184	150	142	113	-	212	157	175	
70	249	233	191	175	140	-	260	194	214	
95	308	288	238	218	174	-	311	236	256	
120	361	336	278	249	199	-	355	270	297	
150	415	385	320	281	224	-	398	303	333	
185	483	447	374	331	265	-	453	352	384	
240	580	534	449	396	317	-	526	415	446	
300	673	618	520	-	-	-	595	471	516	
400	795	726	615	-	-	-	683	552	592	
500	935	849	722	-	-	-	780	631	676	
630	1103	994	849	-	-	-	891	744	792	
800										

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.











The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature                    30°C  
 Soil Temperature                                15°C  
 Soil Thermal Resistivity                    1.2 K.m/W  
 Depth of Burial                                 0.5 m

# CURRENT RATINGS

Flexible Copper conductor  
XLPE insulation (X-90)  
Unarmoured  
Sheathed or unsheathed

**Table 3.11 Single Conductor Flex Cu XLPE Cables**  
– Single Phase Ratings (A)

Conductor Size (mm <sup>2</sup> )										
1	23	23	18	19	14	9	21	22	26	
1.5	29	29	22	23	18	11	28	28	32	
2.5	39	37	30	31	26	15	39	37	44	
4	51	51	40	41	33	21	49	48	57	
6	65	64	51	51	42	26	62	60	71	
10	91	89	70	70	57	35	83	82	93	
16	121	117	94	90	74	47	149	105	120	
25	162	155	125	120	99	64	192	136	156	
35	201	191	155	145	119	79	230	165	187	
50	254	240	196	184	146	-	273	203	226	
70	321	301	248	224	180	-	335	248	276	
95	386	361	298	273	224	-	401	295	331	
120	460	428	354	315	256	-	457	341	383	
150	531	493	410	370	289	-	514	394	429	
185	611	563	471	415	340	-	581	441	495	
240	735	674	567	497	406	-	674	520	574	
300	849	776	653	-	-	-	761	586	663	
400	1026	927	787	-	-	-	865	696	755	
500	1199	1073	913	-	-	-	977	784	856	
630	1417	1249	1066	-	-	-	1098	920	995	











Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-  
Ambient Air Temperature 30°C      Soil Thermal Resistivity 1.2 K.m/W  
Soil Temperature 15°C      Depth of Burial 0.5 m

# CURRENT RATINGS

Flexible Copper conductor  
 X-HF-110 insulation  
 Unarmoured  
 Sheathed or unsheathed

**Table 3.12 Single Conductor Flex Cu X-HF-110 Cables**  
 – Single Phase Ratings (A)

Conductor Size (mm <sup>2</sup> )										
1	28	28	22	22	17	11	24	25	28	
1.5	34	34	28	27	21	14	31	32	35	
2.5	46	45	36	35	30	19	42	41	49	
4	61	60	48	48	40	25	56	54	63	
6	78	75	61	60	49	32	70	68	78	
10	109	105	86	82	66	43	93	91	103	
16	144	138	112	109	89	57	163	119	135	
25	190	182	149	142	117	77	210	152	173	
35	236	225	184	179	141	94	252	187	207	
50	299	281	233	221	175	-	299	228	250	
70	376	352	292	281	218	-	367	282	305	
95	452	423	352	334	275	-	441	331	373	
120	535	499	417	389	317	-	501	381	424	
150	617	574	482	456	368	-	563	439	475	
185	706	654	552	515	422	-	637	492	548	
240	850	783	664	624	509	-	740	581	636	
300	980	900	766	-	-	-	836	669	736	
400	1182	1076	920	-	-	-	952	778	837	
500	1380	1245	1069	-	-	-	1079	906	976	
630	1636	1454	1250	-	-	-	1217	1036	1108	

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-  
 Ambient Air Temperature 30°C      Soil Thermal Resistivity 1.2 K.m/W  
 Soil Temperature 15°C      Depth of Burial 0.5 m









# CURRENT RATINGS

Copper conductors

PVC insulation

Armoured or unarmoured -(including Neutral Screened cables)

**Table 3.13 Two Conductor Cu PVC Cables – Single Phase Ratings (A)**

Conductor Size (mm <sup>2</sup> )								
1	17	16	15	13	11	8	19	19
1.5	22	21	18	16	15	10	23	23
2.5	31	30	26	23	22	15	33	33
4	42	39	34	31	27	19	43	43
6	52	50	44	40	35	25	55	55
10	73	68	59	55	48	34	73	73
16	97	91	78	73	62	46	125	95
25	129	122	103	97	82	60	162	123
35	158	149	128	120	103	74	196	150
50	194	181	152	145	122	-	232	178
70	245	229	194	184	155	-	285	222
95	302	283	233	226	186	-	342	267
120	350	328	275	262	219	-	391	310
150	400	374	309	300	247	-	438	349
185	459	430	357	344	285	-	494	399
240	544	508	415	407	332	-	572	463
300	624	583	483	466	388	-	645	531
400	719	671	549	537	440	-	729	603

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# CURRENT RATINGS

Aluminium conductors

PVC insulation

Armoured or unarmoured - (including Neutral Screened cables)

<b>Table 3.14 Two Conductor Al PVC Cables – Single Phase Ratings (A)</b>								
<b>Conductor Size (mm<sup>2</sup>)</b>								
16	75	71	59	56	48	35	97	73
25	100	95	80	75	64	47	125	96
35	123	115	99	92	80	58	152	117
50	150	141	117	113	95	-	179	139
70	190	178	150	143	120	-	221	173
95	234	219	180	176	145	-	265	208
120	272	255	213	204	171	-	304	242
150	310	291	239	233	192	-	340	271
185	358	335	278	268	222	-	385	311
240	425	398	325	318	260	-	447	362
300	489	457	380	366	303	-	506	417
400	570	532	437	425	349	-	579	477

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

- Ambient Air Temperature                    30°C
- Soil Temperature                                15°C
- Soil Thermal Resistivity                    1.2 K.m/W
- Depth of Burial                                 0.5 m








# CURRENT RATINGS

Copper conductors

XLPE insulation (X-90)

Armoured or unarmoured - (including Neutral Screened cables)

**Table 3.15 Two Conductor Cu XLPE Cables – Single Phase Ratings (A)**

Conductor Size (mm <sup>2</sup> )							
1	20	19	18	15	10	20	20
1.5	26	24	22	20	12	26	26
2.5	37	34	31	28	18	36	36
4	50	46	41	36	23	48	48
6	63	58	51	46	30	60	60
10	86	80	69	64	40	80	80
16	114	107	90	86	54	141	105
25	154	144	121	116	73	182	137
35	190	178	145	142	89	219	165
50	232	217	178	174	-	261	198
70	295	275	220	220	-	321	244
95	364	340	275	272	-	385	299
120	424	395	314	316	-	439	340
150	485	452	365	361	-	492	391
185	560	520	415	417	-	556	442
240	664	618	493	494	-	645	519
300	763	710	575	568	-	728	597
400	884	820	656	656	-	825	677

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m



# CURRENT RATINGS

Flexible Copper conductor  
XLPE insulation (X-90)  
Unarmoured  
Sheathed or unsheathed

**Table 3.16 Two Conductor Flex Cu XLPE Cables**

**– Single Phase Ratings (A)**

Conductor Size (mm <sup>2</sup> )							
1	21	20	18	15	10	20	21
1.5	26	25	22	20	12	26	27
2.5	35	33	30	28	18	36	35
4	47	44	39	36	23	48	46
6	61	56	48	46	30	60	58
10	86	79	68	64	40	80	79
16	113	106	88	86	54	141	102
25	150	141	117	116	73	182	133
35	186	174	142	142	89	219	161
50	234	219	179	174	-	261	199
70	296	276	228	220	-	321	247
95	354	330	266	272	-	385	290
120	419	391	318	316	-	439	340
150	482	449	361	361	-	492	385
185	549	510	413	417	-	556	435
240	656	609	483	494	-	645	508
300	750	696	561	568	-	728	582
400	892	826	655	656	-	825	675

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-  
Ambient Air Temperature 30°C      Soil Thermal Resistivity 1.2 K.m/W  
Soil Temperature 15°C      Depth of Burial 0.5 m

# CURRENT RATINGS

Flexible Copper conductor  
X-HF-110 insulation  
Unarmoured  
Sheathed or unsheathed

**Table 3.17 Two Conductor Flex Cu X-HF-110 Cables**  
– Single Phase Ratings (A)

Conductor Size (mm <sup>2</sup> )							
1	26	25	21	16	12	23	24
1.5	32	30	26	20	15	30	31
2.5	43	41	34	29	20	41	39
4	57	54	46	39	28	54	52
6	72	67	58	48	35	68	66
10	101	94	80	64	48	90	89
16	133	124	107	87	63	154	116
25	174	165	138	114	85	199	147
35	216	203	174	142	104	240	181
50	272	255	216	171	-	284	222
70	340	320	275	219	-	350	275
95	408	382	324	268	-	420	322
120	482	450	387	315	-	479	378
150	551	516	441	356	-	537	427
185	627	585	507	416	-	6007	483
240	747	698	617	503	-	705	573
300	855	797	702	574	-	796	648
400	1015	946	857	658	-	904	771

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.











The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature	30°C	Soil Thermal Resistivity	1.2 K.m/W
Soil Temperature	15°C	Depth of Burial	0.5 m

# CURRENT RATINGS

Copper conductor  
 PVC insulation  
 Unarmoured  
 Sheathed or unsheathed

**Table 3.18 Single Conductor Cu PVC Cables – Three Phase Ratings (A)**

Conductor Size (mm <sup>2</sup> )										
1	18	16	15	14	11	7	18	18	21	
1.5	23	19	18	17	14	9	22	22	26	
2.5	33	29	26	24	19	14	30	30	36	
4	43	38	35	32	26	18	40	40	47	
6	56	48	46	40	32	23	50	50	58	
10	76	66	62	54	42	31	65	65	77	
16	101	88	82	71	57	41	114	86	99	
25	137	117	111	92	73	55	147	110	129	
35	169	145	136	114	91	67	176	134	154	
50	206	178	166	136	108	-	209	158	185	
70	262	225	210	173	139	-	256	198	226	
95	327	280	262	209	168	-	307	239	275	
120	382	327	304	247	197	-	349	277	311	
150	439	376	351	278	222	-	392	311	349	
185	510	437	407	324	259	-	442	358	402	
240	610	521	486	377	302	-	512	415	464	
300	707	603	561	442	355	-	576	477	537	
400	828	701	653	504	402	-	652	541	608	
500	964	809	754	596	477	-	735	628	705	
630	1129	931	866	670	537	-	823	703	795	

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-  
 Ambient Air Temperature 30°C      Soil Thermal Resistivity 1.2 K.m/W  
 Soil Temperature 15°C      Depth of Burial 0.5 m










# CURRENT RATINGS

Aluminium conductor

PVC insulation

Unarmoured

Sheathed or unsheathed

<b>Table 3.19 Single Conductor Al PVC Cables – Three Phase Ratings (A)</b>									
<b>Conductor Size (mm<sup>2</sup>)</b>									
<b>16</b>	79	67	64	55	44	32	89	66	77
<b>25</b>	106	91	86	72	57	43	114	86	100
<b>35</b>	131	112	105	89	71	52	136	103	119
<b>50</b>	161	138	129	105	84	-	162	123	144
<b>70</b>	204	174	163	135	107	-	199	154	175
<b>95</b>	253	218	203	162	130	-	238	185	213
<b>120</b>	296	254	237	193	154	-	272	216	242
<b>150</b>	340	292	272	217	173	-	304	242	271
<b>185</b>	396	341	317	253	202	-	344	278	312
<b>240</b>	475	408	381	307	236	-	400	325	362
<b>300</b>	551	473	441	348	278	-	453	375	418
<b>400</b>	650	556	519	400	320	-	518	430	477
<b>500</b>	763	651	606	480	384	-	591	505	558
<b>630</b>	899	762	709	548	439	-	673	575	636

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.











The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# CURRENT RATINGS

Copper conductor  
 XLPE insulation  
 Unarmoured  
 Sheathed or unsheathed

**Table 3.20 Single Conductor Cu XLPE Cables – Three Phase Ratings (A)**

Conductor Size (mm <sup>2</sup> )										
1	21	18	18	17	13	9	19	19	24	
1.5	28	23	22	20	17	11	24	24	29	
2.5	39	33	31	28	22	15	33	33	41	
4	51	44	41	36	29	21	43	43	52	
6	65	55	52	46	37	26	54	54	64	
10	89	76	72	62	50	35	72	72	85	
16	119	101	95	79	64	47	125	92	108	
25	161	138	129	107	85	64	162	121	141	
35	198	169	158	132	106	79	193	147	169	
50	243	207	194	157	125	-	229	174	203	
70	310	264	246	201	161	-	280	217	248	
95	385	328	306	242	194	-	335	261	295	
120	451	384	358	287	230	-	381	304	342	
150	519	443	413	325	260	-	428	342	383	
185	616	515	479	369	295	-	484	388	442	
240	726	616	573	439	352	-	560	456	510	
300	843	713	662	516	413	-	630	525	591	
400	989	832	772	587	470	-	715	596	670	
500	1156	961	893	696	557	-	805	693	756	
630	1353	1111	1032	785	628	-	902	778	877	

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-  
 Ambient Air Temperature 30°C      Soil Thermal Resistivity 1.2 K.m/W  
 Soil Temperature 15°C      Depth of Burial 0.5 m

# CURRENT RATINGS











Aluminium conductor

XLPE insulation

Unarmoured

Sheathed or unsheathed

**Table 3.21 Single Conductor Al XLPE Cables –Three Phase Ratings (A)**

Conductor Size (mm <sup>2</sup> )										
16	92	78	74	62	50	36	97	71	85	
25	124	107	100	83	66	50	125	93	110	
35	154	131	122	102	83	62	150	113	131	
50	188	161	150	122	98	-	178	135	157	
70	241	205	191	156	125	-	217	169	193	
95	298	255	238	188	151	-	260	203	229	
120	350	298	278	223	178	-	296	236	265	
150	403	344	320	252	201	-	332	266	296	
185	470	402	373	287	230	-	377	303	343	
240	564	482	448	343	275	-	438	356	397	
300	656	559	519	405	323	-	495	412	460	
400	776	659	613	466	373	-	567	473	525	
500	912	773	717	560	448	-	646	556	598	
630	1076	906	842	641	513	-	736	635	700	










Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# CURRENT RATINGS

Flexible Copper conductor  
 XLPE insulation (X-90)  
 Unarmoured  
 Sheathed or unsheathed

<b>Table 3.22 Single Conductor Flex Cu XLPE Cables</b>									
<b>- Three Phase Ratings (A)</b>									
Conductor Size (mm <sup>2</sup> )									
1	22	19	18	17	13	9	19	20	24
1.5	28	24	22	21	17	11	24	25	29
2.5	36	32	30	26	22	15	33	32	41
4	50	42	40	34	29	21	43	41	52
6	63	54	51	45	37	26	54	52	64
10	88	76	70	61	50	35	72	71	85
16	117	100	94	80	64	47	125	91	108
25	156	133	125	103	85	64	162	117	141
35	195	166	155	130	106	79	193	143	169
50	245	210	196	158	125	-	229	174	203
70	311	265	248	201	161	-	280	217	248
95	375	319	298	235	194	-	335	254	295
120	447	381	354	282	230	-	381	299	342
150	517	440	409	320	260	-	428	338	383
185	594	505	470	367	295	-	484	382	442
240	716	608	565	430	352	-	560	445	510
300	827	701	650	504	413	-	630	513	591
400	1000	840	780	586	470	-	715	593	670
500	1168	972	903	693	557	-	805	687	756
630	1382	1133	1052	791	628	-	902	780	877

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.











The values in this table are for typical New Zealand installation conditions of:-  
 Ambient Air Temperature 30°C      Soil Thermal Resistivity 1.2 K.m/W  
 Soil Temperature 15°C      Depth of Burial 0.5 m

# CURRENT RATINGS

Flexible Copper conductor  
X-HF-110 insulation  
Unarmoured  
Sheathed or unsheathed

**Table 3.23 Single Conductor Flex CU X-HF-110 Cables**

**-Three Phase Ratings (A)**

Conductor Size (mm <sup>2</sup> )										
1	27	24	22	22	15	11	21	22	25	
1.5	33	29	28	28	19	14	27	28	32	
2.5	45	39	36	36	27	19	38	36	45	
4	59	51	48	47	35	25	49	47	57	
6	75	65	61	58	44	32	60	58	71	
10	106	91	86	81	61	43	82	81	93	
16	139	120	112	103	79	57	138	103	122	
25	185	159	149	133	107	77	178	133	157	
35	229	197	184	160	129	94	213	160	187	
50	289	249	232	199	156	-	251	199	225	
70	364	312	292	243	200	-	308	243	275	
95	439	378	352	284	244	-	369	284	334	
120	521	447	417	335	288	-	420	335	378	
150	601	516	482	378	327	-	472	378	424	
185	689	592	552	428	384	-	533	428	489	
240	829	712	663	510	470	-	618	510	565	
300	958	820	764	575	536	-	696	575	654	
400	1155	982	915	687	615	-	791	687	742	
500	1348	1138	1059	773	740	-	894	773	864	
630	1598	1327	1235	878	842	-	1004	878	975	

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature	30°C	Soil Thermal Resistivity	1.2 K.m/W
Soil Temperature	15°C	Depth of Burial	0.5 m



# CURRENT RATINGS

Copper conductors

PVC insulation

Armoured or unarmoured - (including Neutral Screened cables)

**Table 3.24 Three & Four Conductor Cu PVC Cables**

**- Three Phase Ratings (A)**

Conductor Size (mm <sup>2</sup> )								
1	15	14	13	10	10	7	15	15
1.5	18	17	16	14	13	9	20	20
2.5	26	25	23	19	18	13	28	28
4	35	33	29	26	23	17	36	36
6	46	42	38	34	30	22	46	46
10	62	58	50	47	40	29	61	61
16	82	78	66	62	54	39	106	80
25	111	104	87	83	68	52	138	103
35	137	128	107	103	86	64	165	125
50	166	156	128	124	101	-	196	150
70	211	196	162	157	130	-	241	187
95	260	243	202	194	162	-	289	229
120	302	282	230	226	185	-	330	261
150	345	321	260	258	207	-	370	293
185	397	369	300	295	241	-	417	334
240	470	437	360	350	288	-	482	395
300	538	499	-	-	-	-	542	444
400	620	575	-	-	-	-	613	515

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

- Ambient Air Temperature                    30°C
- Soil Temperature                                15°C
- Soil Thermal Resistivity                    1.2 K.m/W
- Depth of Burial                                 0.5 m

# CURRENT RATINGS









Aluminium conductors

PVC insulation

Armoured or unarmoured - (including Neutral Screened cables)

**Table 3.25 Three & Four Conductor Al PVC Cables**

**– Three Phase Ratings (A)**

Conductor Size (mm <sup>2</sup> )								
16	64	60	51	48	41	30	83	62
25	86	81	67	65	54	40	107	80
35	106	99	83	79	66	49	129	98
50	129	121	99	97	79	-	152	116
70	163	153	127	122	100	-	187	145
95	202	188	156	150	125	-	224	177
120	235	219	179	176	144	-	256	202
150	268	250	202	200	162	-	287	228
185	310	288	235	231	188	-	326	261
240	368	343	283	274	226	-	378	309
300	424	393	-	-	-	-	427	350
400	495	458	-	-	-	-	488	411

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-








Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# CURRENT RATINGS

Copper conductors

XLPE insulation

Armoured or unarmoured - (including Neutral Screened cables)

<b>Table 3.26 Three &amp; Four Conductor Cu XLPE Cables</b>							
<b>- Three Phase Ratings (A)</b>							
<b>Conductor Size (mm<sup>2</sup>)</b>							
1	18	15	14	13	8	17	17
1.5	22	21	18	17	10	21	21
2.5	31	29	26	23	14	31	31
4	42	39	33	31	20	40	40
6	53	50	42	40	24	49	49
10	73	68	58	54	34	67	67
16	97	91	75	73	45	118	87
25	131	122	100	98	62	153	114
35	162	151	125	121	76	184	139
50	198	185	150	147	-	218	166
70	252	234	190	187	-	269	207
95	311	289	230	231	-	323	249
120	363	337	271	270	-	368	289
150	415	385	305	308	-	412	325
185	480	444	354	355	-	465	372
240	569	527	425	421	-	539	440
300	653	604	-	-	-	607	495
400	754	695	-	-	-	685	561

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-








Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

## CURRENT RATINGS

Aluminium conductors

XLPE insulation

Armoured or unarmoured - (including Neutral Screened cables)

<b>Table 3.27 Three &amp; Four Conductor Al XLPE Cables</b>							
<b>- Three Phase Ratings (A)</b>							
<b>Conductor Size (mm<sup>2</sup>)</b>							
16	75	70	58	56	35	91	67
25	102	95	78	76	47	119	89
35	125	117	97	94	58	142	108
50	154	143	116	114	-	170	128
70	196	182	147	145	-	209	161
95	242	224	178	179	-	250	194
120	282	262	211	209	-	286	225
150	322	299	238	240	-	320	253
185	374	347	276	277	-	364	291
240	446	413	333	330	-	423	345
300	514	475	-	-	-	477	391
400	601	554	-	-	-	546	446

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m








# CURRENT RATINGS

Flexible Copper conductors

XLPE insulation (X-90)

Armoured or unarmoured

**Table 3.28 Three & Four Conductor Flex Cu XLPE Cables**
**– Three Phase Ratings (A)**

Conductor Size (mm <sup>2</sup> )							
1	18	17	15	13	8	17	18
1.5	22	21	19	17	10	21	22
2.5	30	29	25	23	14	31	30
4	40	37	32	31	20	40	39
6	51	47	41	40	24	49	48
10	73	67	57	54	34	67	66
16	96	89	74	73	45	118	85
25	128	119	98	98	62	153	110
35	158	149	122	121	76	184	136
50	200	187	150	147	-	218	166
70	253	235	190	187	-	269	207
95	303	282	222	231	-	323	242
120	360	333	266	270	-	368	285
150	413	383	301	308	-	412	321
185	471	436	345	355	-	465	363
240	562	519	417	421	-	539	430
300	642	593	-	-	-	607	484
400	761	702	-	-	-	685	575

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# CURRENT RATINGS








Flexible Copper conductors

X-HF-110 insulation

Armoured or unarmoured

**Table 3.29 Three & Four Conductor Flex Cu X-HF-110 Cables**

**– Three Phase Ratings (A)**

Conductor Size (mm <sup>2</sup> )							
1	22	20	18	14	10	20	21
1.5	28	26	22	17	13	25	25
2.5	36	34	29	25	18	35	33
4	48	45	39	32	24	46	43
6	61	58	49	41	30	56	54
10	86	80	70	55	41	75	75
16	113	106	90	73	54	129	96
25	150	140	120	100	72	167	125
35	185	173	147	120	89	201	152
50	233	218	187	149	-	240	189
70	292	273	232	185	-	294	230
95	350	327	281	231	-	353	275
120	414	385	327	266	-	402	316
150	475	442	381	308	-	452	361
185	540	503	430	352	-	510	404
240	644	598	523	426	-	591	480
300	736	683	-	-	-	667	540
400	874	809	-	-	-	756	642

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

The values in this table are for typical New Zealand installation conditions of:-

Ambient Air Temperature	30°C
Soil Temperature	15°C
Soil Thermal Resistivity	1.2 K.m/W
Depth of Burial	0.5 m

# VOLTAGE DROPS

**Table 3.30 Single Conductor Cables - Voltage Drops (mV/A.m)**

Conductor Size (mm <sup>2</sup> )	Conductor Temperature								
	Single Phase Touching			Three Phase Trefoil			Three Phase Flat Touching		
	75°C	90°C	110°C	75°C	90°C	110°C	75°C	90°C	110°C
<b>Copper Conductors</b>									
1	51.6	54.1	57.4	44.7	46.8	49.7	44.7	46.8	49.7
1.5	33.0	34.7	36.9	28.6	30.0	31.9	28.6	30.0	31.9
2.5	18.0	18.9	20.1	15.6	16.4	17.4	15.6	16.4	17.4
4	11.2	11.8	12.5	9.71	10.2	10.8	9.71	10.2	10.8
6	7.50	7.87	8.35	6.49	6.81	7.23	6.49	6.81	7.23
10	4.46	4.68	6.67	3.86	4.05	4.30	3.86	4.05	4.30
16	2.81	2.95	3.12	2.43	2.55	2.70	2.43	2.55	2.71
25	1.78	1.87	1.99	1.54	1.62	1.72	1.55	1.62	1.72
35	1.29	1.35	1.43	1.12	1.17	1.24	1.12	1.18	1.25
50	0.963	1.01	1.07	0.834	0.872	0.924	0.840	0.878	0.929
70	0.680	0.710	0.751	0.589	0.615	0.650	0.597	0.623	0.657
95	0.507	0.528	0.556	0.439	0.457	0.481	0.449	0.467	0.491
120	0.415	0.431	0.453	0.359	0.373	0.392	0.371	0.385	0.403
150	0.352	0.365	0.382	0.305	0.316	0.331	0.319	0.330	0.344
185	0.302	0.311	0.323	0.261	0.269	0.280	0.277	0.285	0.296
240	0.255	0.262	0.271	0.221	0.227	0.235	0.240	0.245	0.252
300	0.229	0.233	0.238	0.198	0.202	0.208	0.219	0.222	0.227
400	0.209	0.211	0.216	0.181	0.183	0.187	0.202	0.205	0.208
500	0.194	0.196	0.199	0.168	0.170	0.172	0.191	0.193	0.195
630	0.181	0.184	0.185	0.157	0.159	0.160	0.181	0.182	0.184
<b>Aluminium Conductors</b>									
16	4.68	4.91	-	4.05	4.25	-	4.05	4.25	-
25	2.95	3.08	-	2.55	2.67	-	2.55	2.67	-
35	2.14	2.24	-	1.85	1.94	-	1.85	1.94	-
50	1.58	1.65	-	1.37	1.43	-	1.37	1.44	-
70	1.10	1.15	-	0.952	0.997	-	0.956	1.00	-
95	0.804	0.840	-	0.696	0.727	-	0.702	0.733	-
120	0.644	0.672	-	0.558	0.582	-	0.565	0.589	-
150	0.535	0.557	-	0.463	0.482	-	0.472	0.491	-
185	0.439	0.455	-	0.380	0.394	-	0.391	0.404	-
240	0.352	0.363	-	0.305	0.314	-	0.319	0.327	-
300	0.300	0.307	-	0.260	0.266	-	0.276	0.281	-
400	0.256	0.261	-	0.222	0.226	-	0.240	0.243	-
500	0.226	0.228	-	0.196	0.197	-	0.216	0.216	-
630	0.202	0.204	-	0.175	0.177	-	0.197	0.198	-
800									

Notes: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

PVC (V-75, V90) maximum temperature is 75°C and XLPE (X-90) maximum temperature is 90°C, X-HF-110 maximum temperature is 110°C.

# VOLTAGE DROPS

<b>Table 3.31 Multi Conductor Cables - Voltage Drops (mV/A.m)</b>						
Conductor Size (mm <sup>2</sup> )	Conductor Temperature					
	Single Phase			Three Phase		
	75°C	90°C	110°C	75°C	90°C	110°C
<b>Copper Conductors</b>						
1	51.6	54.1	57.4	44.7	46.8	49.7
1.5	33.0	34.7	36.8	28.6	30.0	31.9
2.5	18.0	18.9	20.1	15.6	16.4	17.4
4	11.2	11.8	12.5	9.71	10.2	10.8
6	7.50	7.85	8.34	6.49	6.80	7.22
10	4.46	4.68	4.95	3.86	4.05	4.29
16	2.81	2.95	3.12	2.43	2.55	2.70
25	1.78	1.86	1.98	1.54	1.61	1.71
35	1.28	1.35	1.43	1.11	1.17	1.24
50	0.958	1.00	1.063	0.829	0.868	0.920
70	0.673	0.703	0.745	0.583	0.609	0.645
95	0.498	0.520	0.549	0.431	0.450	0.475
120	0.405	0.423	0.445	0.351	0.366	0.385
150	0.342	0.355	0.372	0.296	0.307	0.322
185	0.290	0.299	0.313	0.251	0.259	0.271
240	0.243	0.249	0.259	0.210	0.216	0.224
300	0.215	0.219	0.227	0.186	0.190	0.196
400	0.194	0.198	0.202	0.168	0.171	0.175
<b>Aluminium Conductors</b>						
16	4.67	4.90	-	4.04	4.24	-
25	2.93	3.08	-	2.54	2.67	-
35	2.13	2.23	-	1.84	1.93	-
50	1.57	1.65	-	1.36	1.43	-
70	1.09	1.15	-	0.948	0.993	-
95	0.798	0.835	-	0.691	0.723	-
120	0.638	0.666	-	0.552	0.577	-
150	0.528	0.550	-	0.457	0.476	-
185	0.431	0.448	-	0.373	0.388	-
240	0.343	0.355	-	0.297	0.307	-
300	0.290	0.298	-	0.251	0.258	-
400	0.245	0.249	-	0.212	0.216	-

Notes: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

PVC (V-75, V90) maximum temperature is 75°C, XLPE (X-90) maximum temperature is 90°C, X-HF-110 maximum temperature is 110°C



# AC RESISTANCES

<b>Table 3.32 Single Conductor Cables - AC Resistances (mΩ/m)</b>					
Conductor Size (mm <sup>2</sup> )	Conductor Temperature				
	45°C	60°C	75°C	90°C	110°C
<b>Copper Conductors</b>					
1	23.3	24.5	25.8	27.0	28.7
1.5	14.9	15.7	16.5	17.3	18.4
2.5	8.14	8.57	9.01	9.45	10.0
4	5.06	5.33	5.61	5.88	6.24
6	3.38	3.56	3.75	3.93	4.17
10	2.01	2.12	2.23	2.33	2.48
16	1.26	1.33	1.40	1.47	1.56
25	0.799	0.842	0.884	0.927	0.984
35	0.576	0.607	0.638	0.668	0.710
50	0.426	0.448	0.471	0.494	0.524
70	0.295	0.311	0.327	0.342	0.363
95	0.213	0.225	0.236	0.247	0.262
120	0.170	0.179	0.188	0.197	0.208
150	0.138	0.145	0.153	0.160	0.169
185	0.111	0.117	0.123	0.129	0.136
240	0.0862	0.0905	0.0948	0.0991	0.105
300	0.0703	0.0736	0.0770	0.0803	0.0846
400	0.0569	0.0595	0.0620	0.0646	0.0677
500	0.0467	0.0487	0.0506	0.0525	0.0547
630	0.0389	0.0404	0.0418	0.0432	0.0448
<b>Flexible Copper Conductors</b>					
1	21.4	22.6	23.7	24.9	26.4
1.5	14.6	15.4	16.2	17.0	18.0
2.5	8.76	9.23	9.70	10.2	10.8
4	5.44	5.73	6.02	6.31	6.70
6	3.62	3.82	4.01	4.21	4.47
10	2.10	2.21	2.32	2.44	2.59
16	1.33	1.40	1.47	1.54	1.64
25	0.857	0.903	0.949	0.995	1.06
35	0.609	0.641	0.674	0.707	0.750
50	0.424	0.447	0.470	0.493	0.523
70	0.300	0.316	0.332	0.348	0.369
95	0.227	0.240	0.252	0.264	0.280
120	0.178	0.188	0.197	0.207	0.219
150	0.144	0.151	0.159	0.166	0.176
185	0.119	0.125	0.131	0.137	0.145
240	0.0912	0.0958	0.100	0.105	0.111
300	0.0745	0.0780	0.0817	0.0853	0.0898
400	0.0587	0.0613	0.0640	0.0666	0.0699
500	0.0487	0.0507	0.0527	0.0548	0.0571
630	0.0395	0.0409	0.0424	0.0438	0.0455

## AC RESISTANCES

<b>Table 3.33 Single Conductor Cables - AC Resistances (mΩ/m)</b>					
Conductor Size (mm <sup>2</sup> )	Conductor Temperature				
	45°C	60°C	75°C	90°C	110°C
<b>Aluminium Conductors</b>					
16	2.10	2.22	2.33	2.45	-
25	1.32	1.39	1.47	1.54	-
35	0.956	1.01	1.06	1.11	-
50	0.706	0.745	0.783	0.822	-
70	0.488	0.515	0.542	0.568	-
95	0.353	0.372	0.392	0.411	-
120	0.279	0.295	0.310	0.325	-
150	0.228	0.240	0.253	0.265	-
185	0.182	0.192	0.202	0.212	-
240	0.140	0.147	0.155	0.162	-
300	0.113	0.119	0.125	0.130	-
400	0.0890	0.0936	0.0981	0.103	-
500	0.0709	0.0744	0.0779	0.0813	-
630	0.0571	0.0597	0.0623	0.0649	-

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

# AC RESISTANCES

**Table 3.34 Multi Conductor Cables - AC Resistances (mΩ/m)**

Conduct or Size (mm <sup>2</sup> )	Conductor Temperature									
	Circular Conductors					Shaped Conductors				
	45°C	60°C	75°C	90°C	110°C	45°C	60°C	75°C	90°C	110°C
<b>Copper Conductors</b>										
1	23.3	24.5	25.8	27.0	28.7	-	-	-	-	-
1.5	14.9	15.7	16.5	17.3	18.4	-	-	-	-	-
2.5	8.14	8.57	9.01	9.45	10.0	-	-	-	-	-
4	5.06	5.33	5.61	5.88	6.24	-	-	-	-	-
6	3.38	3.56	3.75	3.93	4.17	-	-	-	-	-
10	2.01	2.12	2.23	2.33	2.48	-	-	-	-	-
16	1.26	1.33	1.40	1.47	1.56	-	-	-	-	-
25	0.799	0.842	0.884	0.927	0.984	0.799	0.842	0.884	0.927	-
35	0.576	0.607	0.638	0.669	0.710	0.576	0.607	0.638	0.669	-
50	0.426	0.449	0.471	0.494	0.524	0.426	0.448	0.471	0.494	-
70	0.295	0.311	0.327	0.343	0.364	0.295	0.311	0.327	0.342	-
95	0.214	0.225	0.236	0.248	0.262	0.213	0.224	0.236	0.247	-
120	0.170	0.179	0.188	0.197	0.209	0.170	0.179	0.187	0.196	-
150	0.139	0.146	0.153	0.160	0.170	0.138	0.145	0.153	0.160	-
185	0.112	0.118	0.123	0.129	0.136	0.111	0.117	0.123	0.128	-
240	0.0870	0.0912	0.0955	0.0998	0.105	0.0859	0.0902	0.0945	0.0988	-
300	0.0712	0.0745	0.0778	0.0812	0.0852	0.0698	0.0732	0.0766	0.0800	-
400	0.0580	0.0605	0.0630	0.0656	0.0685	0.0563	0.0589	0.0615	0.0641	-
<b>Flexible Copper Conductors</b>										
1	21.4	22.6	23.7	24.9	26.4	-	-	-	-	-
1.5	14.6	15.4	16.2	17.0	18.0	-	-	-	-	-
2.5	8.76	9.23	9.70	10.2	10.8	-	-	-	-	-
4	5.44	5.73	6.02	6.31	6.70	-	-	-	-	-
6	3.62	3.82	4.01	4.21	4.47	-	-	-	-	-
10	2.10	2.21	2.32	2.44	2.59	-	-	-	-	-
16	1.33	1.40	1.47	1.54	1.64	-	-	-	-	-
25	0.857	0.903	0.949	0.995	1.06	-	-	-	-	-
35	0.609	0.642	0.674	0.707	0.750	-	-	-	-	-
50	0.424	0.447	0.470	0.493	0.523	-	-	-	-	-
70	0.300	0.316	0.332	0.348	0.369	-	-	-	-	-
95	0.228	0.240	0.252	0.264	0.280	-	-	-	-	-
120	0.179	0.188	0.198	0.207	0.219	-	-	-	-	-
150	0.144	0.152	0.159	0.167	0.176	-	-	-	-	-
185	0.119	0.126	0.132	0.138	0.146	-	-	-	-	-
240	0.0920	0.0965	0.101	0.106	0.111	-	-	-	-	-
300	0.0753	0.0789	0.0825	0.0860	0.0905	-	-	-	-	-
400	0.0597	0.0623	0.0649	0.0675	0.0706	-	-	-	-	-

# AC RESISTANCES

<b>Table 3.35 Multi Conductor Cables - AC Resistances (mΩ/m)</b>										
Conduct or Size  (mm <sup>2</sup> )	Conductor Temperature									
	Circular Conductors					Shaped Conductors				
	45°C	60°C	75°C	90°C	110°C	45°C	60°C	75°C	90°C	110°C
<b>Aluminium Conductors</b>										
<b>16</b>	2.10	2.22	2.33	2.45	-	2.10	2.22	2.33	2.45	-
<b>25</b>	1.32	1.39	1.47	1.54	-	1.32	1.39	1.47	1.54	-
<b>35</b>	0.956	1.01	1.06	1.11	-	0.956	1.01	1.06	1.11	-
<b>50</b>	0.706	0.745	0.784	0.822	-	0.706	0.745	0.783	0.822	-
<b>70</b>	0.488	0.515	0.542	0.569	-	0.488	0.515	0.542	0.568	-
<b>95</b>	0.353	0.373	0.392	0.411	-	0.353	0.372	0.392	0.411	-
<b>120</b>	0.280	0.295	0.310	0.325	-	0.279	0.295	0.310	0.325	-
<b>150</b>	0.228	0.241	0.253	0.265	-	0.228	0.240	0.253	0.265	-
<b>185</b>	0.182	0.192	0.202	0.212	-	0.182	0.192	0.202	0.211	-
<b>240</b>	0.140	0.148	0.155	0.162	-	0.139	0.147	0.154	0.162	-
<b>300</b>	0.113	0.119	0.125	0.131	-	0.112	0.118	0.124	0.130	-
<b>400</b>	0.0897	0.0943	0.0988	0.103	-	0.0886	0.0932	0.0978	0.102	-

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

# REACTANCES

**Table 3.36 Reactance at 50 Hz of Single Core Cables (mΩ/m)**

Conductor Size (mm <sup>2</sup> )	Insulation Material			
	Single Phase, or Three Phase Trefoil		Three Phase Flat Touching	
	PVC	XLPE	PVC	XLPE
1	0.168	0.166	0.184	0.181
1.5	0.157	0.155	0.172	0.170
2.5	0.143	0.141	0.159	0.156
4	0.137	0.131	0.152	0.146
6	0.128	0.123	0.143	0.138
10	0.118	0.114	0.134	0.129
16	0.111	0.106	0.126	0.122
25	0.106	0.102	0.121	0.118
35	0.101	0.0982	0.117	0.113
50	0.0962	0.0924	0.111	0.108
70	0.0917	0.0893	0.107	0.104
95	0.0904	0.0868	0.106	0.102
120	0.0870	0.0844	0.102	0.0996
150	0.0868	0.0844	0.102	0.0996
185	0.0862	0.0835	0.101	0.0988
240	0.0847	0.0818	0.0999	0.0970
300	0.0839	0.0809	0.0991	0.0961
400	0.0829	0.0802	0.0982	0.0955
500	0.0820	0.0796	0.0973	0.0948
630	0.0800	0.0787	0.0952	0.0940
800				

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

## REACTANCES (FLEXIBLE)

<b>Table 3.37 Reactance at 50 Hz of Single Core Cables (mΩ/m)</b>				
Conductor Size  (mm <sup>2</sup> )	Insulation Material (Flexible Cord & Flexible Cable)			
	Single Phase, or Three Phase Trefoil		Three Phase Flat Touching	
	PVC	XLPE	PVC	XLPE
1	0.161	0.158	0.176	0.173
1.5	0.150	0.148	0.165	0.163
2.5	0.139	0.137	0.155	0.153
4	0.132	0.126	0.147	0.141
6	0.124	0.119	0.139	0.134
10	0.112	0.107	0.127	0.123
16	0.105	0.101	0.120	0.116
25	0.101	0.0973	0.116	0.113
35	0.0961	0.0930	0.111	0.108
50	0.0938	0.0901	0.109	0.105
70	0.0894	0.0869	0.105	0.102
95	0.0885	0.0849	0.104	0.100
120	0.0854	0.0828	0.101	0.0980
150	0.0853	0.0830	0.101	0.0982
185	0.0847	0.0821	0.0999	0.0973
240	0.0835	0.0808	0.0988	0.0960
300	0.0830	0.0800	0.0982	0.0953
400	0.0814	0.0788	0.0966	0.0941
500	0.0803	0.0780	0.0955	0.0932
630	0.0789	0.0777	0.0941	0.0929
800	-	-	-	-

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

# REACTANCES

<b>Table 3.38 Reactance at 50 Hz of Multicore Cables (mΩ/m)</b>				
Conductor Size  (mm <sup>2</sup> )	Insulation Material			
	Circular Conductors		Shaped Conductors	
	PVC	XLPE	PVC	XLPE
1	0.119	0.114	-	-
1.5	0.111	0.107	-	-
2.5	0.102	0.0988	-	-
4	0.102	0.0930	-	-
6	0.0967	0.0887	-	-
10	0.0906	0.0840	-	-
16	0.0861	0.0805	-	-
25	0.0853	0.0808	0.0786	0.0744
35	0.0826	0.0786	0.0761	0.0725
50	0.0797	0.0751	0.0734	0.0692
70	0.0770	0.0741	0.0710	0.0683
95	0.0766	0.0725	0.0706	0.0668
120	0.0743	0.0713	0.0685	0.0657
150	0.0745	0.0718	0.0687	0.0662
185	0.0744	0.0720	0.0686	0.0663
240	0.0735	0.0709	0.0678	0.0653
300	0.0732	0.0704	0.0675	0.0649
400	0.0728	0.0702	0.0671	0.0647

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.

## REACTANCES (FLEXIBLE)

<b>Table 3.39 Reactance at 50 Hz of Multicore Cables (mΩ/m)</b>				
Conductor Size  (mm <sup>2</sup> )	Insulation Material (Flexible Cord & Flexible Cable)			
	Circular Conductors		Shaped Conductors	
	PVC	XLPE	PVC	XLPE
1	0.116	0.111	-	-
1.5	0.109	0.105	-	-
2.5	0.101	0.0977	-	-
4	0.100	0.0911	-	-
6	0.0954	0.0871	-	-
10	0.0876	0.0810	-	-
16	0.0835	0.0779	-	-
25	0.0829	0.0783	-	-
35	0.0801	0.0761	-	-
50	0.0799	0.0754	-	-
70	0.0773	0.0744	-	-
95	0.0771	0.0729	-	-
120	0.0753	0.0723	-	-
150	0.0755	0.0728	-	-
185	0.0754	0.0730	-	-
240	0.0749	0.0722	-	-
300	0.0747	0.0718	-	-
400	0.0738	0.0714	-	-

Note: Content from AS/NZS 3008.1.2:2017 has been reproduced with the permission from Standards New Zealand under Copyright Licence 000926. Please see the Standard for full details.



# VOLTAGE DROP GRAPHS

This information seeks to provide a quick means of selecting the size of cable to comply with voltage drop requirements. The range of graphs is intended to cover normal stock cables available from Nexans.

## Basis of Graphs

© Copyright Standards New Zealand 2012. Content in the graphs and current rating values are derived from AS/NZS 3008.1.2:2017 and has been reproduced or adapted with permission from Standards New Zealand under Copyright Licence 000926. Please refer to the complete Standard for full details available for purchase from Standards New Zealand at [www.standards.co.nz](http://www.standards.co.nz).

New Zealand regulations allow a maximum voltage drop of 5% from the point of supply to anywhere in the installation.

The graphs have been drawn for a voltage drop of 2.5% with the standard New Zealand supply voltages. i.e. 5.75 volts for single phase 230 volt systems, or 10 volts for three phase 400 volt systems.

For installations involving mains, sub-mains and circuits, larger cable sizes may be necessary than these graphs show, to keep the voltage drop in the complete installation under the maximum allowed by the regulations.

The graphs are drawn to allow for the highest current with the cable installed under any of the standard installation conditions as per this section or the Nexans New Zealand Handbook

It is important to check that the cable will carry the required maximum load under the particular conditions of the actual installation proposed.

In cases where the load current is significantly less than the maximum for the cable, the temperature of the conductor will be less than the maximum allowed. Hence the actual voltage drop will be lower than that shown by the graphs.

## Use of the Graphs

Assuming that the load current and length of run are known.

Select the graph appropriate for the cable under consideration, whether single phase or three phase, and for single core cables whether laid in trefoil or flat configuration.

Locate the intersecting point on the graph for the required values of load current and length of run.

For this point read the conductor size indicated for the graph line either on or above the point.

Check that the required load current is within the maximum for the cable size under the intended installation conditions, using either this section, the Nexans New Zealand Handbook or AS/NZS 3008.1.2.

## Disclaimer

Nexans New Zealand Limited has taken every precaution to ensure that the information contained in these graphs is in line with the requirements of the appropriate New Zealand Standards and correct electrical practice. However, we accept no liability of any kind with respect to the information presented here.

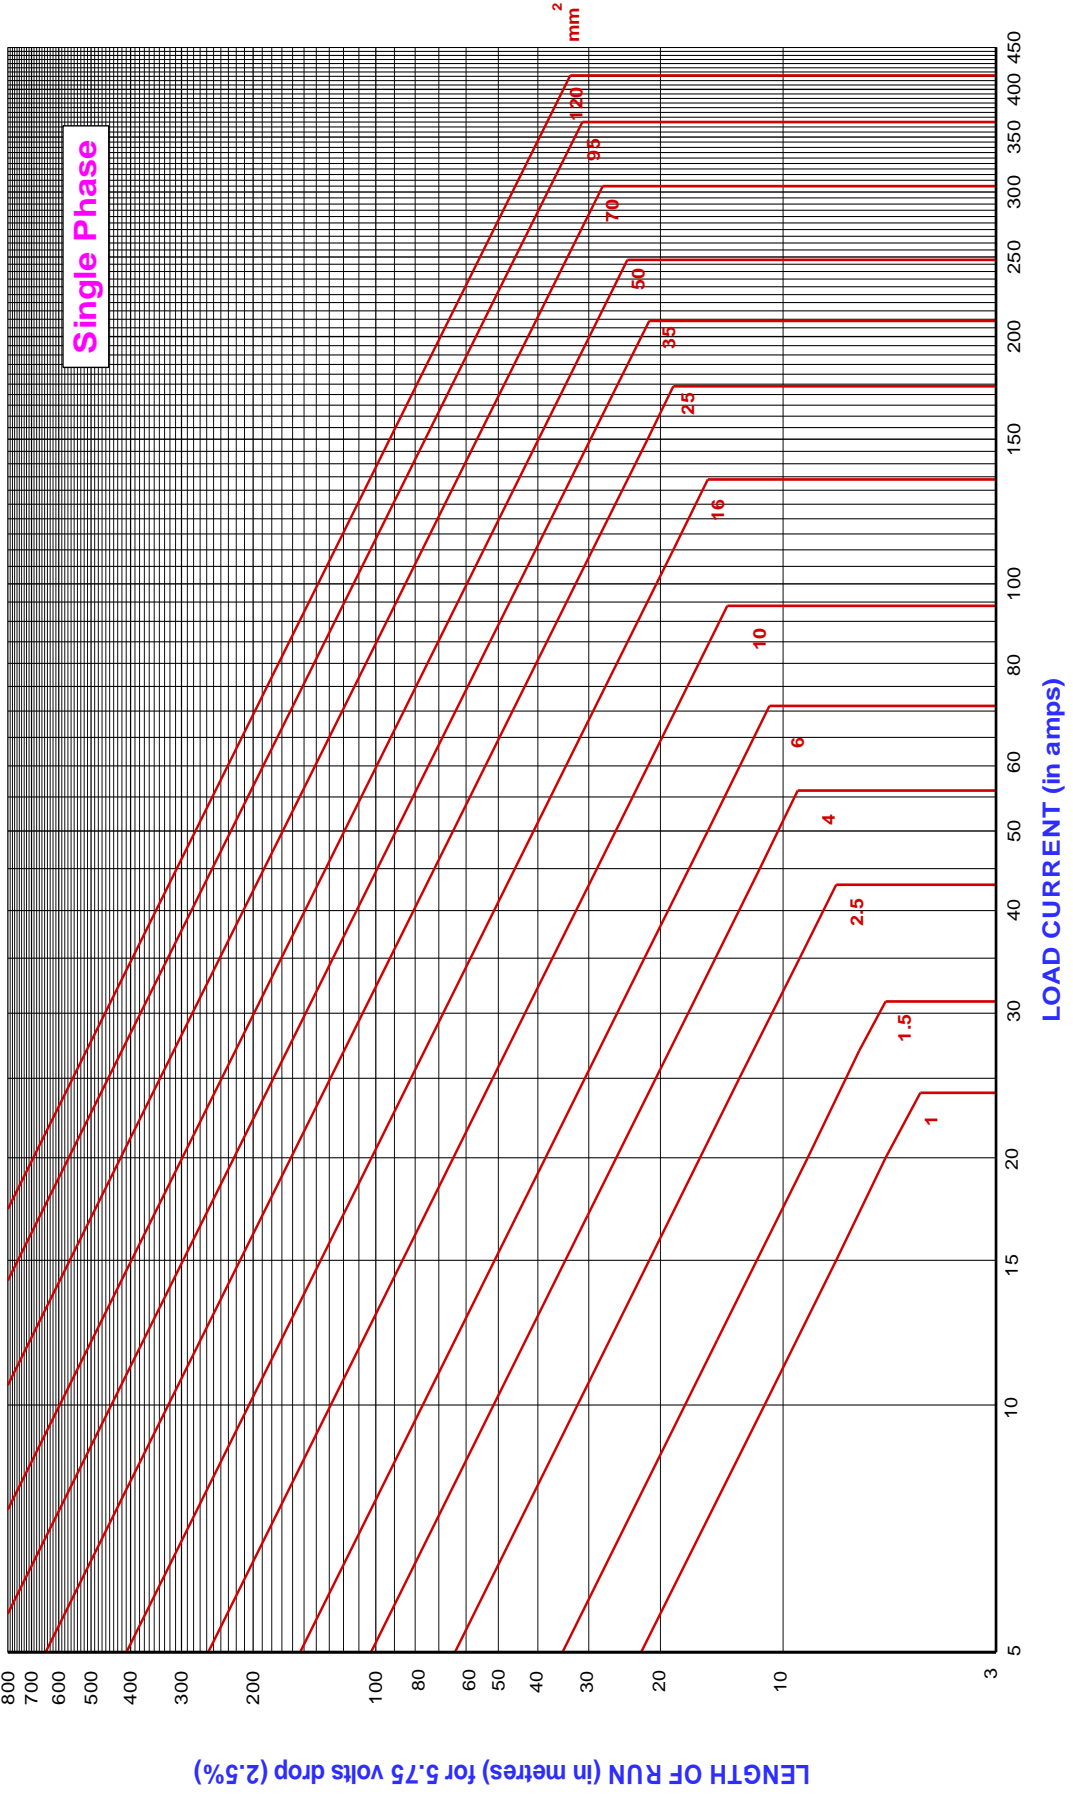
**It is the responsibility of the Electrician signing the Certificate of Compliance to ensure that all the requirements of the Wiring Regulations are met.**

## LIST OF GRAPHS

<b>Graph 1</b>	Single core, Copper, PVC insulation, PVC sheathed or unsheathed. Conduit or TPS.
<b>Graph 2</b>	Single phase, 1 mm <sup>2</sup> to 120 mm <sup>2</sup> Single core, Copper, PVC insulation, PVC sheathed or unsheathed. Conduit or TPS. Three phase, Trefoil, Balanced, 1 mm <sup>2</sup> to 120 mm <sup>2</sup>
<b>Graph 3</b>	Single core, Copper, PVC insulation, PVC sheathed or unsheathed. Conduit or TPS. Three phase, Flat, Balanced, 1 mm <sup>2</sup> to 120 mm <sup>2</sup>
<b>Graph 4</b>	Single core, copper, XLPE (X-90) insulation, PVC sheathed. Cantol. Single phase, 16 mm <sup>2</sup> to 630 mm <sup>2</sup>
<b>Graph 5</b>	Single core, Copper, XLPE (X-90) insulation, PVC sheathed. Cantol. Three phase, Trefoil, Balanced, 16 mm <sup>2</sup> to 630 mm <sup>2</sup>
<b>Graph 6</b>	Single core, Copper, XLPE (X-90) insulation, PVC sheathed. Cantol. Three phase, Flat, Balanced, 16 mm <sup>2</sup> to 630 mm <sup>2</sup>
<b>Graph 7</b>	Single core, Aluminium, XLPE (X-90) insulation, PVC sheathed. Cantol. Single phase, 70 mm <sup>2</sup> to 630 mm <sup>2</sup>
<b>Graph 8</b>	Single core, Aluminium, XLPE (X-90) insulation, PVC sheathed. Cantol. Three phase, Trefoil, Balanced, 70 mm <sup>2</sup> to 630 mm <sup>2</sup>
<b>Graph 9</b>	Single core, Aluminium, XLPE (X-90) insulation, PVC sheathed. Cantol. Three phase, Flat, Balanced, 70 mm <sup>2</sup> to 630 mm <sup>2</sup>
<b>Graph 10</b>	Two core, Copper, PVC insulation, armoured or unarmoured or neutral screened, PVC sheathed. TPS or Remolex. Single phase, 1 mm <sup>2</sup> to 50 mm <sup>2</sup>
<b>Graph 11</b>	Three or four core, Copper, PVC insulation, armoured or unarmoured or neutral screened, PVC sheathed. TPS or Remolex. Three phase, Balanced, 1.5 mm <sup>2</sup> to 35 mm <sup>2</sup>
<b>Graph 12</b>	Three or four core, Copper, XLPE (X-90) insulation, armoured or unarmoured or neutral screened, PVC sheathed. Cempex. Three phase, Balanced, 6 mm <sup>2</sup> to 240 mm <sup>2</sup>
<b>Graph 13</b>	Three or four core, Aluminium, XLPE (X-90) insulation, armoured or unarmoured or neutral screened, PVC sheathed. URD. Three phase, Balanced, 35 mm <sup>2</sup> to 240 mm <sup>2</sup>

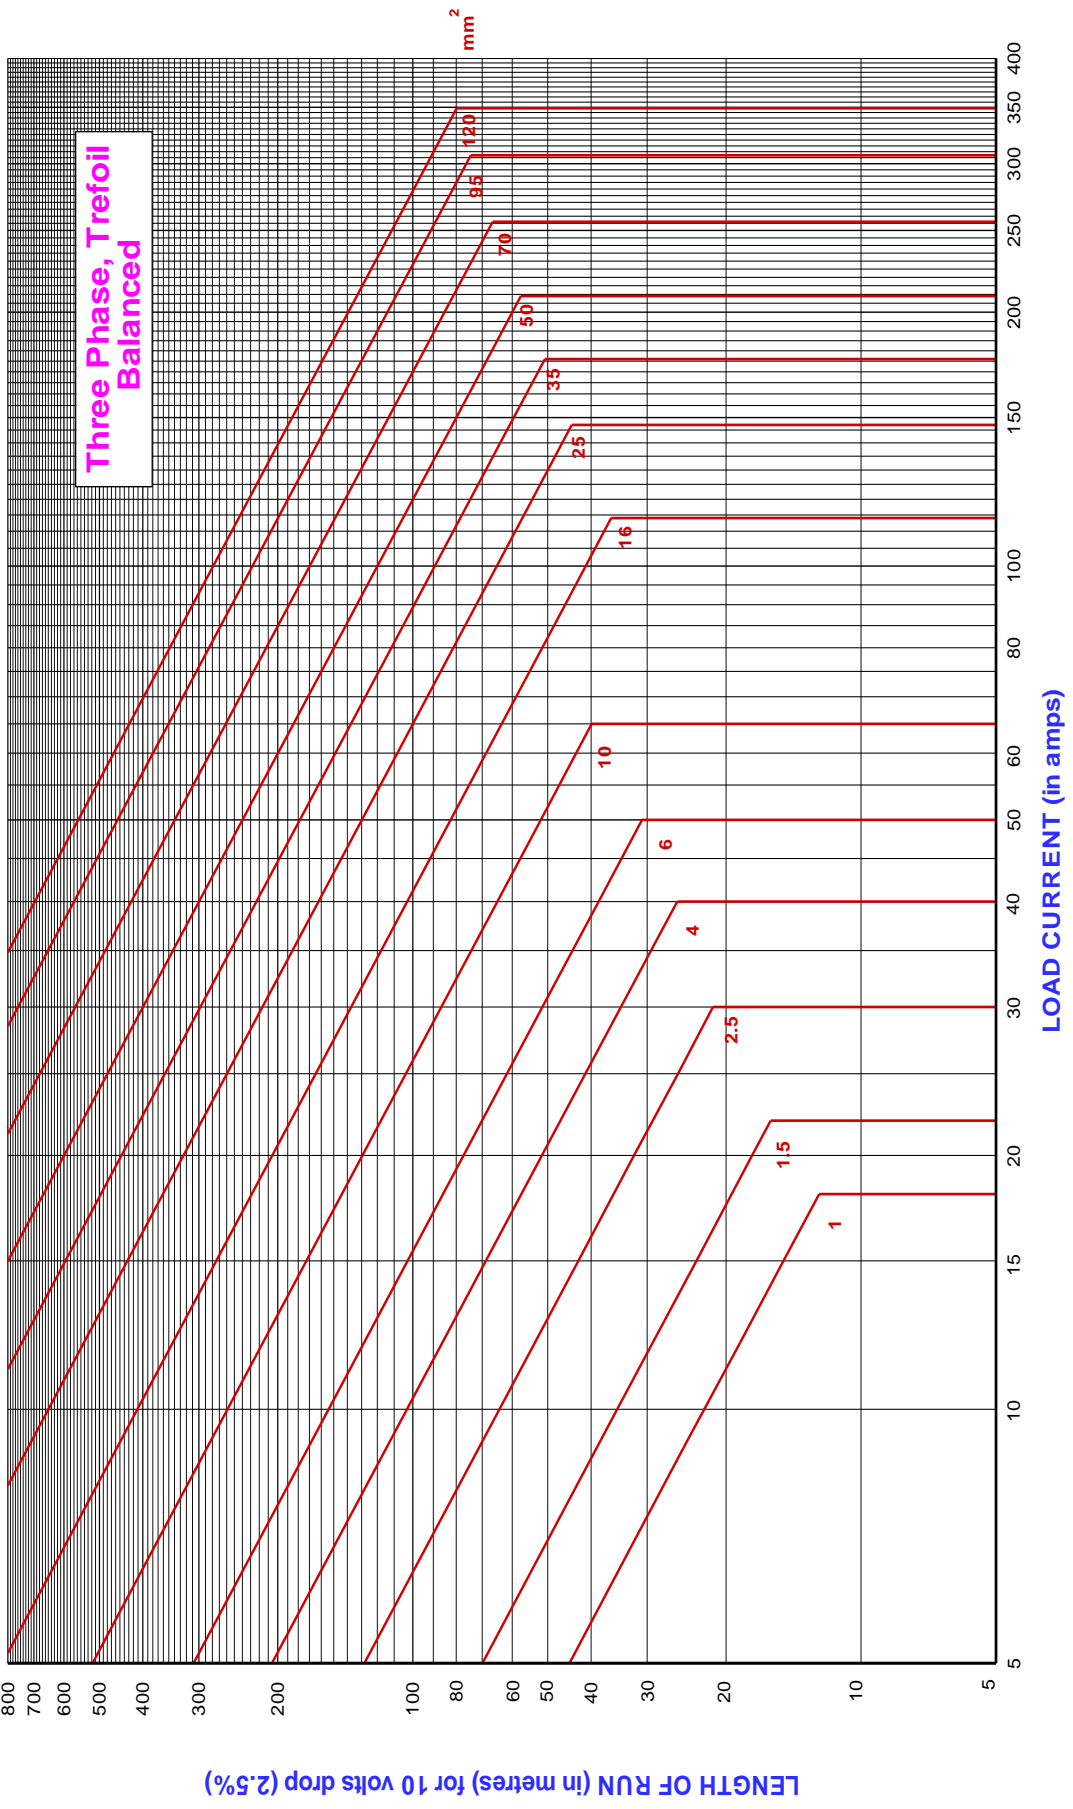
**Single Core, Copper, PVC Insulation, PVC Sheathed or Unsheathed, Conduit or TPS**

**Graph 1**  
Jan 2012



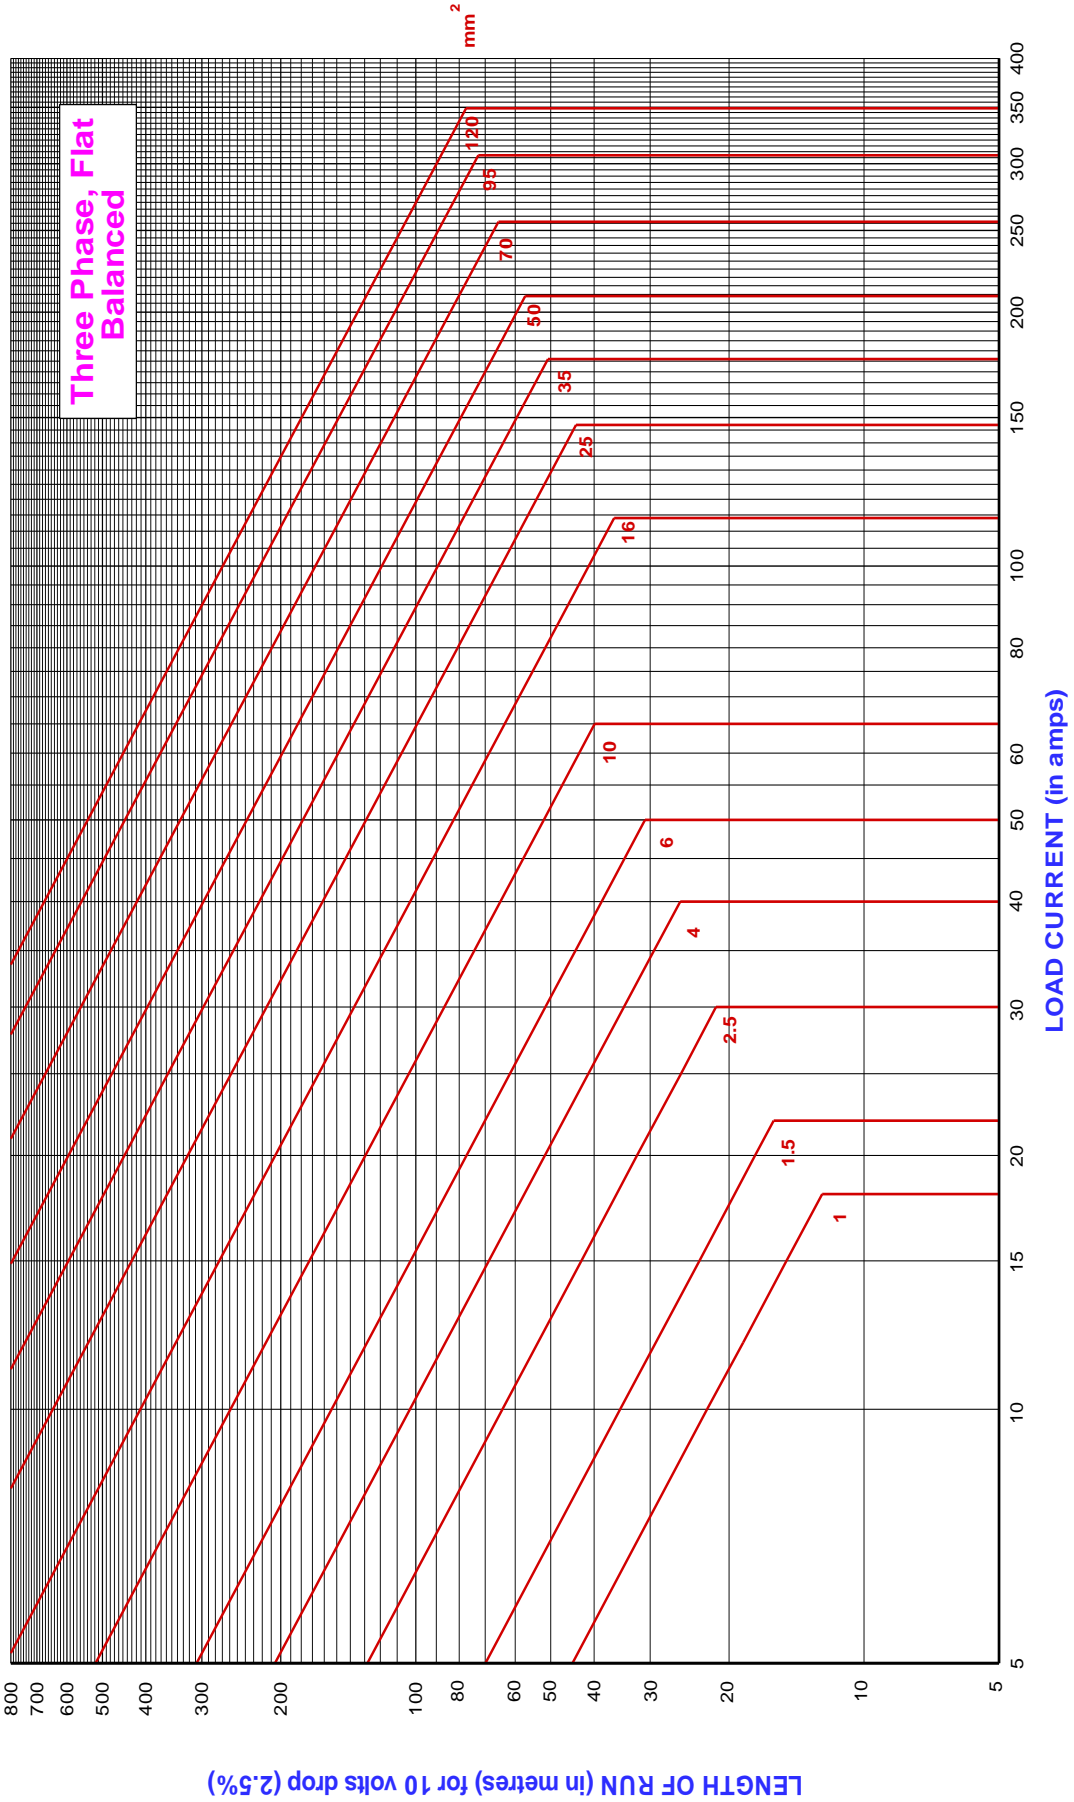
**Single Core, Copper, PVC Insulation, PVC Sheathed or Unsheathed, Conduit or TPS**

**Graph 2**  
Jan 2012



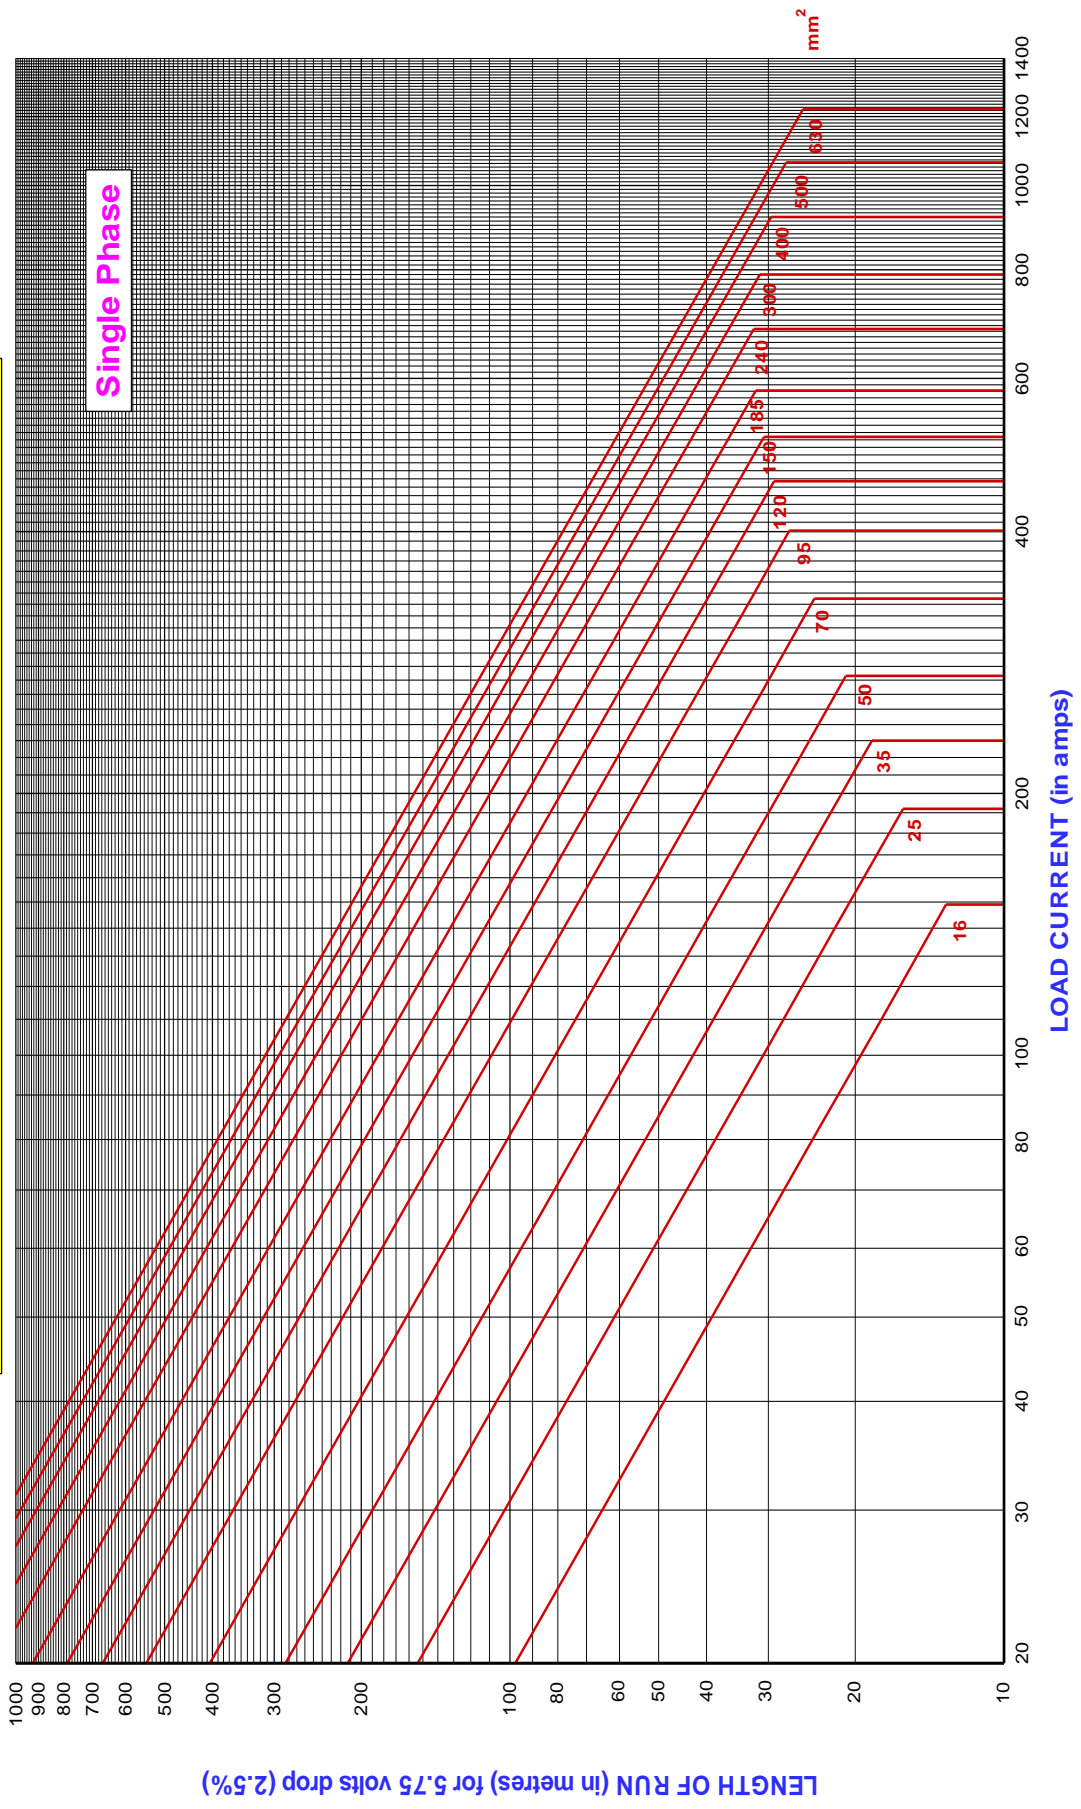
**Single Core, Copper, PVC Insulation, PVC Sheathed or Unsheathed, Conduit or TPS**

**Graph 3**  
Jan 2012



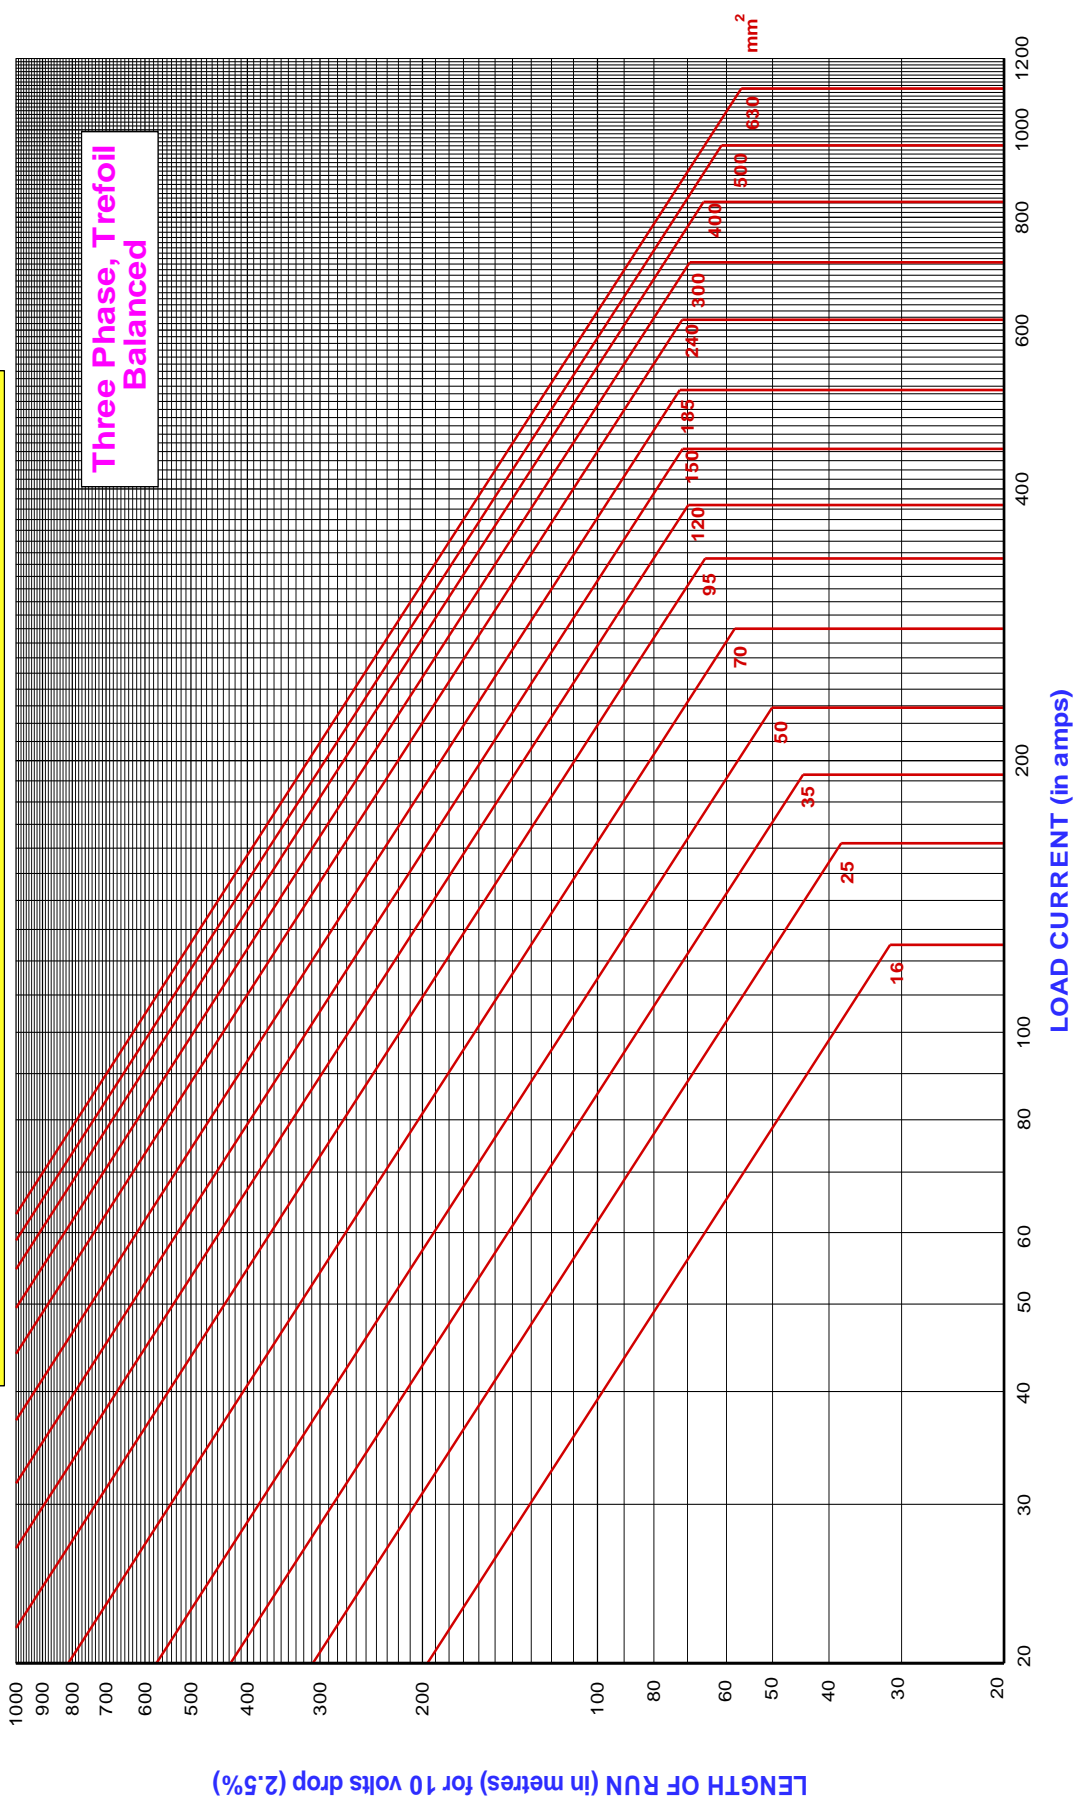
**Single Core, Copper, XLPE (X-90) Insulation, PVC Sheathed. Cantol**

**Graph 4**  
Jan 2012



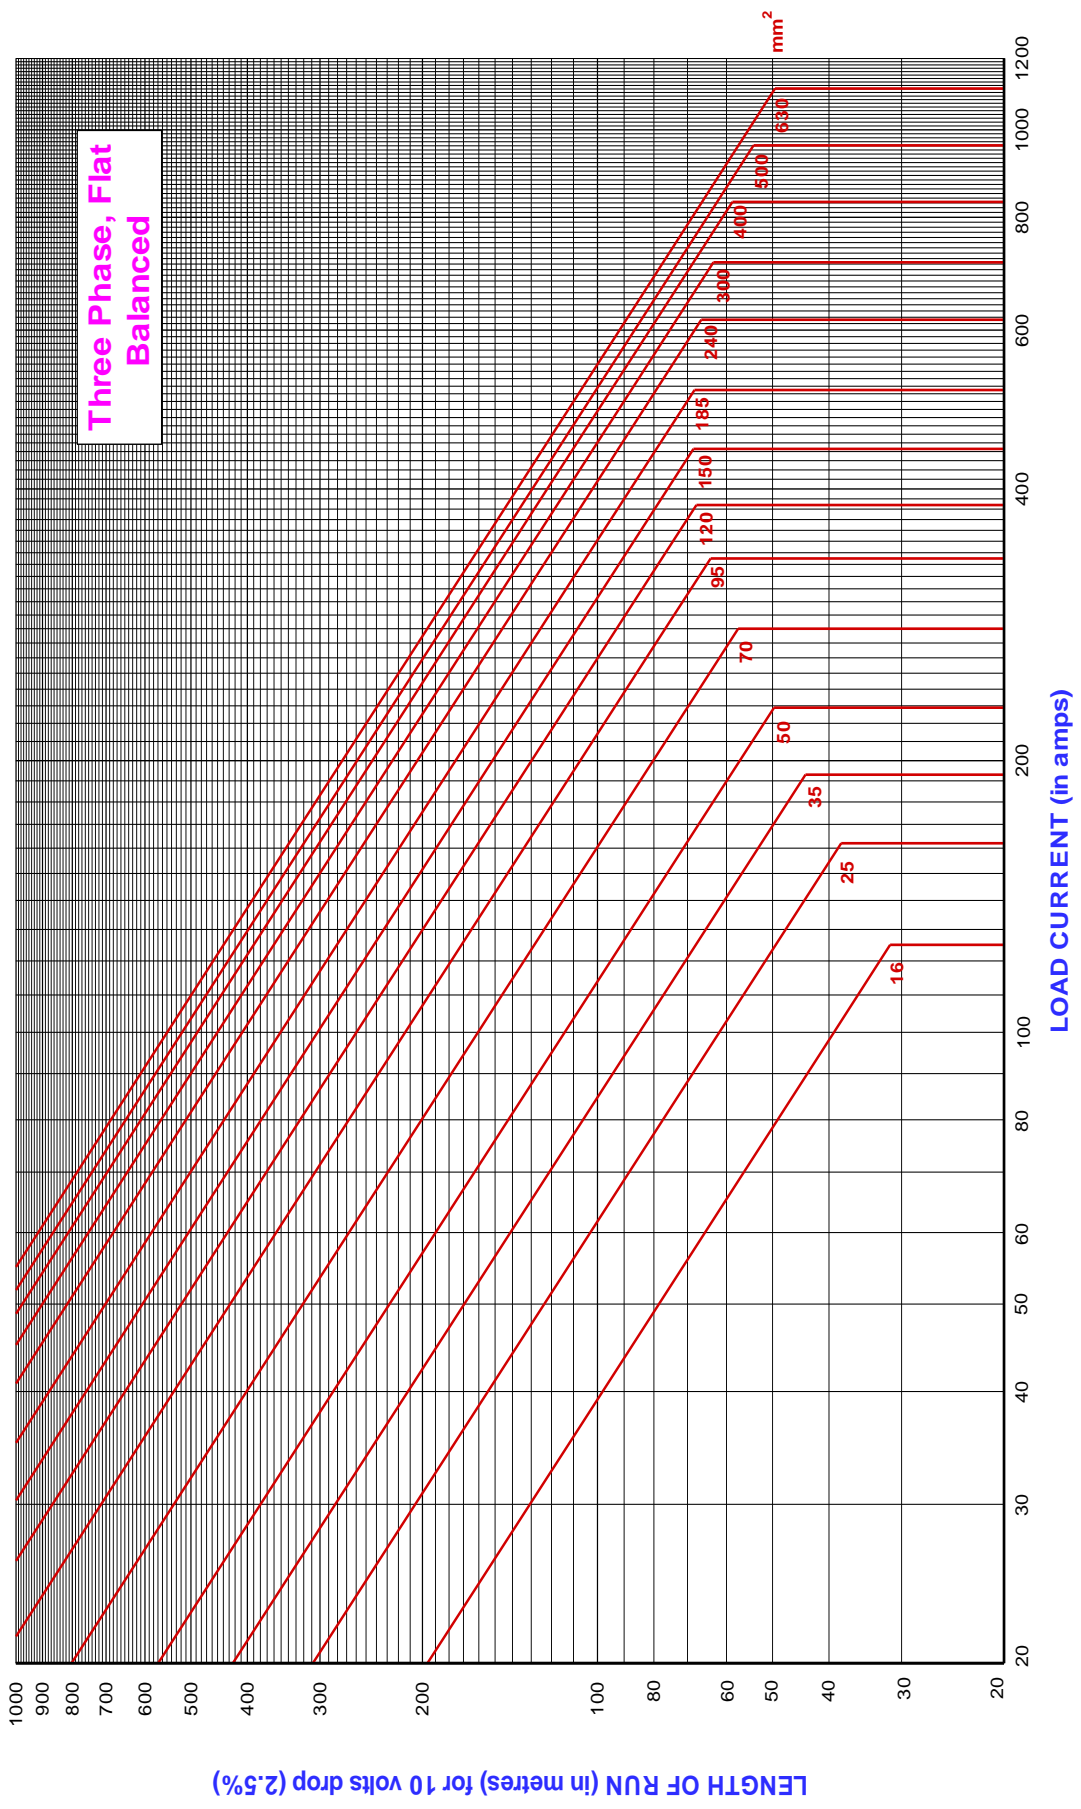
**Single Core, Copper, XLPE (X-90) Insulation, PVC Sheathed.  
Cantol**

**Graph 5**  
Jan 2012



**Single Core, Copper, XLPE (X-90) Insulation, PVC Sheathed.  
Cantol**

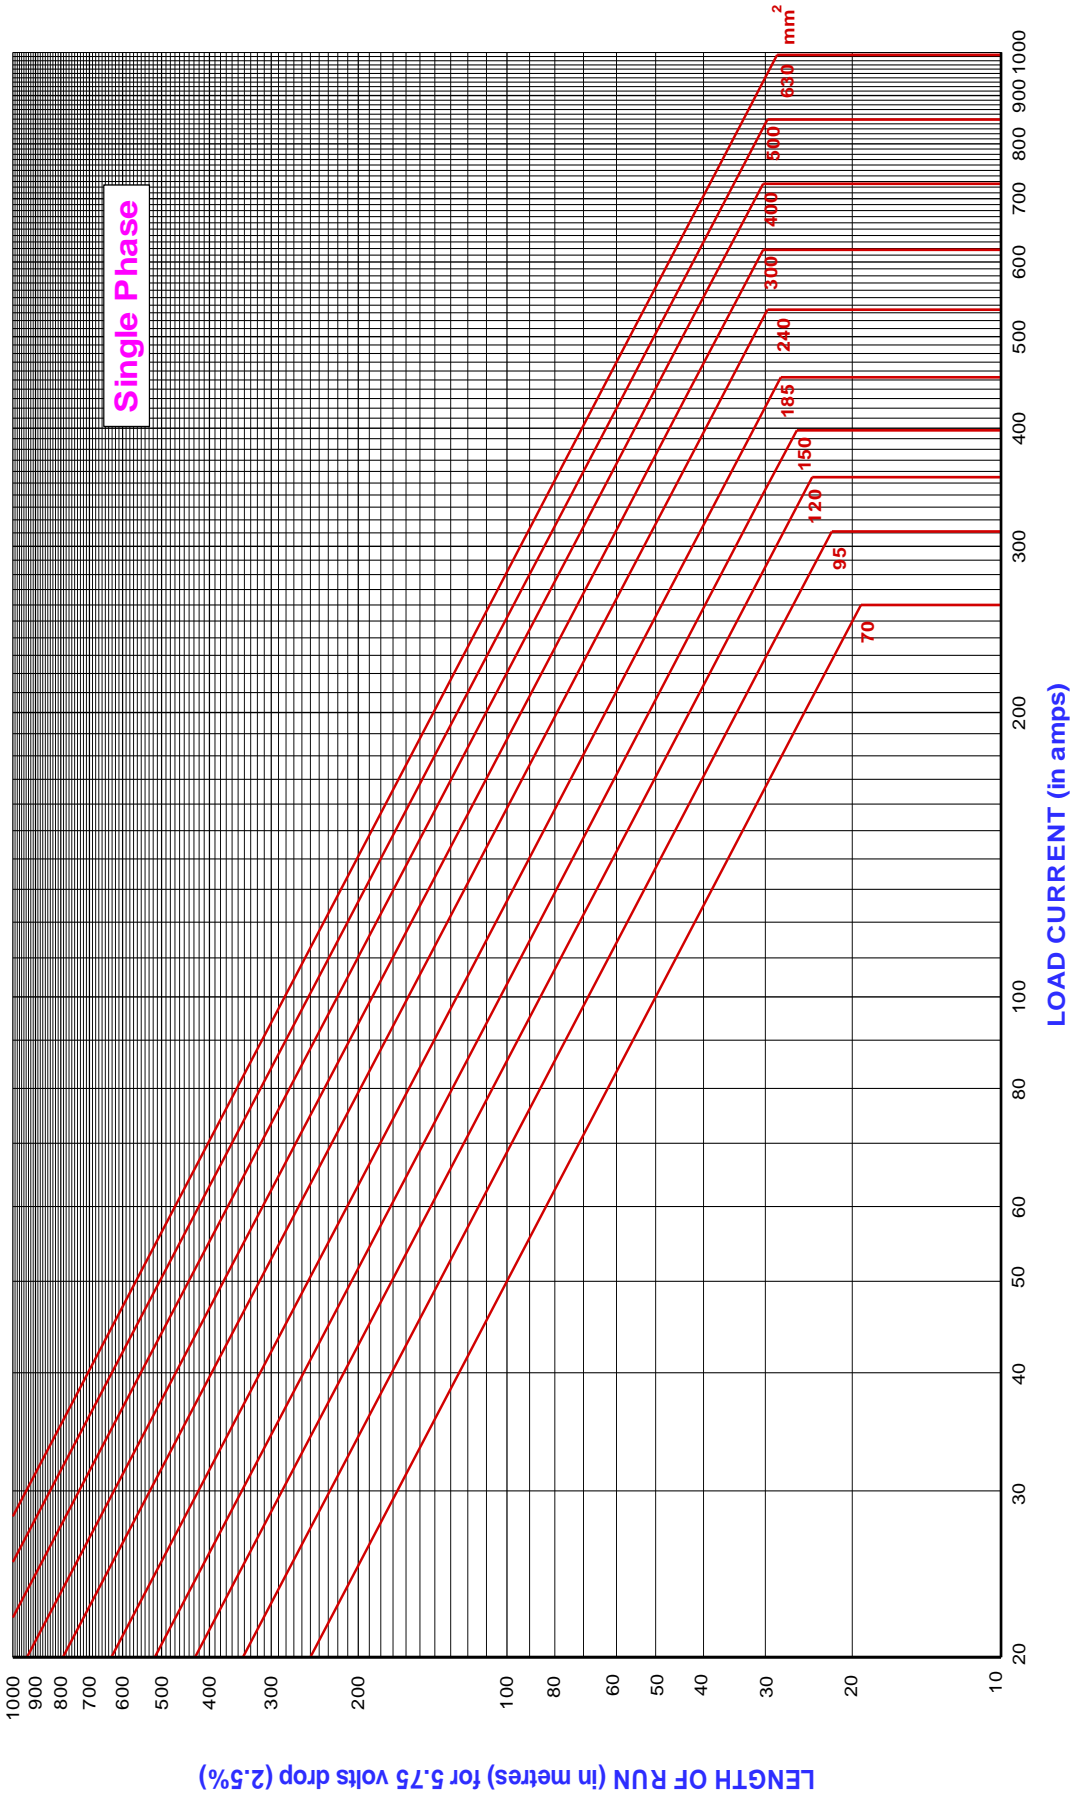
**Graph 6**  
Jan 2012





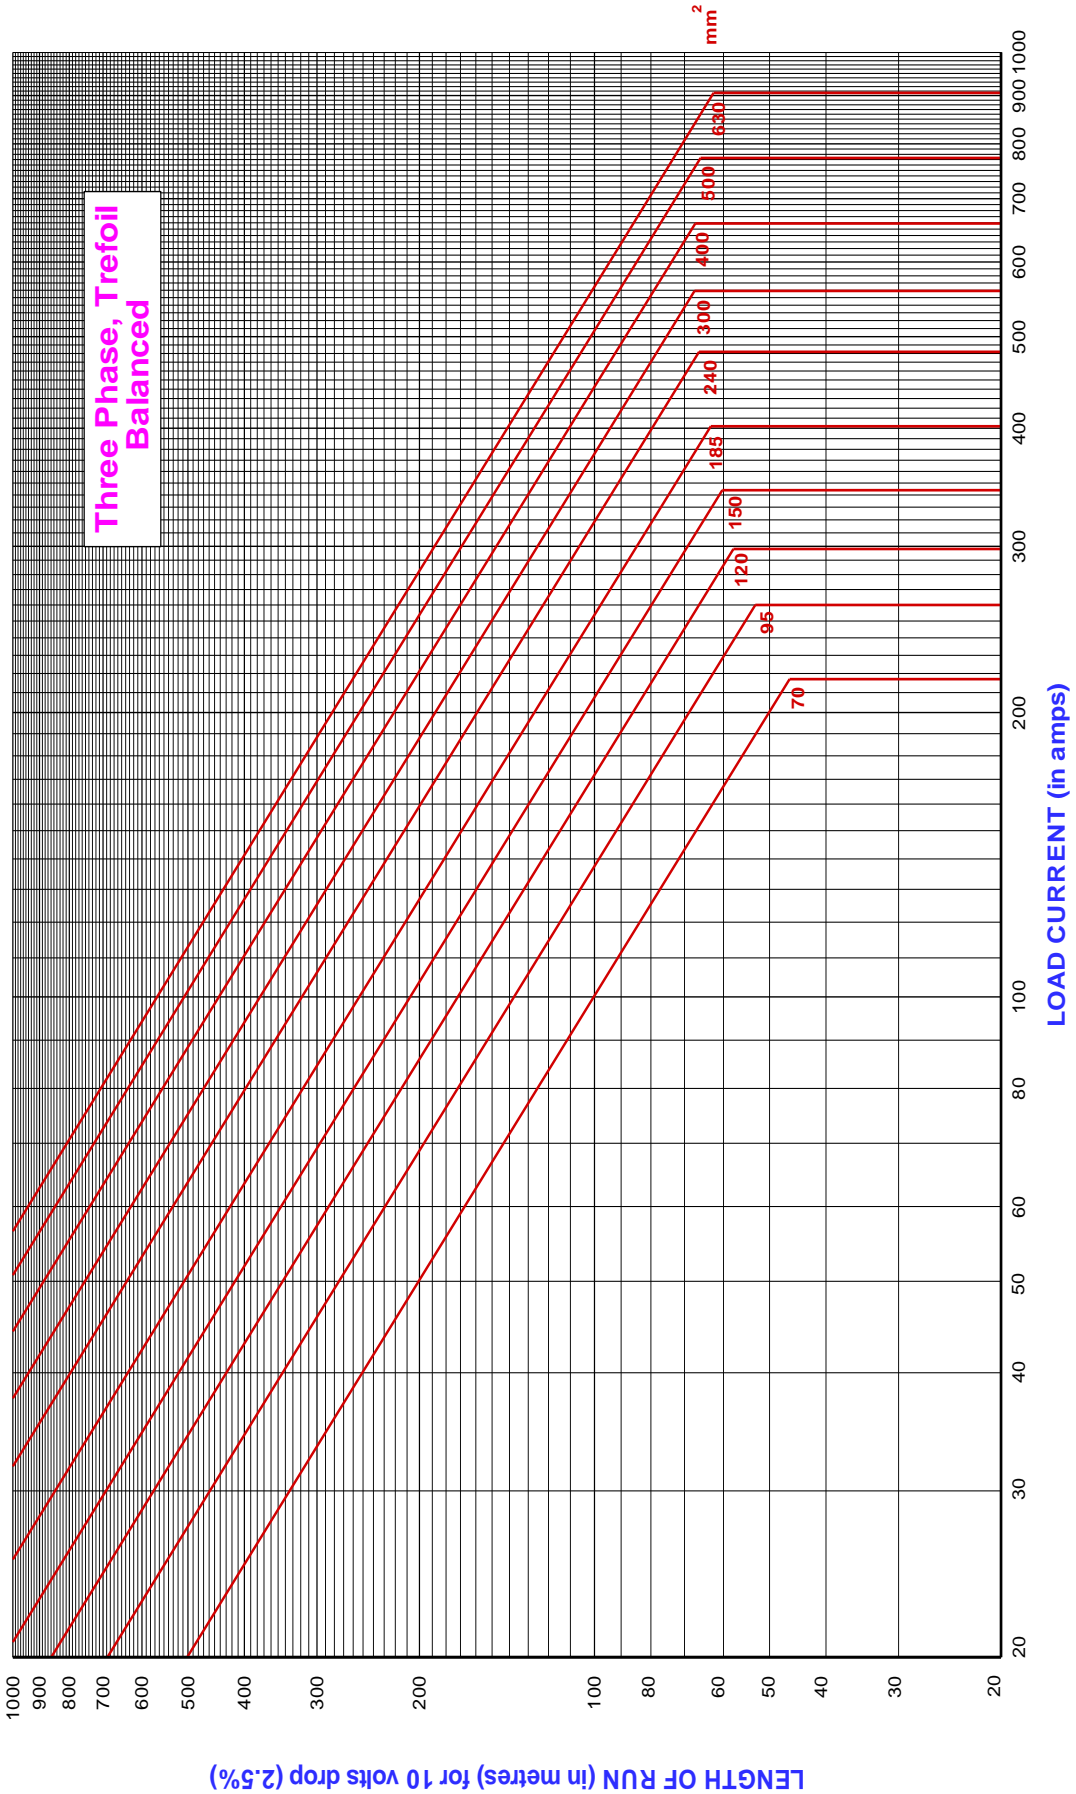
**Single Core, Aluminium, XLPE (X-90) Insulation, PVC Sheathed, Cantol**

**Graph 7**  
Jan 2012



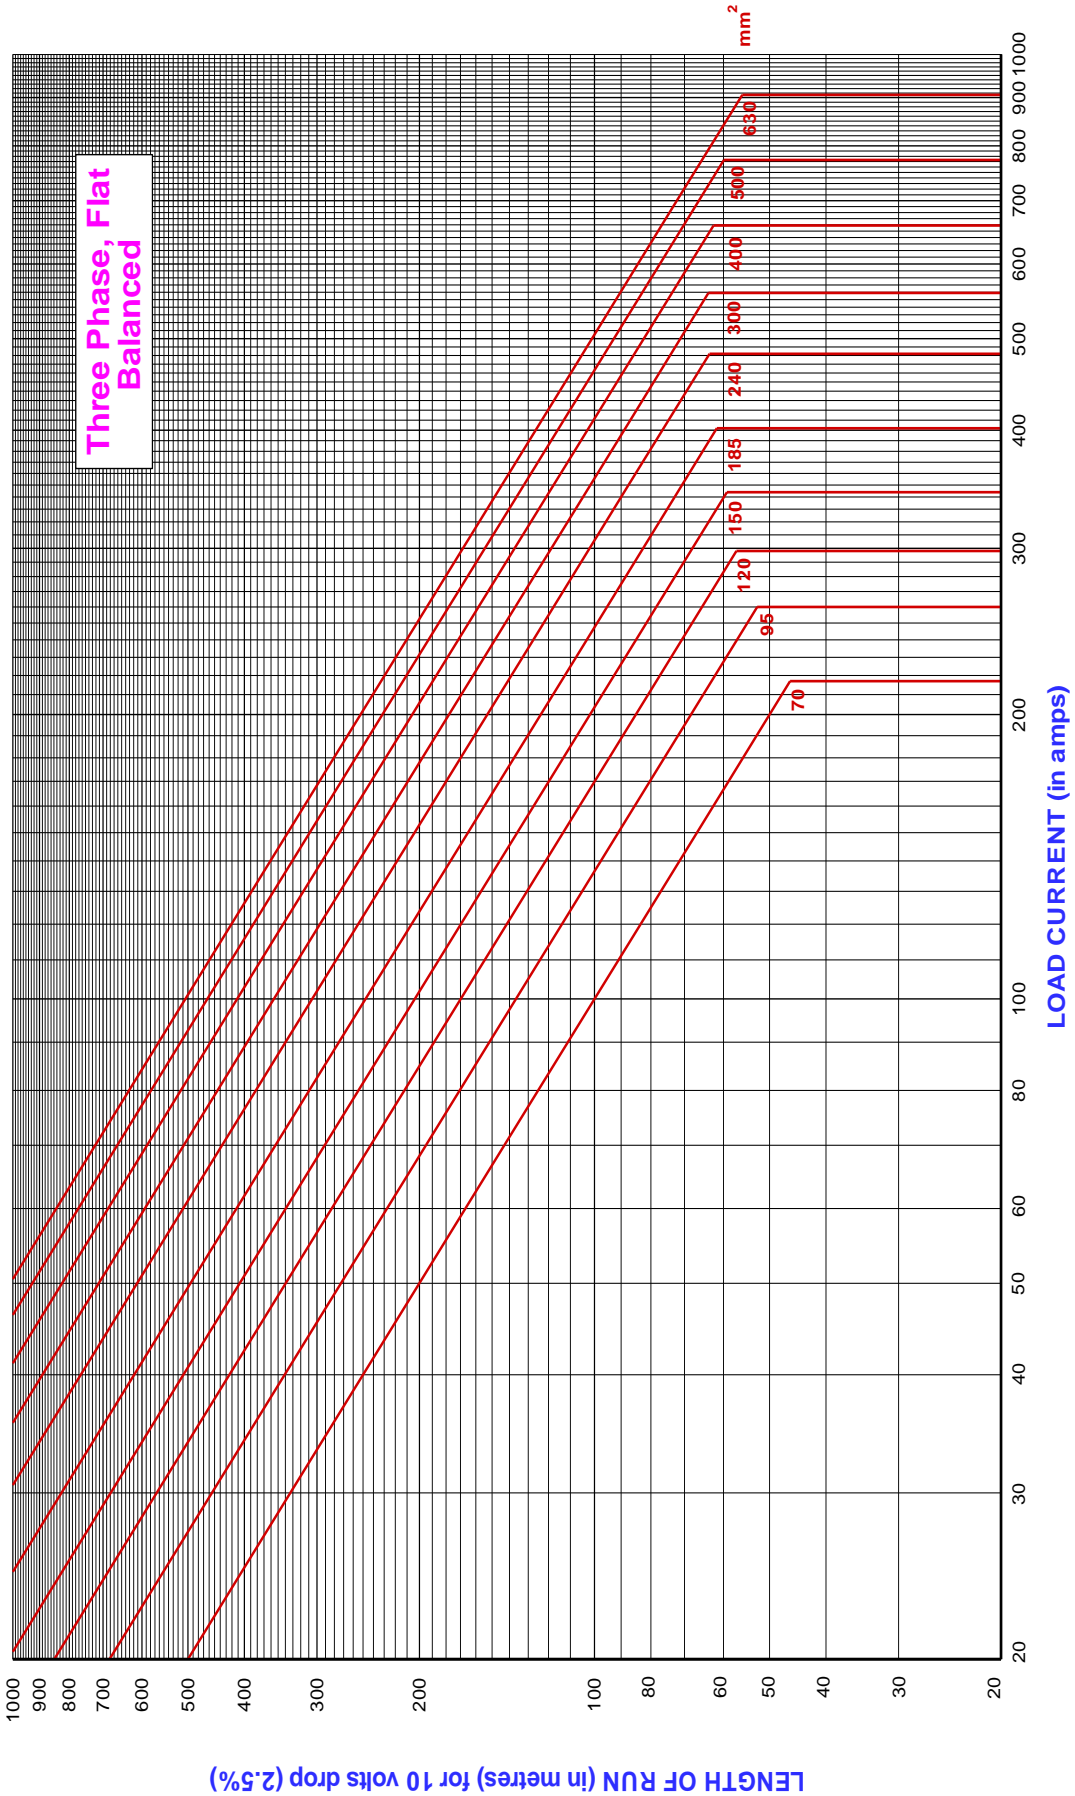
**Single Core, Aluminium, XLPE (X-90) Insulation, PVC Sheathed.  
Cantol**

**Graph 8**  
Jan 2012



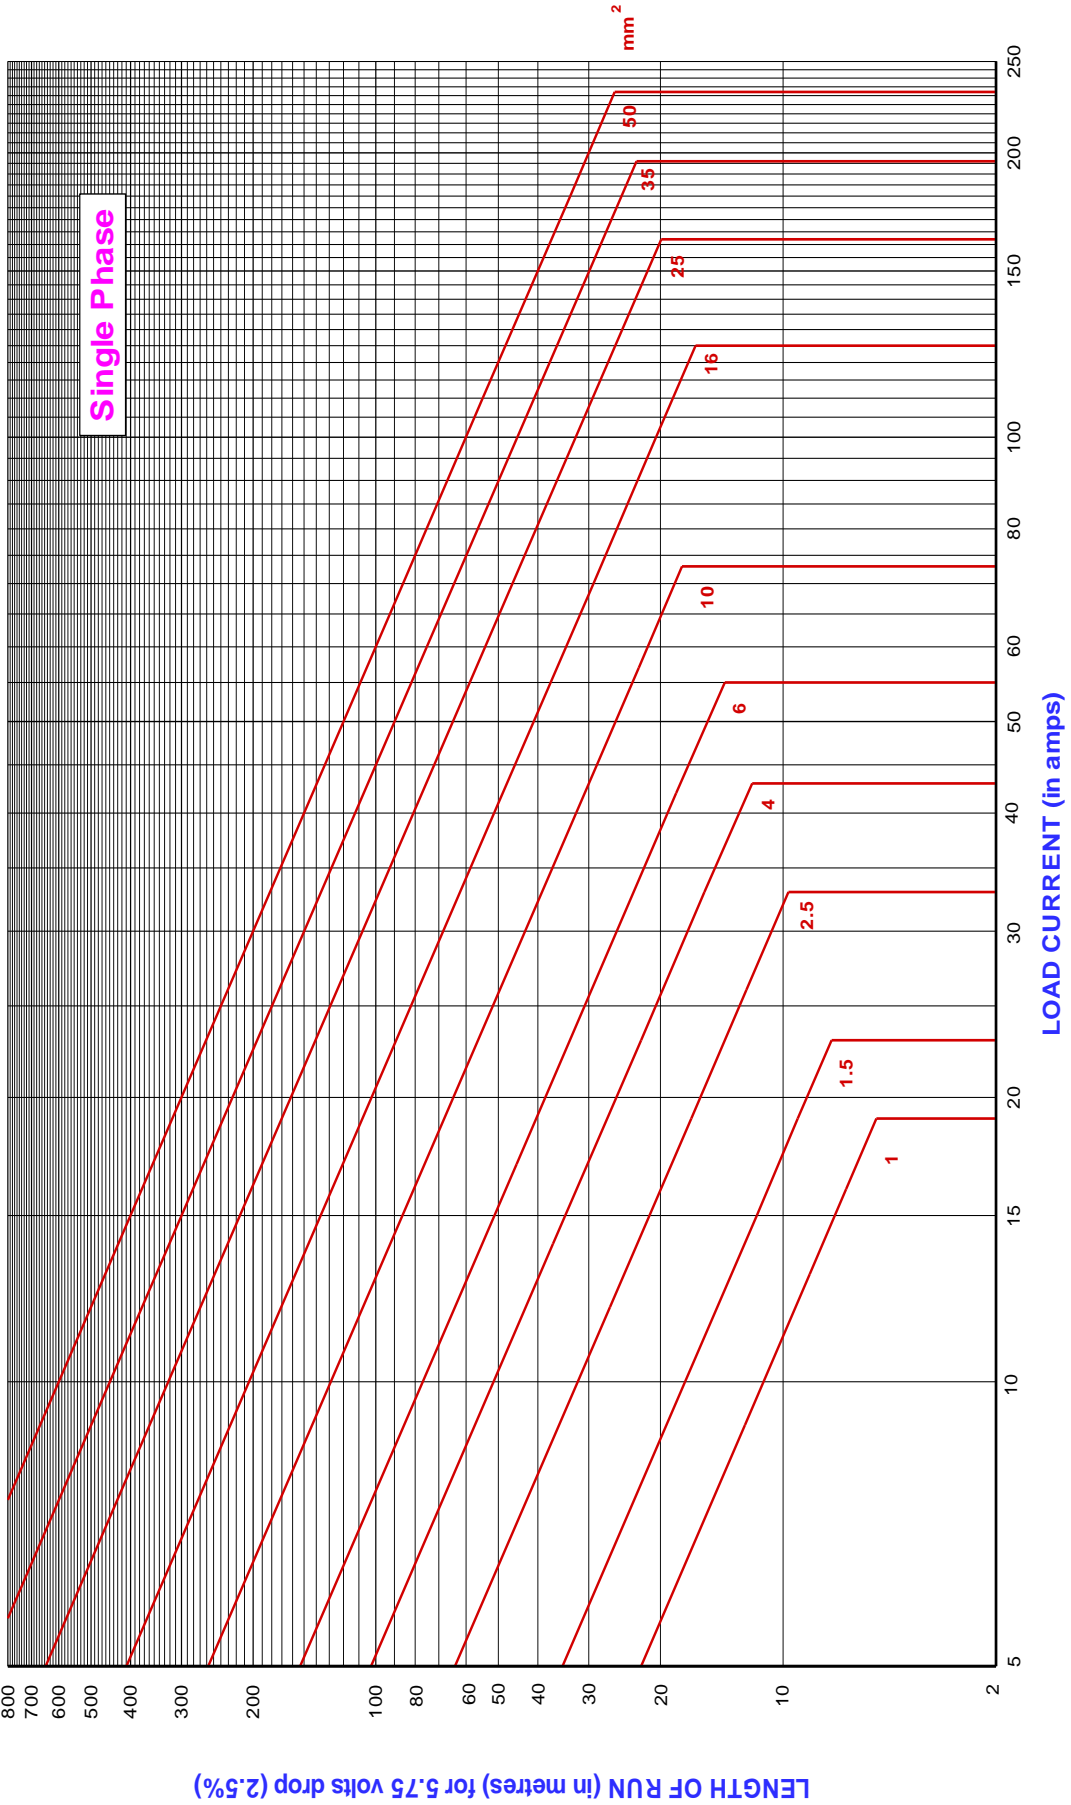
**Single Core, Aluminium, XLPE (X-90) Insulation, PVC Sheathed.  
Cantol**

**Graph 9**  
Jan 2012



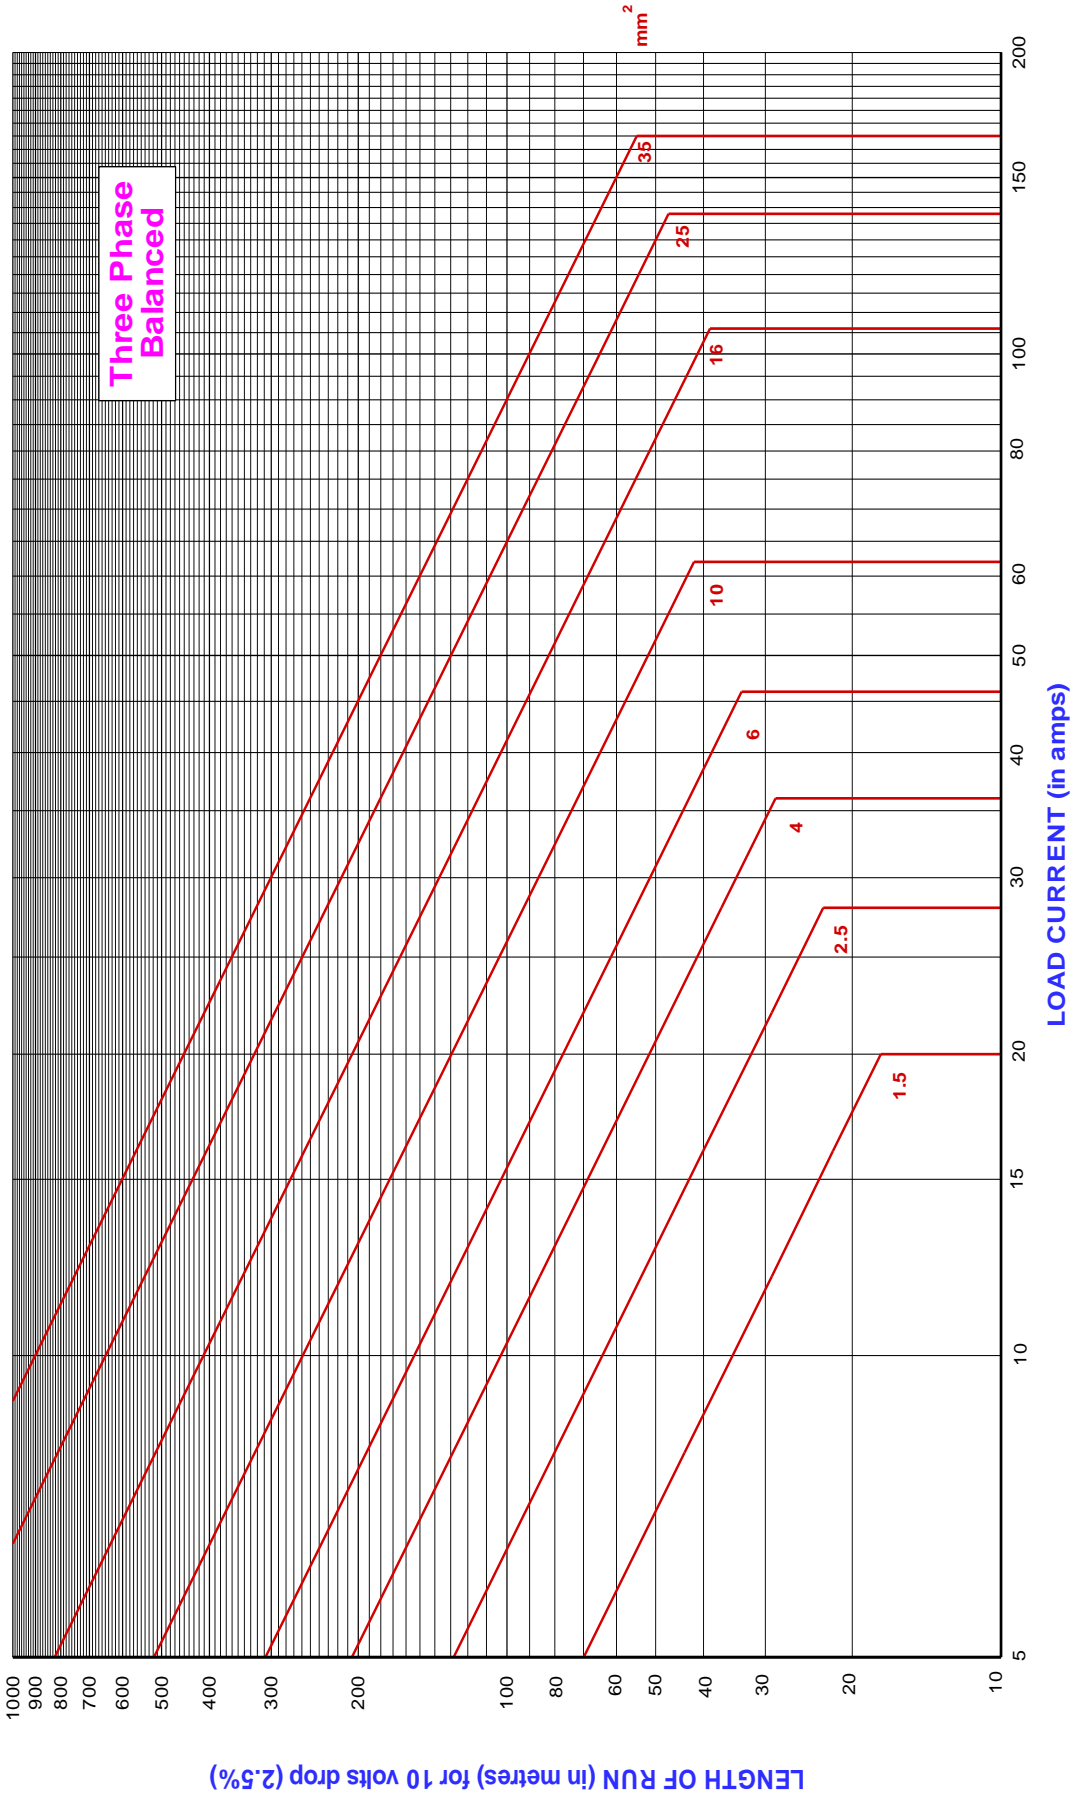
**Two Core, Copper, PVC Insulation, Armoured or Unarmoured or Neutral Screened, PVC Sheathed. TPS or Remolex**

**Graph 10**  
Jan 2012



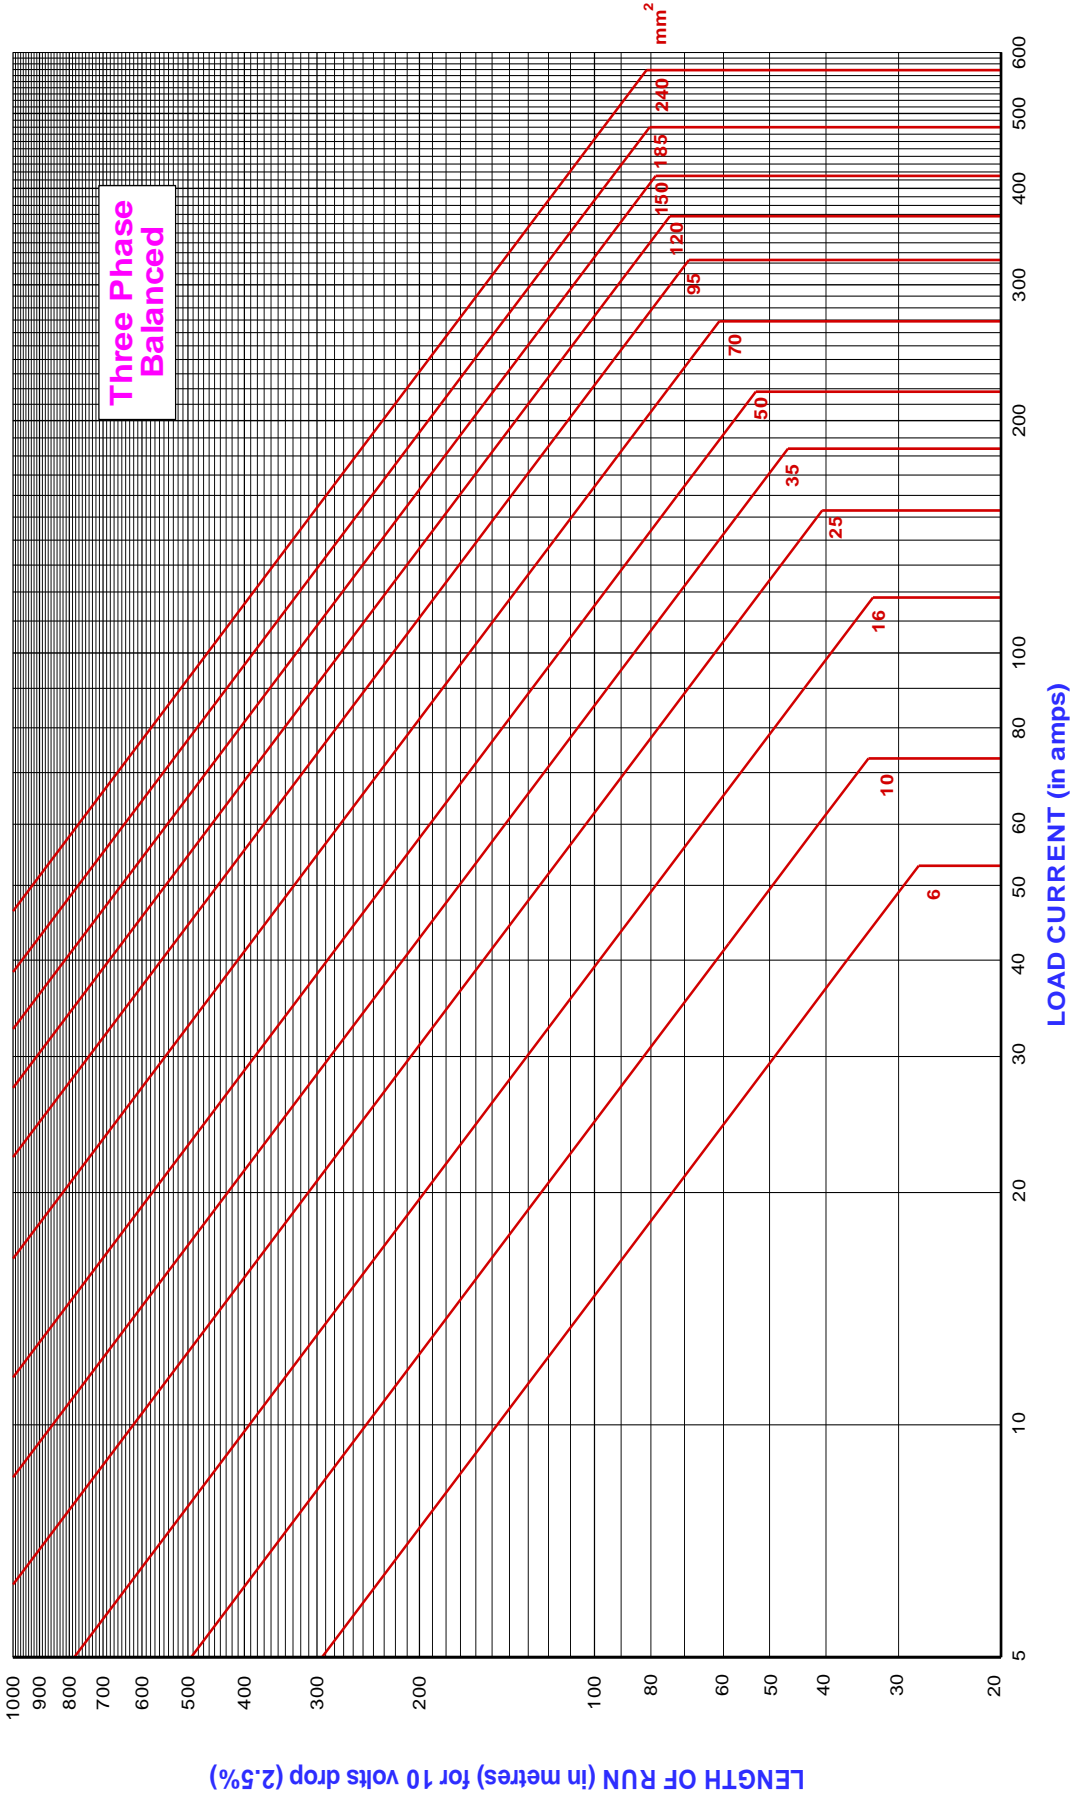
**Three or Four Core, Copper, PVC Insulation, Armoured or Unarmoured or Neutral Screened, PVC Sheathed, TPS or Remolex**

**Graph 11**  
Jan 2012



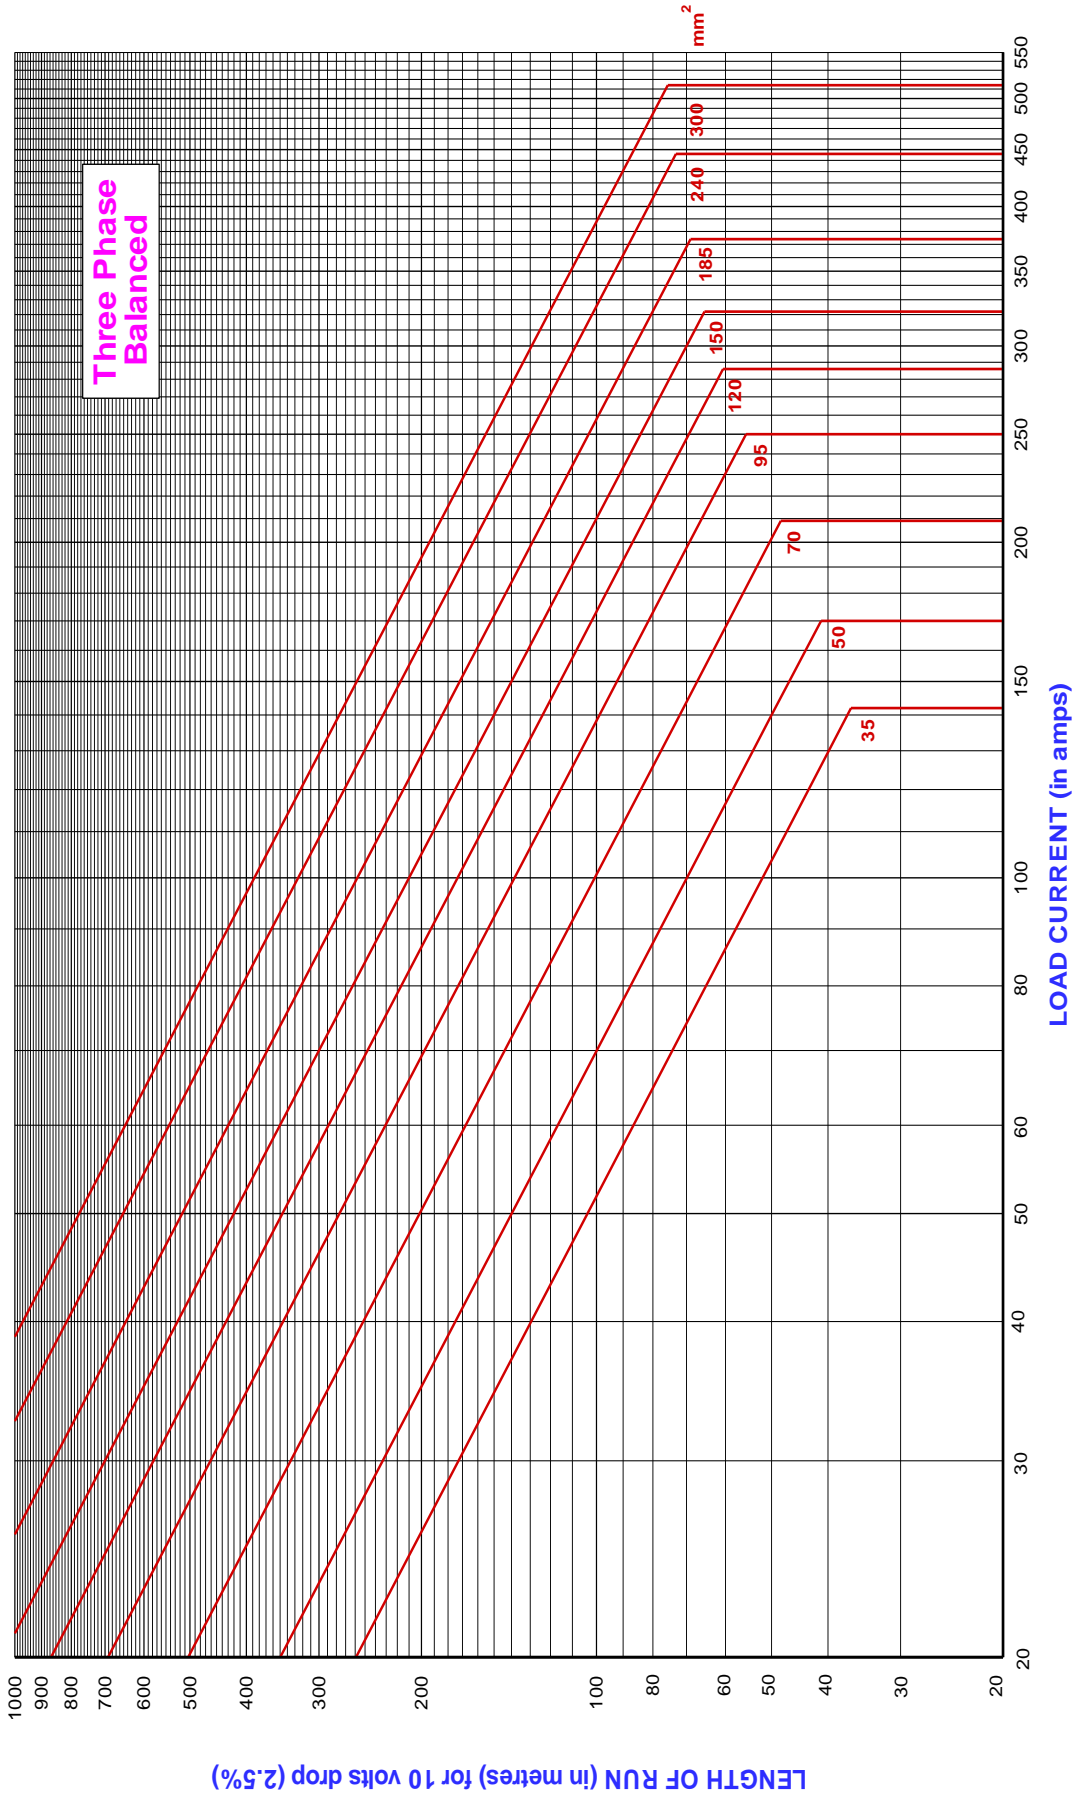
**Three or Four Core, Copper, XLPE (X-90) Insulation, Armoured or Unarmoured or Neutral Screened, PVC Sheathed. Cempex**

**Graph 12**  
Jan 2012



**Three or Four Core, Aluminium, XLPE (X-90) Insulation, Armoured or Unarmoured or Neutral Screened, PVC Sheathed. URD**

**Graph 13**  
Jan 2012



---

# NOTES



# SECTION FOUR

## MEDIUM VOLTAGE

### TR-XLPE LONG-LIFE CABLES

	<b>PAGE</b>
<b>Explanatory Information</b>	<b>2-13</b>
History of long-life cables	2
Constructing Long-life cable	3
Screen Designs	4
Testing	5
Test Voltage Levels	6
Installation Tests	7
Current Ratings	10
Rating Factors	11
Notes	12
<b>Product Sheets</b>	<b>14-58</b>
Single Core Cu 11 kV Cables - 3 kA for 1 s Wire Screens	14
Single Core Cu 11 kV Cables - 10 kA for 1 s Wire Screens	16
Single Core Al 11 kV Cables - 3 kA for 1 s Wire Screens	18
Single Core Al 11 kV Cables - 10 kA for 1 s Wire Screens	20
Three Core Cu 11 kV Cables - 3 kA for 1 s Wire Screens	22
Three Core Cu 11 kV Cables - 10 kA for 1 s Wire Screens	24
Three Core Al 11 kV Cables - 3 kA for 1 s Wire Screens	26
Three Core Al 11 kV Cables - 10 kA for 1 s Wire Screens	28
Single Core Cu 22 kV Cables - 3 kA for 1 s Wire Screens	30
Single Core Cu 22 kV Cables - 10 kA for 1 s Wire Screens	32
Single Core Al 22 kV Cables - 3 kA for 1 s Wire Screens	34
Single Core Al 22 kV Cables - 10 kA for 1 s Wire Screens	36
Three Core Cu 22 kV Cables - 3 kA for 1 s Wire Screens	38
Three Core Cu 22 kV Cables - 10 kA for 1 s Wire Screens	40
Three Core Al 22 kV Cables - 3 kA for 1 s Wire Screens	42
Three Core Al 22 kV Cables - 10 kA for 1 s Wire Screens	44
Single Core Cu 33 kV Cables - 3 kA for 1 s Wire Screens	46
Single Core Cu 33 kV Cables - 10 kA for 1 s Wire Screens	48
Single Core Al 33 kV Cables - 3 kA for 1 s Wire Screens	50
Single Core Al 33 kV Cables - 10 kA for 1 s Wire Screens	52
Three Core Cu 33 kV Cables	55
Three Core Al 33 kV Cables	57
<b>Notes</b>	<b>58</b>

# HISTORY OF LONG-LIFE CABLES

Nexans has an impressive long history as pioneers for designing and manufacturing quality medium voltage cables in New Zealand. As the largest power cable manufacturer in NZ and the only manufacturer of MV, we pride ourselves on delivering cable that has a life expectancy of over 50 years from our state of the art facility in New Plymouth, and have been since 1967.

In 1967, CANZAC cables were the first to manufacture the first-generation cross-linked polyethylene cables in the Southern Hemisphere and again were the first to introduce extruded semi-conductive screens to replace the taped version in 1973. In 1990, Olex Cables upgraded from steam to dry-cured triple extrusion and introduced the first-generation tree-retardant cross-linked polyethylene (TR-XLPE) in New Zealand. Eight years later, an X-ray 8000 dimensional controller was installed to the machine which scans through three layers of polymer to accurately measure layer thicknesses for consistency. After an improvement on the compound which was trialled in 1998, Olex Cables then went into full production of the second-generation TR-XLPE in 2005, reducing tree-growth even further. A new advanced hi-tech X-ray is installed the same year. Nexans Olex trialled the next generation of TR-XLPE in 2011 and went into full production in 2017, making Nexans NZ leaders in long-life cable.

## Don't take a chance on the unknown

Have you ever considered why some cable products are so much cheaper than others? With cable, most of the cost is in the materials. If the price looks too good to be true, it almost certainly is!

Nexans have collaborated with our compound supplier for over 50 years to provide the best TR-XLPE material available on the market today, and our testing requires special equipment to ensure AS/NZS standards are not only met but exceed.

Investing in our cable gives you the very best of design, materials, refined manufacturing processes and quality test systems.

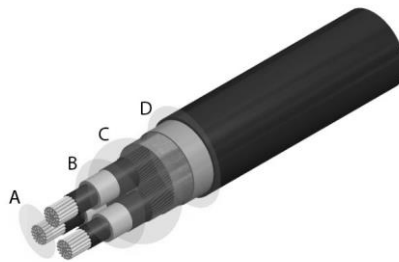
## Indicative cost comparison

	<i>Nexans</i>	<i>Unbranded</i>
MDPE Sheath		-2%
PVC Sheath		-1%
Aluminium		-0%
Copper		-0%
Fillers		-0%
Certified TR-XLPE Insulation		-6%
Semi-Conductive Screen		-5%
<b>Cost</b>		<b>-14%</b>
<b>Life Expectancy</b>	<b>50 Years</b>	<b>?</b>

# CONSTRUCTING LONG-LIFE CABLE

Nexans Medium Voltage TR-XLPE cables are designed in accordance with AS/NZS 1429.1:2006 and specific customer requirements where applicable to provide optimum performance for the end application.

The AS/NZS 1429.1:2006 is compatible with, and in some instances, exceeds, the requirements of the international standard IEC 60502.2. AS/NZS 1429.1 is also compatible with (UK) BS 6622 and (US) AEIC CS8 and ICEA S-93-639/NEMA WC74.



**A** – We use the highest grades of copper/aluminium and the latest technology in stranding to manufacture over 2 million metres of compacted MV cores a year.

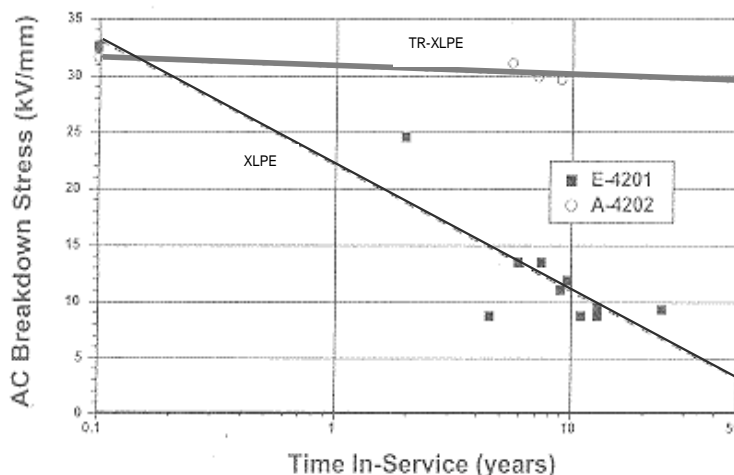
**B** – Utilising our state of the art machinery, our triple head extrusion process is fed raw materials from a pressurised clean room to ensure the interfaces between the materials are free of voids and contamination. The extruded core is then x-rayed to monitor wall thickness and concentricity.

**C** – A carefully controlled screening and cabling process using our expertise ensures the cable is manufactured to the highest standards, meeting our individual customers fault rating requirements.

**D** – Our sheathing is applied on our extrusion line using digitally controlled micrometres for highly accurate sheathing layers. Common sheathing materials are PVC, LLDPE, MDPE and HDPE.

**Alternate designs incorporating aluminium foil laminate, steel wire armour or submarine cables can be produced upon request.**

Once the construction of cable is complete, one of the most important test for medium voltage cable before it leaves our plant is the partial discharge (PD) test. This is carried out using special equipment and ensures that our MV cables are free of voids within the insulation, guaranteeing a life expectancy of over 50 years. Imported products may not meet the same quality due to testing carried out using only the equipment they have.



Projected useful life of TR-XLPE cables – more than 50 years

## SCREEN DESIGNS

The standard range of Nexans Medium Voltage TR-XLPE cables rated up to and including 33 kV incorporates copper wire screens based on fault levels of either 3 kA or 10 kA for 1 second. If either of the standard screen designs does not suit a particular installation, the screen constructions can be tailored in size to meet the specific fault requirements of any operating system.

### Wire Screen Cross Sectional Areas

In the case of three core cables which have screens around each individual core, the total screen cross sectional area is spread evenly over the three cores.

There are several other factors which can override the above criteria. Firstly, the screens are designed so that the average gap between the wires does not exceed 4 mm. This results in the screen area being increased above that required for the required fault level in certain cases. Secondly, the screen area is limited to a value so that its fault rating does not exceed that of the conductor. In some cases, the smaller cables in a range have fault levels of less than either 3 kA or 10 kA for 1 second respectively.

### Screen Short Circuit Ratings

The screen short circuit ratings are calculated in accordance with formulae given in IEC 60949. Based on AS/NZS 1429.1 a starting temperature of 80°C and a final temperature of 250°C are used. The formulae are based on adiabatic conditions ie, no dissipation of heat during the short circuit.

The fault rating **I<sub>sc</sub>** of a copper wire screen of a given cross sectional area can be calculated for any duration from the formula:

$$I_{sc} = \frac{148.6 * S}{\sqrt{t}} \quad (A)$$

Where: S = Screen Area (mm<sup>2</sup>) and t = Fault Duration (s).

Conversely, the screen area required for a given fault rating can be calculated as follows:

$$S = \frac{I_{sc} * \sqrt{t}}{148.6} \quad (mm^2)$$

For convenience, fault ratings for durations of 1 second are often quoted and this simplifies calculations since  $\sqrt{t} = 1$  and this term disappears from the formulae.

## TESTING

Testing of Nexans Medium Voltage TR-XLPE cables is carried out in accordance with AS/NZS 1429.1:2006. The tests performed are:

**Routine tests\*** - "tests made by the manufacturer on all completed cable to demonstrate the integrity of the cable."

**Sample tests\*** - "tests made by the manufacturer on samples of completed cable, or components taken from a completed cable, at a specified frequency so as to verify that the finished product meets the design specification."

**Type tests#** - "tests made by a manufacturer before supplying commercially a type of cable in order to demonstrate satisfactory performance characteristics to meet the intended application. These tests are of such a nature that, after they have been made, they need not be repeated unless changes are made in the cable materials, design, or method of manufacture, which might change the performance characteristics."

\* All routine and sample tests are performed in the factory.

# Type tests are carried out within the Nexans group, which includes a separate laboratory dedicated to EHV cable testing. The extensive facilities include high voltage test equipment which can perform partial discharge measurements at voltages up to 300 kV, high voltage break-down tests to 600 kV, cyclic ageing tests and impulse withstand tests. This allows all type tests to AS/NZS and other national standards to be performed.

<b>Tests Performed on Cables</b>		
<b>Routine Tests</b>	<b>Sample Tests</b>	<b>Type Tests</b>
Spark test on sheath.	Thicknesses of extruded components.	Insulation resistance at 20°C and 90°C.
Conductor examination and resistance.	Screen and armour wire diameters, and screen area.	Elongation at rupture of conductor screen.
Partial discharge test	Heat shock test (PVC sheaths only).	Pressure test (PVC sheaths only.)
High voltage a.c. test for 5 min.	Insulation shrinkage.	Loss of mass (PVC sheaths only).
High voltage a.c. test for 1 min on separation sheath (three core armoured cable only).	Insulation concentricity.	Volume resistivity of conductor and insulation screens
	Conductor screen projections/irregularities.	Mechanical tests (before and after ageing) of insulation and sheaths.
	Determination of voids and contaminants.	Partial discharge test after bending.
	Hot set test.	Impulse withstand test followed by high voltage a.c. test for 15 min.
	Insulation screen strip ability and adhesion.	Partial discharge test after heat cycling.
		DDF (tan $\delta$ ) as a function of temperature.
		High voltage a.c. test for 4 h.
		Compatibility test for separation sheath (if any) and over sheath.

## TEST VOLTAGE LEVELS

<b>Voltage Withstand Tests</b>				
Rated Voltage (kV)	Impulse (kV)	Type Tests		Routine Test
		High Voltage 15 min 50 Hz (after impulse test) (kV)	High Voltage 4 h 50 Hz (kV)	High Voltage 5 min 50 Hz (kV)
3.8/6.6	60	12.5	15	12.5
6.35/11	95	21	25	21
12.7/22	150	42	50	42
19/33	200	63	75	63

<b>Partial Discharge Voltage Levels</b>		
Rated Voltage (kV)	Permitted Maximum Discharge	
	20 pC at 200 percent U <sub>0</sub> (kV)	5 pC at 150 percent U <sub>0</sub> (kV)
3.8/6.6	7.6	5.7
6.35/11	13	10
12.7/22	25	19
19/33	38	29

# INSTALLATION TESTS

## General

After the cable, has been installed and prior to commencing terminating or jointing, it is desirable to carry out checks to establish that the cable has not been damaged during the installation process, namely a Sheath Integrity Test and an Insulation Resistance Test of Primary Insulation. After completion of the tests, if the terminating or jointing is not being commenced straight away, the cable ends should be resealed with heat shrinkable end caps or similar to prevent the ingress of moisture.

## Nexans New Zealand Recommendations for Tests After Complete Installation of TR-XLPE Medium Voltage Cables

### Advice Concerning Tests After Installation

If a test is carried out after installation, please note that the test is to detect defects caused during installation. After installation, the test is applied to the cable and accessories.

### High Voltage D.C. Test After Installation

The D.C. testing of the primary insulation is **NOT** recommended. There are two important reasons for **NOT** using a High Voltage DC Test.

1. The DC field in the cable and accessories applies different electric stresses (both in magnitude and in physical location) to an AC field, so much so, that it is considered to be a poor process to find faults.
2. The application of High Voltage DC leads to premature failure of aged and “wet” primary insulation. This has been proven in the Laboratory and has been proven repeatedly in the field.

### Safety Requirements

As the voltages used in these tests are potentially lethal, appropriate safety measures must be employed to ensure that the safety of all people involved in the testing process is not compromised.

Cable ends to be isolated shall be disconnected from the supply and protected from contact to supply, or ground, or accidental contact. Safety measures shall include, and shall not necessarily be limited to, earthing of cable under test prior to and after test voltages are applied, erection of safety barriers with warning signs, and an open communication channel between testing personnel.

The testing guidelines outlined in this document are Nexans recommendations only, and Nexans cannot be held responsible for ensuring the safe implementation of these recommendations.

### Sheath Integrity Test

A sheath integrity test (e.g., 1000 V minimum insulation resistance tester) applied between the outer-most metallic layer and earth can identify after-installation damage to the non-metallic outer sheath.

The measured value should be read after application of the voltage for 1 minute. Ideally the measured value should be corrected for temperature to a standard value at 20°C if correction factors are available. A rough guide is that the insulation resistance decreases to one half of the value for a 10°C rise in temperature. The cable temperature should be recorded along with the measured values.

Measured values of Insulation Resistance for the sheath should be greater than calculated values. Calculated values for new cable range from 1.5 MΩ/km to 4.0 MΩ/km @ 20°C for PVC sheaths and from 120 MΩ/km to 300 MΩ/km @ 20°C for PE sheaths. Values are highest for small cables and thick sheaths and lowest for large cables and thin sheaths (factory tests show that measured values are up to an order of magnitude greater than the calculated values).

Earth the screens after an Insulation Resistance Test on a sheath for at least 5 minutes before handling or performing other tests.

# INSTALLATION TESTS (CONT.)

## Insulation Resistance Test of Primary Insulation

DC voltages up to 5 kV, used when performing Insulation Resistance Tests on Primary Insulation, are not considered to be a "High voltage DC test".

An Insulation Resistance Test of the Primary Insulation should be carried out with an insulation resistance tester, with a minimum DC voltage of 2.5 kV for 1.9/3.3 kV cables or 5 kV for cables above 1.9/3.3 kV and up to 19/33 kV. The insulation test should be carried out in the "Guarded Mode" and the instrument should have a minimum full-scale range of 500 G $\Omega$ . Guarding should be applied at both ends and a spare core used for the connection lead to the guard at the far end. Any conductor or cable core used as a guard lead must have a resistance to ground of greater than 10 k $\Omega$ . The measured value should be read after application of the voltage for 1 minute. Ideally the measured value should be corrected for temperature to a standard value at 20°C if correction factors are available. A rough guide is that the insulation resistance decreases to one half of the value for a 10°C rise in temperature. The cable temperature should be recorded along with the measured values.

Measured values of insulation resistance for the primary insulation should be greater than calculated values. Calculated values for new cable range from 2,400 M $\Omega$ /km to 18,000 M $\Omega$ /km at 20°C. Values are highest for small conductors and higher voltages and lowest for large conductors and lower voltages (factory tests show that measured values are up to an order of magnitude greater than the calculated values).

This test should be performed prior to any high voltage tests. Short the conductors to the screens after an Insulation Resistance Test on Primary Insulation for at least 10 minutes before handling or performing other tests.

If the instrument used for the above insulation resistance testing is a "Megger," Type BM 25, or equivalent, then the two following tests should be considered.

1. A 10-minute Polarisation Index Test - this test is commonly used as a replacement for the standard insulation resistance test.
2. A 5 Minute Step Voltage Test - the test should use five equal steps up to the maximum test voltage of 2.5 kV for 1.9/3.3 kV cables or 5 kV for cables greater than 1.9/3.3 kV up to 19/33 kV. This test is becoming increasingly used on cables of 6.35/11 kV and greater.

Both the above tests can be carried out automatically with the Megger, BM 25 unit and guarding should be applied at both ends as above.



## INSTALLATION TESTS (CONT.)

### High Voltage A.C. Test After Installation

An A.C. voltage test at power frequency should be applied for 24 hours with the normal operating voltage of the system to the primary insulation.

Some customers have objected to a 24-hour test at only the operating voltage of the cable and would prefer a test using a higher voltage for a shorter time. This can be achieved by a Very Low Frequency (VLF) HV AC Test, and the equipment now exists for hire in New Zealand to perform this. The VLF HV AC Test is becoming recognised throughout the world as a replacement test for the old HV DC Test or the 24-hour AC test at normal operating voltage, although not many standards have details in them at this point in time. VLF Tests are carried out at a frequency in the band of 0.1 to 0.02 Hz. The VLF Test Set must be of adequate power to test the measured cable capacitance at the frequency chosen. The suggested maximum VLF test voltage for new cable is between 2.7 and 3.0 times the cable operating voltage ( $U_0$ ), for a minimum of 15 minutes. Where possible, a 30-minute testing time is now recommended as international research has shown this to give a higher confidence. Refer to the test procedure of IEEE-400-2.

For existing or aged cables being recommissioned after repair or alterations, the VLF Test Voltage should be a maximum of 2.3 times the cable operating voltage ( $U_0$ ), for 15 minutes.

### Documentation

The values obtained in the above tests should be recorded in a cable log so that they are available for comparison purposes in the future.

# CURRENT RATINGS

The continuous current ratings given in this publication have been calculated in accordance with the International Electrotechnical Commission Publication No. IEC 60287 - "Calculation of the Continuous Current Rating of Cables (100% Load factor)", based on the following environmental conditions: Ambient Air Temperature, 30°C; Ambient Soil Temperature, 15°C; Soil Thermal Resistivity, 1.2 Km/W; Depth of burial, 1.0 m; and Screens bonded both ends.

In all cases, the ratings given are the single circuit ratings corresponding to continuous loading at the maximum conductor temperature of 90°C. Where the conditions vary from those on which the ratings are based, rating factors from Tables 4.1 to 4.4 (Section 4 Medium Voltage TR-XLPE Cables) need to be applied.

## Methods of Installation

The methods of installation for which the ratings are applicable are shown graphically in Figure 2.1 (Section 2 General Technical Information).

## Groups of Circuits

For groups of circuits unenclosed in air, the spacings and arrangements which need to be maintained to prevent derating are given in Figure 2.2 (Section 2 General Technical Information).

Where a number of circuits are installed in close proximity in such a way that they are not thermally independent, the appropriate rating factors from Tables 4.5, 4.6, (Section 4 Medium Voltage TR-XLPE Cables) and 2.1, 2.2 (Section 2 General Technical Information) need to be applied.

## Cables in Parallel

For cables operated in parallel, each parallel leg is regarded as a separate circuit for current rating purposes and the appropriate rating factors for grouping are applicable. Refer also to Figure 2.3 (Section 2 General Technical Information) for the arrangements of single core cables so as to ensure equal current sharing between parallel legs of the same phase.

## Bonding of Screens

The current ratings given for single core cables assume that the copper wire screens are solidly bonded to earth at both ends. Solid bonding can result in a reduction in current ratings on larger cables due to the heating effect of circulating currents induced in the screen. This loss can be minimised, either in short runs of cable, by earthing at one end only (single point bonding) which results in a standing voltage proportional to the conductor current and the length of run being induced on the screen and in long runs of cable, by dividing the route into tri-sections and transposing or "cross bonding" the screens at every joint position in a tri-section so that the e.m.f.'s induced by the three phases cancel one another.

When these methods of bonding are employed, higher current ratings may be used, however attention must be paid to the safety aspects with respect to the induced standing voltages. This places a limitation on the length of circuit for which single point bonding can be used.

Generally, it is only considered practical to use special cross-bonding arrangements on transmission class cables (66 kV and above) as the benefits of the higher current ratings are outweighed by the costs of the extra equipment required.

## Emergency Ratings

TR-XLPE insulated cables can operate under emergency conditions with a conductor temperature of 130°C for periods of up to 36 hours, not more than three times per year. In practice, however, due to the difficulty in ensuring compatibility with terminations and the high-volume expansion of TR-XLPE above 100°C, a limit of 105°C for emergency rating is specified in AS/NZS 1429.1. The 105°C emergency limit represents the following approximate percentage increase over the normal continuous ratings:

Cables in air: +12%

Cables in ground (laid direct or in ducts): +9%.

## MEDIUM VOLTAGE RATING FACTORS





**Table 4.1 Air Temperature Variation**

	Air Temperature (°C)									
	15	20	25	30	35	40	45	50	55	60
Rating Factor	1.12	1.08	1.04	1.00	0.96	0.91	0.87	0.82	0.76	0.71





**Table 4.2 Soil Temperature Variation**

	Soil Temperature (°C)									
	0	5	10	15	20	25	30	35	40	45
Rating Factor	1.10	1.06	1.03	1.00	0.97	0.93	0.89	0.86	0.82	0.77

**Table 4.3 Depth of Burial Variation**

Depth of Burial (m)				
	Up to 300 mm <sup>2</sup>	Over 300 mm <sup>2</sup>		
0.8	1.02	1.03	1.01	1.01
1.0	1.00	1.0	1.00	1.00
1.25	0.98	0.98	0.98	0.98
1.5	0.97	0.96	0.96	0.97
1.75	0.96	0.94	0.95	0.97
2.0	0.94	0.92	0.94	0.96
2.5	0.93	0.91	0.92	0.95
3.0 (or more)	0.92	0.89	0.90	0.94

**Table 4.4 Soil Thermal Resistivity Variation**

Soil Thermal Resistivity (K.m/W)				
0.8	1.16	1.12	1.09	1.07
0.9	1.11	1.09	1.06	1.05
1.0	1.07	1.06	1.04	1.03
1.2	1.00	1.00	1.00	1.00
1.5	0.90	0.92	0.93	0.95
2.0	0.79	0.82	0.85	0.87
2.5	0.71	0.75	0.78	0.82
3.0	0.65	0.69	0.73	0.77

# MEDIUM VOLTAGE RATING FACTORS (CONT.)

**Table 4.5 Groups of Circuits Laid Direct**

No. of Circuits	Single Core Cables						Multicore Cables				
	Touching		Spacing (m)				Touching	Spacing (m)			
Trefoil	Flat	0.15	0.30	0.45	0.60	0.15		0.30	0.45	0.60	
2	0.78	0.80	0.82	0.86	0.89	0.91	0.80	0.85	0.89	0.91	0.93
3	0.66	0.68	0.71	0.77	0.80	0.83	0.68	0.76	0.81	0.84	0.87
4	0.59	0.62	0.65	0.72	0.77	0.80	0.62	0.71	0.77	0.81	0.84
5	0.55	0.58	0.61	0.68	0.74	0.78	0.57	0.66	0.73	0.78	0.82
6	0.52	0.55	0.58	0.66	0.72	0.76	0.54	0.64	0.71	0.77	0.81
7	0.49	0.52	0.56	0.64	0.70	0.75	0.51	0.61	0.69	0.75	0.79
8	0.47	0.50	0.54	0.63	0.69	0.74	0.49	0.59	0.68	0.74	0.79
9	0.45	0.48	0.52	0.61	0.68	0.74	0.47	0.58	0.67	0.73	0.78
10	0.44	0.47	0.51	0.61	0.68	0.73	0.45	0.57	0.66	0.73	0.78
11	0.43	0.46	0.50	0.60	0.67	0.73	0.44	0.55	0.65	0.72	0.77
12	0.41	0.45	0.49	0.59	0.67	0.72	0.43	0.54	0.64	0.72	0.77

**Table 4.6 Groups of Circuits In Underground Ducts**

No. of Circuits	Multicore Cables in Single-way Ducts or Single Core Cables in Multiway Ducts				Single Core Cables in Single-way Ducts		
	Touching	Spacing (m)			Touching	Spacing (m)	
0.30		0.45	0.60	0.45		0.60	
2	0.88	0.91	0.93	0.94	0.85	0.88	0.90
3	0.80	0.85	0.88	0.90	0.75	0.80	0.83
4	0.76	0.81	0.85	0.88	0.70	0.77	0.80
5	0.72	0.78	0.83	0.86	0.67	0.74	0.78
6	0.69	0.76	0.81	0.85	0.64	0.72	0.76
7	0.67	0.75	0.80	0.84	0.62	0.70	0.75
8	0.65	0.74	0.79	0.83	0.61	0.69	0.74
9	0.63	0.72	0.78	0.83	0.59	0.68	0.73
10	0.62	0.72	0.78	0.82	0.58	0.67	0.73
11	0.61	0.71	0.77	0.82	0.57	0.67	0.72
12	0.60	0.70	0.77	0.81	0.57	0.66	0.72

# NOTES

# SINGLE CORE CU 11 KV CABLES

## 3 kA for 1 s Wire Screens

Copper conductor  
 SCXLPE conductor screen  
 TR-XLPE insulation  
 SCXLPE insulation screen  
 Copper wire screen  
 PVC/HDPE sheath

} Triple extruded, Dry-cure

<b>Product Sheet No. 231-13 A</b>							
Conductor Size (mm <sup>2</sup> )	Nominal Diameters		Wire Screen		Thickness of Sheath PVC/HDPE (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
	Insulation (mm)	Insulation Screen (mm)	Area (mm <sup>2</sup> )	No. & Size (No. x mm)			
16 *	12.5	14.1	16	28 x 0.85	1.0 / 1.0	20.3	0.58
25	13.7	15.3	20	36 x 0.85	1.0 / 1.0	21.5	0.73
35	14.7	16.3	20	36 x 0.85	1.0 / 1.0	22.5	0.84
50	16.0	17.6	20	36 x 0.85	1.0 / 1.0	23.8	0.98
70	17.4	19.0	20	36 x 0.85	1.0 / 1.0	25.2	1.21
95	19.1	20.7	20	36 x 0.85	1.0 / 1.0	26.9	1.48
120	20.5	22.1	20	36 x 0.85	1.0 / 1.0	28.3	1.74
150	21.9	23.5	20	36 x 0.85	1.0 / 1.0	29.7	2.02
185	23.7	25.3	20	36 x 0.85	1.0 / 1.0	31.5	2.40
240	25.9	27.5	20	36 x 0.85	1.0 / 1.0	33.7	2.98
300	28.2	29.8	20	36 x 0.85	1.0 / 1.1	36.2	3.60
400	31.5	33.1	20	36 x 0.85	1.1 / 1.1	39.7	4.48
500	34.9	36.5	20	36 x 0.85	1.1 / 1.2	43.3	5.50
630	38.5	40.1	20	36 x 0.85	1.2 / 1.2	47.1	6.90

**Issue: June 2019**  
**6.35/11 (12) kV. Made to AS/NZS 1429.1**

\* Short circuit rating less than 3 kA for 1 s




Note: Subject to confirmation, similar cables can be manufactured to other specifications.

# SINGLE CORE CU 11 KV CABLES

## 3 kA for 1 s Wire Screens

Copper conductor  
 SCXLPE conductor screen  
 TR-XLPE insulation  
 SCXLPE insulation screen  
 Copper wire screen  
 PVC/HDPE sheath

} Triple extruded, Dry-cure

Product Sheet No. 231-13 B							
Conductor Size (mm <sup>2</sup> )	Conductor AC Resistance at 50 Hz and 90°C (Ohm/km)	Inductive Reactance at 50 Hz (Ohm/km)	Conductor to Screen Capacitance (μF/km)	Nominal PVC Duct Size (Multi Way) (mm)	Current Ratings (A)		
							
16 *	1.47	0.154	0.18	65	125	120	101
25	0.927	0.144	0.21	65	163	154	129
35	0.668	0.137	0.23	65	197	183	153
50	0.494	0.130	0.26	65	237	216	181
70	0.342	0.121	0.29	80 (NZ)	294	263	221
95	0.247	0.115	0.33	80 (NZ)	359	313	264
120	0.196	0.111	0.36	100 (NZ)	413	355	305
150	0.159	0.107	0.39	100 (NZ)	470	397	341
185	0.128	0.103	0.43	100 (NZ)	539	447	384
240	0.0981	0.099	0.47	100 (NZ)	636	516	443
300	0.0791	0.096	0.52	150	730	579	509
400	0.0632	0.093	0.59	150	847	655	575
500	0.0510	0.090	0.66	150	978	737	647
630	0.0416	0.087	0.74	150	1122	823	722

**Issue: June 2019**  
**6.35/11 (12) kV. Made to AS/NZS 1429.1**

\* Short circuit rating less than 3 kA for 1 s

Note: The values in this table are for installation conditions of:

Ambient Air Temperature 30 °C  
 Soil Temperature 15 °C  
 Soil Thermal Resistivity 1.2 K.m/W  
 Depth of Burial 1.0 m  
 Screens bonded both ends

# SINGLE CORE CU 11 KV CABLES

## 10 kA for 1 s Wire Screens

Copper conductor

SCXLPE conductor screen

TR-XLPE insulation

SCXLPE insulation screen

} Triple extruded, Dry-cure

Copper wire screen

PVC/HDPE sheath

### Product Sheet No. 231-14 A

Conductor Size (mm <sup>2</sup> )	Nominal Diameters		Wire Screen		Thickness of Sheath PVC/HDPE (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
	Insulation (mm)	Insulation Screen (mm)	Area (mm <sup>2</sup> )	No. & Size (No. x mm)			
25 *	13.7	15.3	24	29 x 1.03	1.0 / 1.0	21.9	0.77
35 *	14.7	16.3	34	24 x 1.35	1.0 / 1.0	23.5	0.98
50 *	16.0	17.6	49	22 x 1.69	1.0 / 1.0	25.5	1.26
70	17.4	19.0	70	31 x 1.69	1.0 / 1.0	26.9	1.68
95	19.1	20.7	70	31 x 1.69	1.0 / 1.0	28.6	1.95
120	20.5	22.1	69	48 x 1.35	1.0 / 1.0	29.3	2.20
150	21.9	23.5	69	48 x 1.35	1.0 / 1.0	30.7	2.48
185	23.7	25.3	69	48 x 1.35	1.0 / 1.0	32.5	2.86
240	25.9	27.5	69	48 x 1.35	1.0 / 1.0	34.7	3.44
300	28.2	29.8	69	48 x 1.35	1.0 / 1.1	37.2	4.06
400	31.5	33.1	69	48 x 1.35	1.1 / 1.1	40.7	4.94
500	34.9	36.5	69	48 x 1.35	1.1 / 1.2	44.3	5.95
630	38.5	40.1	69	48 x 1.35	1.2 / 1.2	48.1	7.35

Issue: June 2019

6.35/11 (12) kV. Made to AS/NZS 1429.1

\* Short circuit rating less than 10 kA for 1 s

Note: Subject to confirmation, similar cables can be manufactured to other specifications.



# SINGLE CORE CU 11 KV CABLES

## 10 kA for 1 s Wire Screens

Copper conductor

SCXLPE conductor screen




TR-XLPE insulation

SCXLPE insulation screen

} Triple extruded, Dry-cure

Copper wire screen

PVC/HDPE sheath

Product Sheet No. 231-14 B							
Conductor Size (mm <sup>2</sup> )	Conductor AC Resistance at 50 Hz and 90°C (Ohm/km)	Inductive Reactance at 50 Hz (Ohm/km)	Conductor to Screen Capacitance (μF/km)	Nominal PVC Duct Size (Multi Way) (mm)	Current Ratings (A)		
							
25 *	0.927	0.145	0.21	65	164	154	129
35 *	0.668	0.140	0.23	65	200	184	154
50 *	0.494	0.134	0.26	80 (NZ)	242	217	183
70	0.342	0.125	0.29	80 (NZ)	298	262	221
95	0.247	0.119	0.33	100 (NZ)	362	311	267
120	0.196	0.113	0.36	100 (NZ)	413	351	301
150	0.159	0.109	0.39	100 (NZ)	467	391	336
185	0.128	0.105	0.43	100 (NZ)	535	439	377
240	0.0980	0.101	0.47	100 (NZ)	627	503	432
300	0.0791	0.098	0.52	150	715	561	493
400	0.0631	0.094	0.59	150	823	630	553
500	0.0509	0.091	0.66	150	943	702	616
630	0.0415	0.088	0.74	150	1072	777	681

**Issue: June 2019**  
**6.35/11 (12) kV. Made to AS/NZS 1429.1**

\* Short circuit rating less than 10 kA for 1 s

Note: The values in this table are for installation conditions of:

Ambient Air Temperature 30 °C

Soil Temperature 15 °C

Soil Thermal Resistivity 1.2 K.m/W

Depth of Burial 1.0 m

Screens bonded both ends

# SINGLE CORE AL 11 KV CABLES

## 3 kA for 1 s Wire Screens

Aluminium conductor

SCXLPE conductor screen

TR-XLPE insulation

SCXLPE insulation screen

} Triple extruded, Dry-cure

Copper wire screen

PVC/HDPE sheath

### Product Sheet No. 231-23 A

Conductor Size (mm <sup>2</sup> )	Nominal Diameters		Wire Screen		Thickness of Sheath PVC/HDPE (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
	Insulation (mm)	Insulation Screen (mm)	Area (mm <sup>2</sup> )	No. & Size (No. x mm)			
25 *	13.7	15.3	16	28 x 0.85	1.0 / 1.0	21.5	0.53
35 ^	14.6	16.2	20	36 x 0.85	1.0 / 1.0	22.4	0.62
50	15.9	17.5	20	36 x 0.85	1.0 / 1.0	23.7	0.68
70	17.4	19.0	20	36 x 0.85	1.0 / 1.0	25.2	0.78
95 ^	19.1	20.7	20	36 x 0.85	1.0 / 1.0	26.9	0.89
120	20.5	22.1	20	36 x 0.85	1.0 / 1.0	28.3	0.99
150	21.9	23.5	20	36 x 0.85	1.0 / 1.0	29.7	1.09
185 ^	23.6	25.2	20	36 x 0.85	1.0 / 1.0	31.4	1.24
240 ^	25.8	27.4	20	36 x 0.85	1.0 / 1.0	33.6	1.45
300 ^	28.0	29.6	20	36 x 0.85	1.0 / 1.1	36.0	1.68
400	31.1	32.7	20	36 x 0.85	1.1 / 1.1	39.3	2.02
500	34.2	35.8	20	36 x 0.85	1.1 / 1.2	42.6	2.39
630	37.8	39.4	20	36 x 0.85	1.2 / 1.2	46.4	2.89
800	42.4	44.0	20	36 x 0.85	1.2 / 1.3	51.3	3.51
1000	46.3	47.9	20	36 x 0.85	1.2 / 1.3	55.4	4.22

Issue: June 2019

6.35/11 (12) kV. Made to AS/NZS 1429.1

\* Short circuit rating less than 3 kA for 1 s

^ Also complies with AS/NZS 4026




Note: Subject to confirmation, similar cables can be manufactured to other specifications.

# SINGLE CORE AL 11 KV CABLES

## 3 kA for 1 s Wire Screens

Aluminium conductor  
 SCXLPE conductor screen  
 TR-XLPE insulation  
 SCXLPE insulation screen  
 Copper wire screen  
 PVC/HDPE sheath

} Triple extruded, Dry-cure

Product Sheet No. 231-23 B							
Conductor Size (mm <sup>2</sup> )	Conductor AC Resistance at 50 Hz and 90°C (Ohm/km)	Inductive Reactance at 50 Hz (Ohm/km)	Conductor to Screen Capacitance (µF/km)	Nominal PVC Duct Size (Multi Way) (mm)	Current Ratings (A)		
							
25 *	1.54	0.144	0.21	65	127	119	100
35 ^	1.113	0.138	0.23	65	153	142	119
50	0.822	0.130	0.26	65	184	167	140
70	0.568	0.121	0.29	80 (NZ)	229	204	172
95 ^	0.411	0.115	0.33	80 (NZ)	279	243	205
120	0.325	0.111	0.36	100 (NZ)	322	276	237
150	0.265	0.107	0.39	100 (NZ)	365	309	265
185 ^	0.211	0.103	0.42	100 (NZ)	421	349	300
240 ^	0.161	0.099	0.47	100 (NZ)	497	404	347
300 ^	0.130	0.096	0.52	150	572	455	399
400	0.102	0.093	0.58	150	669	519	456
500	0.0803	0.090	0.65	150	779	590	518
630	0.0638	0.088	0.72	150	907	669	587
800	0.0518	0.085	0.82	200	1050	752	687
1000	0.0432	0.083	0.90	200	1187	830	758

**Issue: June 2019**  
**6.35/11 (12) kV. Made to AS/NZS 1429.1**

\* Short circuit rating less than 3 kA for 1 s

^ Also complies with AS/NZS 4026

Note: The values in this table are for installation conditions of:

- Ambient Air Temperature 30 °C
- Soil Temperature 15 °C
- Soil Thermal Resistivity 1.2 K.m/W
- Depth of Burial 1.0 m
- Screens bonded both ends

# SINGLE CORE AL 11 KV CABLES

## 10 kA for 1 s Wire Screens

Aluminium conductor

SCXLPE conductor screen

TR-XLPE insulation

SCXLPE insulation screen

} Triple extruded, Dry-cure

Copper wire screen

PVC/HDPE sheath

### Product Sheet No. 231-24 A

Conductor Size (mm <sup>2</sup> )	Nominal Diameters		Wire Screen		Thickness of Sheath PVC/HDPE (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
	Insulation (mm)	Insulation Screen (mm)	Area (mm <sup>2</sup> )	No. & Size (No. x mm)			
35 *	14.6	16.2	23	40 x 0.85	1.0 / 1.0	22.4	0.64
50 *	15.9	17.5	33	39 x 1.03	1.0 / 1.0	24.1	0.80
70 *	17.4	19.0	45	54 x 1.03	1.0 / 1.0	25.6	1.00
95 *	19.1	20.7	62	43 x 1.35	1.0 / 1.0	27.9	1.28
120	20.5	22.1	69	48 x 1.35	1.0 / 1.0	29.3	1.45
150	21.9	23.5	69	48 x 1.35	1.0 / 1.0	30.7	1.55
185 ^	23.6	25.2	69	48 x 1.35	1.0 / 1.0	32.4	1.69
240 ^	25.8	27.4	69	48 x 1.35	1.0 / 1.0	34.6	1.90
300 ^	28.0	29.6	69	48 x 1.35	1.0 / 1.1	37.0	2.14
400	31.1	32.7	69	48 x 1.35	1.1 / 1.1	40.3	2.48
500	34.2	35.8	69	48 x 1.35	1.1 / 1.2	43.6	2.85
630	37.8	39.4	69	48 x 1.35	1.2 / 1.2	47.4	3.35
800	42.4	44.0	69	48 x 1.35	1.2 / 1.3	52.3	3.97
1000	46.3	47.9	69	48 x 1.35	1.3 / 1.4	56.6	4.70

Issue: June 2019

6.35/11 (12) kV. Made to AS/NZS 1429.1

\* Short circuit rating less than 10 kA for 1 s

^ Also complies with AS/NZS 4026




Note: Subject to confirmation, similar cables can be manufactured to other specifications.

# SINGLE CORE AL 11 KV CABLES

## 10 kA for 1 s Wire Screens

Aluminium conductor  
 SCXLPE conductor screen  
 TR-XLPE insulation  
 SCXLPE insulation screen  
 Copper wire screen  
 PVC/HDPE sheath

} Triple extruded, Dry-cure

Product Sheet No. 231-24 B							
Conductor Size (mm <sup>2</sup> )	Conductor AC Resistance at 50 Hz and 90°C (Ohm/km)	Inductive Reactance at 50 Hz (Ohm/km)	Conductor to Screen Capacitance (μF/km)	Nominal PVC Duct Size (Multi Way) (mm)	Current Ratings (A)		
							
35 *	1.113	0.138	0.23	65	153	142	119
50 *	0.822	0.131	0.26	80 (NZ)	185	168	141
70 *	0.568	0.122	0.29	80 (NZ)	229	204	172
95 *	0.411	0.117	0.33	80 (NZ)	281	243	205
120	0.325	0.113	0.36	100 (NZ)	323	275	236
150	0.265	0.109	0.39	100 (NZ)	366	307	263
185 ^	0.211	0.105	0.42	100 (NZ)	420	346	297
240 ^	0.161	0.101	0.47	100 (NZ)	495	398	342
300 ^	0.130	0.098	0.52	150	566	446	392
400	0.102	0.095	0.58	150	659	507	445
500	0.0802	0.092	0.65	150	763	572	502
630	0.0637	0.089	0.72	150	881	644	565
800	0.0517	0.086	0.82	200	1013	718	656
1000	0.0430	0.084	0.90	200	1136	786	718

**Issue: June 2019**  
**6.35/11 (12) kV. Made to AS/NZS 1429.1**

\* Short circuit rating less than 10 kA for 1 s

^ Also complies with AS/NZS 4026

Note: The values in this table are for installation conditions of:

Ambient Air Temperature 30 °C  
 Soil Temperature 15 °C  
 Soil Thermal Resistivity 1.2 K.m/W  
 Depth of Burial 1.0 m  
 Screens bonded both ends

# THREE CORE CU 11 KV CABLES

## 3 kA for 1 s Wire Screens

Copper conductor  
 SCXLPE conductor screen  
 TR-XLPE insulation  
 SCXLPE insulation screen  
 Copper wire screens  
 PVC/HDPE sheath

} Triple extruded, Dry-cure

<b>Product Sheet No. 233-13 A</b>							
Conductor Size (mm <sup>2</sup> )	Nominal Diameters		Wire Screen (Per Core)		Thickness of Sheath PVC/HDPE (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
	Insulation (mm)	Insulation Screen (mm)	Area (mm <sup>2</sup> )	No. & Size (No. x mm)			
16 *	12.5	14.1	5.7	10 x 0.85	1.1 / 1.1	39.0	1.46
25	13.7	15.3	6.8	12 x 0.85	1.1 / 1.2	41.8	1.86
35	14.7	16.3	6.8	12 x 0.85	1.1 / 1.2	43.9	2.20
50	16.0	17.6	6.8	12 x 0.85	1.2 / 1.2	46.9	2.67
70	17.4	19.0	7.4	13 x 0.85	1.3 / 1.3	50.4	3.42
95	19.1	20.7	7.9	14 x 0.85	1.3 / 1.4	54.2	4.32
120	20.5	22.1	8.5	15 x 0.85	1.4 / 1.4	57.8	5.20
150	21.9	23.5	8.5	15 x 0.85	1.4 / 1.5	61.0	6.10
185	23.7	25.3	9.6	17 x 0.85	1.5 / 1.5	65.1	7.35
240	25.9	27.5	10.2	18 x 0.85	1.6 / 1.6	70.2	9.20
300	28.2	29.8	11.3	20 x 0.85	1.6 / 1.7	75.4	11.20
400	31.5	33.1	11.9	21 x 0.85	1.8 / 1.8	83.2	14.00

**Issue: June 2019**  
**6.35/11 (12) kV. Made to AS/NZS 1429.1**




\* Short circuit rating less than 3 kA for 1 s

Note: Subject to confirmation, similar cables can be manufactured to other specifications.

# THREE CORE CU 11 KV CABLES

## 3 kA for 1 s Wire Screens

Copper conductor  
 SCXLPE conductor screen }  
 TR-XLPE insulation } Triple extruded, Dry-cure  
 SCXLPE insulation screen }  
 Copper wire screens  
 PVC/HDPE sheath

<b>Product Sheet No. 233-13 B</b>							
Conductor Size (mm <sup>2</sup> )	Conductor AC Resistance at 50 Hz and 90°C (Ohm/km)	Inductive Reactance at 50 Hz (Ohm/km)	Conductor to Screen Capacitance (μF/km)	Nominal PVC Duct Size (Single Way) (mm)	Current Ratings (A)		
							
16 *	1.47	0.141	0.18	65	111	112	93
25	0.927	0.132	0.21	65	145	143	119
35	0.668	0.126	0.23	65	175	171	143
50	0.494	0.119	0.26	65	210	202	168
70	0.342	0.111	0.29	80 (NZ)	259	246	206
95	0.247	0.105	0.33	80 (NZ)	315	294	246
120	0.196	0.102	0.36	100 (NZ)	360	333	284
150	0.159	0.099	0.39	100 (NZ)	408	373	318
185	0.128	0.095	0.43	100 (NZ)	466	421	358
240	0.0984	0.091	0.47	100 (NZ)	545	486	414
300	0.0796	0.089	0.52	150	622	547	474
400	0.0638	0.086	0.59	150	713	618	536

**Issue: June 2019**  
**6.35/11 (12) kV. Made to AS/NZS 1429.1**

\* Short circuit rating less than 3 kA for 1 s

Note: The values in this table are for installation conditions of:

Ambient Air Temperature 30 °C  
 Soil Temperature 15 °C  
 Soil Thermal Resistivity 1.2 K.m/W  
 Depth of Burial 1.0 m

# THREE CORE CU 11 KV CABLES

## 10 kA for 1 s Wire Screens

Copper conductor

SCXLPE conductor screen

TR-XLPE insulation

SCXLPE insulation screen

Copper wire screens

PVC/HDPE sheath

} Triple extruded, Dry-cure

### Product Sheet No. 233-14 A

Conductor Size (mm <sup>2</sup> )	Nominal Diameters		Wire Screens (per core)		Thickness of Sheath PVC/HDPE (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
	Insulation (mm)	Insulation Screen (mm)	Area (mm <sup>2</sup> )	No. & Size (No. x mm)			
35 *	14.7	16.3	11.3	20 x 0.85	1.2 / 1.2	44.1	2.35
50 *	16.0	17.6	16.5	29 x 0.85	1.2 / 1.3	47.1	2.95
70	17.4	19.0	22.7	40 x 0.85	1.3 / 1.3	50.4	3.85
95	19.1	20.7	22.7	40 x 0.85	1.3 / 1.4	54.2	4.74
120	20.5	22.1	22.7	40 x 0.85	1.4 / 1.4	57.8	5.60
150	21.9	23.5	22.7	40 x 0.85	1.4 / 1.5	61.0	6.50
185	23.7	25.3	22.7	40 x 0.85	1.5 / 1.5	65.1	7.70
240	25.9	27.5	22.7	40 x 0.85	1.6 / 1.6	70.2	9.55
300	28.2	29.8	22.7	40 x 0.85	1.6 / 1.7	75.4	11.50
400	31.5	33.1	22.7	40 x 0.85	1.8 / 1.8	83.2	14.35

Issue: June 2019

6.35/11 (12) kV. Made to AS/NZS 1429.1

\* Short circuit rating less than 10 kA for 1 s

Note: Subject to confirmation, similar cables can be manufactured to other specifications.






# THREE CORE CU 11 KV CABLES

## 10 kA for 1 s Wire Screens

Copper conductor  
 SCXLPE conductor screen  
 TR-XLPE insulation  
 SCXLPE insulation screen  
 Copper wire screens  
 PVC/HDPE sheath

} Triple extruded, Dry-cure

<b>Product Sheet No. 233-14 B</b>							
Conductor Size (mm <sup>2</sup> )	Conductor AC Resistance at 50 Hz and 90°C (Ohm/km)	Inductive Reactance at 50 Hz (Ohm/km)	Conductor to Screen Capacitance (μF/km)	Nominal PVC Duct Size (Single Way) (mm)	Current Ratings (A)		
							
35 *	0.668	0.126	0.23	65	175	171	143
50 *	0.494	0.119	0.26	80 (NZ)	210	202	169
70	0.342	0.111	0.29	80 (NZ)	259	246	206
95	0.247	0.105	0.33	80 (NZ)	315	294	246
120	0.196	0.102	0.36	100 (NZ)	360	333	284
150	0.159	0.099	0.39	100 (NZ)	408	373	318
185	0.128	0.095	0.43	100 (NZ)	466	421	358
240	0.0984	0.091	0.47	100 (NZ)	545	486	414
300	0.0796	0.089	0.52	150	622	547	474
400	0.0638	0.086	0.59	150	713	618	536

**Issue: June 2019**  
**6.35/11 (12) kV. Made to AS/NZS 1429.1**

\* Short circuit rating less than 10 kA for 1 s

Note: The values in this table are for installation conditions of:

Ambient Air Temperature    30 °C  
 Soil Temperature            15 °C  
 Soil Thermal Resistivity    1.2 K.m/W  
 Depth of Burial              1.0 m

# THREE CORE AL 11 KV CABLES

## 3 kA for 1 s Wire Screens

Aluminium conductor

SCXLPE conductor screen

TR-XLPE insulation

SCXLPE insulation screen

} Triple extruded, Dry-cure

Copper wire screens

PVC/HDPE sheath

### Product Sheet No. 233-23 A

Conductor Size (mm <sup>2</sup> )	Nominal Diameters		Wire Screens (per core)		Thickness of Sheath PVC/HDPE (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
	Insulation (mm)	Insulation Screen (mm)	Area (mm <sup>2</sup> )	No. & Size (No. x mm)			
25 *	13.7	15.3	5.7	10 x 0.85	1.1 / 1.1	41.6	1.33
35 ^	14.6	16.2	6.8	12 x 0.85	1.1 / 1.2	43.7	1.52
50	15.9	17.5	6.8	12 x 0.85	1.2 / 1.2	46.7	1.75
70	17.4	19.0	7.4	13 x 0.85	1.3 / 1.3	50.4	2.11
95 ^	19.1	20.7	7.9	14 x 0.85	1.3 / 1.4	54.2	2.51
120	20.5	22.1	8.5	15 x 0.85	1.4 / 1.4	57.5	2.89
150	21.9	23.5	8.5	15 x 0.85	1.4 / 1.5	60.7	3.26
185 ^	23.6	25.2	9.6	17 x 0.85	1.5 / 1.5	64.6	3.79
240 ^	25.8	27.4	10.2	18 x 0.85	1.6 / 1.6	69.7	4.56
300 ^	28.0	29.6	10.8	19 x 0.85	1.6 / 1.7	74.7	5.35
400	31.1	32.7	11.9	21 x 0.85	1.8 / 1.8	82.3	6.55
500							

Issue: June 2019

6.35/11 (12) kV. Made to AS/NZS 1429.1

\* Short circuit rating less than 3 kA for 1 s

^ Also complies with AS/NZS 4026




Note: Subject to confirmation, similar cables can be manufactured to other specifications.

# THREE CORE AL 11 KV CABLES

## 3 kA for 1 s Wire Screens

Aluminium conductor  
 SCXLPE conductor screen  
 TR-XLPE insulation  
 SCXLPE insulation screen  
 Copper wire screens  
 PVC/HDPE sheath

} Triple extruded, Dry-cure

Product Sheet No. 233-23 B							
Conductor Size (mm <sup>2</sup> )	Conductor AC Resistance at 50 Hz and 90°C (Ohm/km)	Inductive Reactance at 50 Hz (Ohm/km)	Conductor to Screen Capacitance (μF/km)	Nominal PVC Duct Size (Single Way) (mm)	Current Ratings (A)		
							
25 *	1.54	0.132	0.21	65	112	111	93
35 ^	1.11	0.126	0.23	65	135	133	110
50	0.822	0.120	0.26	65	162	157	130
70	0.568	0.111	0.29	80 (NZ)	201	191	160
95 ^	0.411	0.105	0.33	80 (NZ)	244	228	191
120	0.325	0.102	0.36	100 (NZ)	280	259	220
150	0.265	0.099	0.39	100 (NZ)	317	290	246
185 ^	0.211	0.095	0.42	100 (NZ)	363	328	279
240 ^	0.162	0.092	0.47	100 (NZ)	425	379	323
300 ^	0.130	0.089	0.52	150	486	428	371
400	0.102	0.087	0.58	150	562	487	423
500							

**Issue: June 2019**  
**6.35/11 (12) kV. Made to AS/NZS 1429.1**

\* Short circuit rating less than 3 kA for 1 s

^ Also complies with AS/NZS 4026

Note: The values in this table are for installation conditions of:

Ambient Air Temperature 30 °C  
 Soil Temperature 15 °C  
 Soil Thermal Resistivity 1.2 K.m/W  
 Depth of Burial 1.0 m

# THREE CORE AL 11 KV CABLES

## 10 kA for 1 s Wire Screens

Aluminium conductor

SCXLPE conductor screen

TR-XLPE insulation

SCXLPE insulation screen

} Triple extruded, Dry-cure

Copper wire screens

PVC/HDPE sheath

### Product Sheet No. 233-24 A

Conductor Size (mm <sup>2</sup> )	Nominal Diameters		Wire Screens (per core)		Thickness of Sheath PVC/HDPE (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
	Insulation (mm)	Insulation Screen (mm)	Area (mm <sup>2</sup> )	No. & Size (No. x mm)			
25 *	13.7	15.3	5.7	10 x 0.85	1.1 / 1.1	41.6	1.33
35 *	14.6	16.2	7.9	14 x 0.85	1.1 / 1.2	43.7	1.55
50 *	15.9	17.5	10.8	19 x 0.85	1.2 / 1.3	46.9	1.88
70 *	17.4	19.0	15.3	27 x 0.85	1.3 / 1.3	50.4	2.34
95 *	19.1	20.7	20.4	36 x 0.85	1.3 / 1.4	54.2	2.86
120	20.5	22.1	22.7	40 x 0.85	1.4 / 1.4	57.5	3.29
150	21.9	23.5	22.7	40 x 0.85	1.4 / 1.5	60.7	3.66
185 ^	23.6	25.2	22.7	40 x 0.85	1.5 / 1.5	64.6	4.16
240 ^	25.8	27.4	22.7	40 x 0.85	1.6 / 1.6	69.7	4.91
300 ^	28.0	29.6	22.7	40 x 0.85	1.6 / 1.7	75.0	5.65
400	31.1	32.7	22.7	40 x 0.85	1.8 / 1.8	82.3	6.85
500							

Issue: June 2019

6.35/11 (12) kV. Made to AS/NZS 1429.1

\* Short circuit rating less than 10 kA for 1 s

^ Also complies with AS/NZS 4026




Note: Subject to confirmation, similar cables can be manufactured to other specifications.

# THREE CORE AL 11 KV CABLES

## 10 kA for 1 s Wire Screens

Aluminium conductor  
 SCXLPE conductor screen  
 TR-XLPE insulation  
 SCXLPE insulation screen  
 Copper wire screens  
 PVC/HDPE sheath

} Triple extruded, Dry-cure

Product Sheet No. 233-24 B							
Conductor Size (mm <sup>2</sup> )	Conductor AC Resistance at 50 Hz and 90°C (Ohm/km)	Inductive Reactance at 50 Hz (Ohm/km)	Conductor to Screen Capacitance (μF/km)	Nominal PVC Duct Size (Single Way) (mm)	Current Ratings (A)		
							
25 *	1.54	0.132	0.21	65	112	111	93
35 *	1.11	0.126	0.23	65	135	133	110
50 *	0.822	0.120	0.26	65	162	157	130
70 *	0.568	0.111	0.29	80 (NZ)	201	191	160
95 *	0.411	0.105	0.33	80 (NZ)	244	228	191
120	0.325	0.102	0.36	100 (NZ)	280	259	220
150	0.265	0.099	0.39	100 (NZ)	317	290	246
185 ^	0.211	0.095	0.42	100 (NZ)	363	328	279
240 ^	0.162	0.092	0.47	100 (NZ)	425	379	323
300 ^	0.130	0.089	0.52	150	486	427	370
400	0.102	0.087	0.58	150	562	487	423
500							

**Issue: June 2019**  
**6.35/11 (12) kV. Made to AS/NZS 1429.1**

\* Short circuit rating less than 10 kA for 1 s

^ Also complies with AS/NZS 4026

Note: The values in this table are for installation conditions of:

Ambient Air Temperature 30 °C  
 Soil Temperature 15 °C  
 Soil Thermal Resistivity 1.2 K.m/W  
 Depth of Burial 1.0 m

# SINGLE CORE CU 22 KV CABLES

## 3 kA for 1 s Wire Screens

Copper conductor  
 SCXLPE conductor screen  
 TR-XLPE insulation  
 SCXLPE insulation screen  
 Copper wire screen  
 PVC/HDPE sheath

} Triple extruded, Dry-cure

<b>Product Sheet No. 241-13 A</b>							
Conductor Size (mm <sup>2</sup> )	Nominal Diameters		Wire Screen		Thickness of Sheath PVC/HDPE (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
	Insulation (mm)	Insulation Screen (mm)	Area (mm <sup>2</sup> )	No. & Size (No. x mm)			
35	18.5	20.1	20	36 x 0.85	1.0 / 1.0	26.3	0.98
50	19.8	21.4	20	36 x 0.85	1.0 / 1.0	27.6	1.12
70	21.2	22.8	20	36 x 0.85	1.0 / 1.0	29.0	1.35
95	22.9	24.5	20	36 x 0.85	1.0 / 1.0	30.7	1.64
120	24.3	25.9	20	36 x 0.85	1.0 / 1.0	32.1	1.91
150	25.7	27.3	20	36 x 0.85	1.0 / 1.0	33.5	2.20
185	27.5	29.1	20	36 x 0.85	1.0 / 1.1	35.5	2.60
240	29.7	31.3	20	36 x 0.85	1.0 / 1.1	37.7	3.18
300	32.0	33.6	20	36 x 0.85	1.1 / 1.1	40.2	3.83
400	35.3	36.9	20	36 x 0.85	1.1 / 1.2	43.7	4.73
500	38.7	40.3	20	36 x 0.85	1.2 / 1.2	47.3	5.75
630	42.3	43.9	20	36 x 0.85	1.2 / 1.3	51.2	7.20

**Issue: June 2019**  
**12.7/22 (24) kV. Made to AS/NZS 1429.1**




Note: Subject to confirmation, similar cables can be manufactured to other specifications.

# SINGLE CORE CU 22 KV CABLES

## 3 kA for 1 s Wire Screens

Copper conductor  
 SCXLPE conductor screen  
 TR-XLPE insulation  
 SCXLPE insulation screen  
 Copper wire screen  
 PVC/HDPE sheath

} Triple extruded, Dry-cure

<b>Product Sheet No. 241-13 B</b>							
Conductor Size (mm <sup>2</sup> )	Conductor AC Resistance at 50 Hz and 90°C (Ohm/km)	Inductive Reactance at 50 Hz (Ohm/km)	Conductor to Screen Capacitance (μF/km)	Nominal PVC Duct Size (Multi Way) (mm)	Current Ratings (A)		
							
35	0.668	0.147	0.17	80 (NZ)	202	183	156
50	0.494	0.139	0.19	80 (NZ)	242	216	183
70	0.342	0.130	0.21	100 (NZ)	299	263	227
95	0.247	0.123	0.23	100 (NZ)	365	314	271
120	0.196	0.119	0.25	100 (NZ)	419	355	307
150	0.159	0.115	0.27	100 (NZ)	476	398	343
185	0.128	0.110	0.29	100 (NZ)	546	448	386
240	0.0978	0.106	0.32	150	644	517	455
300	0.0789	0.103	0.35	150	737	581	511
400	0.0629	0.099	0.40	150	854	657	578
500	0.0505	0.095	0.44	150	986	740	651
630	0.0411	0.092	0.49	200	1132	829	758

**Issue: June 2019**  
**12.7/22 (24) kV. Made to AS/NZS 1429.1**

Note: The values in this table are for installation conditions of:

Ambient Air Temperature 30 °C  
 Soil Temperature 15 °C  
 Soil Thermal Resistivity 1.2 K.m/W  
 Depth of Burial 1.0 m  
 Screens bonded both ends

# SINGLE CORE CU 22 KV CABLES

## 10 kA for 1 s Wire Screens

Copper conductor

SCXLPE conductor screen

TR-XLPE insulation

SCXLPE insulation screen

} Triple extruded, Dry-cure

Copper wire screen

PVC/HDPE sheath

### Product Sheet No. 241-14 A

Conductor Size (mm <sup>2</sup> )	Nominal Diameters		Wire Screen		Thickness of Sheath PVC/HDPE (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
	Insulation (mm)	Insulation Screen (mm)	Area (mm <sup>2</sup> )	No. & Size (No. x mm)			
35 *	18.5	20.1	34	41 x 1.03	1.0 / 1.0	26.7	1.10
50 *	19.8	21.4	49	34 x 1.35	1.0 / 1.0	28.6	1.39
70	21.2	22.8	69	48 x 1.35	1.0 / 1.0	30.0	1.81
95	22.9	24.5	69	48 x 1.35	1.0 / 1.0	31.7	2.10
120	24.3	25.9	69	48 x 1.35	1.0 / 1.0	33.1	2.37
150	25.7	27.3	69	48 x 1.35	1.0 / 1.0	34.5	2.65
185	27.5	29.1	69	48 x 1.35	1.0 / 1.1	36.5	3.06
240	29.7	31.3	69	48 x 1.35	1.1 / 1.1	38.9	3.66
300	32.0	33.6	69	48 x 1.35	1.1 / 1.1	41.2	4.29
400	35.3	36.9	69	48 x 1.35	1.2 / 1.2	44.9	5.20
500	38.7	40.3	69	48 x 1.35	1.2 / 1.2	48.3	6.25
630	42.3	43.9	69	48 x 1.35	1.3 / 1.3	52.4	7.70

Issue: June 2019

12.7/22 (24) kV. Made to AS/NZS 1429.1

\* Short circuit rating less than 10 kA for 1 s

Note: Subject to confirmation, similar cables can be manufactured to other specifications.






# SINGLE CORE CU 22 KV CABLES

## 10 kA for 1 s Wire Screens

Copper conductor  
 SCXLPE conductor screen  
 TR-XLPE insulation  
 SCXLPE insulation screen  
 Copper wire screen  
 PVC/HDPE sheath

} Triple extruded, Dry-cure

Product Sheet No. 241-14 B							
Conductor Size (mm <sup>2</sup> )	Conductor AC Resistance at 50 Hz and 90°C (Ohm/km)	Inductive Reactance at 50 Hz (Ohm/km)	Conductor to Screen Capacitance (μF/km)	Nominal PVC Duct Size (Multi Way) (mm)	Current Ratings (A)		
							
35 *	0.668	0.148	0.17	80 (NZ)	202	183	156
50 *	0.494	0.141	0.19	100 (NZ)	244	216	187
70	0.342	0.132	0.21	100 (NZ)	301	262	226
95	0.247	0.125	0.23	100 (NZ)	365	311	269
120	0.196	0.121	0.25	100 (NZ)	419	351	303
150	0.159	0.117	0.27	100 (NZ)	474	392	338
185	0.128	0.112	0.29	150	541	440	387
240	0.0978	0.108	0.32	150	634	504	444
300	0.0788	0.104	0.35	150	722	563	496
400	0.0628	0.101	0.40	150	831	632	556
500	0.0505	0.097	0.44	150	953	707	621
630	0.0409	0.094	0.49	200	1083	783	716

**Issue: June 2019**  
**12.7/22 (24) kV. Made to AS/NZS 1429.1**

\* Short circuit rating less than 10 kA for 1 s

Note: The values in this table are for installation conditions of:

Ambient Air Temperature 30 °C  
 Soil Temperature 15 °C  
 Soil Thermal Resistivity 1.2 K.m/W  
 Depth of Burial 1.0 m  
 Screens bonded both ends

# SINGLE CORE AL 22 KV CABLES

## 3 kA for 1 s Wire Screens

Aluminium conductor

SCXLPE conductor screen

TR-XLPE insulation

SCXLPE insulation screen

} Triple extruded, Dry-cure

Copper wire screen

PVC/HDPE sheath

### Product Sheet No. 241-23 A

Conductor Size (mm <sup>2</sup> )	Nominal Diameters		Wire Screen		Thickness of Sheath PVC/HDPE (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
	Insulation (mm)	Insulation Screen (mm)	Area (mm <sup>2</sup> )	No. & Size (No. x mm)			
35 ^	18.4	20.0	20	36 x 0.85	1.0 / 1.0	26.2	0.75
50	19.7	21.3	20	36 x 0.85	1.0 / 1.0	27.5	0.82
70	21.2	22.8	20	36 x 0.85	1.0 / 1.0	29.0	0.92
95 ^	22.9	24.5	20	36 x 0.85	1.0 / 1.0	30.7	1.04
120	24.3	25.9	20	36 x 0.85	1.0 / 1.0	32.1	1.15
150	25.7	27.3	20	36 x 0.85	1.0 / 1.0	33.5	1.27
185 ^	27.4	29.0	20	36 x 0.85	1.0 / 1.1	35.4	1.43
240 ^	29.6	31.2	20	36 x 0.85	1.0 / 1.1	37.6	1.65
300 ^	31.8	33.4	20	36 x 0.85	1.1 / 1.1	40.0	1.90
400	34.9	36.5	20	36 x 0.85	1.1 / 1.2	43.3	2.26
500	38.0	39.6	20	36 x 0.85	1.2 / 1.2	46.6	2.65
630	41.6	43.2	20	36 x 0.85	1.2 / 1.3	50.5	3.17
800	46.2	47.8	20	36 x 0.85	1.3 / 1.3	55.3	3.83
1000	50.1	51.7	20	36 x 0.85	1.4 / 1.4	59.6	4.58

Issue: June 2019

12.7/22 (24) kV. Made to AS/NZS 1429.1

^ Also complies with AS/NZS 4026




Note: Subject to confirmation, similar cables can be manufactured to other specifications.

# SINGLE CORE AL 22 KV CABLES

## 3 kA for 1 s Wire Screens

Aluminium conductor  
 SCXLPE conductor screen  
 TR-XLPE insulation  
 SCXLPE insulation screen  
 Copper wire screen  
 PVC/HDPE sheath

} Triple extruded, Dry-cure

Product Sheet No. 241-23 B							
Conductor Size (mm <sup>2</sup> )	Conductor AC Resistance at 50 Hz and 90°C (Ohm/km)	Inductive Reactance at 50 Hz (Ohm/km)	Conductor to Screen Capacitance (μF/km)	Nominal PVC Duct Size (Multi Way) (mm)	Current Ratings (A)		
							
35 ^	1.113	0.148	0.17	80 (NZ)	156	142	120
50	0.822	0.140	0.19	80 (NZ)	187	167	142
70	0.568	0.130	0.21	100 (NZ)	233	204	176
95 ^	0.411	0.123	0.23	100 (NZ)	283	244	210
120	0.325	0.119	0.25	100 (NZ)	326	277	239
150	0.265	0.115	0.27	100 (NZ)	370	309	267
185 ^	0.211	0.110	0.29	100 (NZ)	426	350	301
240 ^	0.161	0.106	0.32	150	503	404	356
300 ^	0.130	0.103	0.35	150	577	455	401
400	0.102	0.099	0.39	150	673	520	458
500	0.0800	0.096	0.43	150	783	592	520
630	0.0634	0.093	0.48	200	912	672	615
800	0.0513	0.090	0.54	200	1054	756	691
1000	0.0427	0.088	0.60	200	1192	836	763

**Issue: June 2019**  
**12.7/22 (24) kV. Made to AS/NZS 1429.1**

^ Also complies with AS/NZS 4026

Note: The values in this table are for installation conditions of:

Ambient Air Temperature 30 °C  
 Soil Temperature 15 °C  
 Soil Thermal Resistivity 1.2 K.m/W  
 Depth of Burial 1.0 m  
 Screens bonded both ends

# SINGLE CORE AL 22 KV CABLES

## 10 kA for 1 s Wire Screens

Aluminium conductor

SCXLPE conductor screen

TR-XLPE insulation

SCXLPE insulation screen

} Triple extruded, Dry-cure

Copper wire screen

PVC/HDPE sheath

### Product Sheet No. 241-24 A

Conductor Size (mm <sup>2</sup> )	Nominal Diameters		Wire Screen		Thickness of Sheath PVC/HDPE (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
	Insulation (mm)	Insulation Screen (mm)	Area (mm <sup>2</sup> )	No. & Size (No. x mm)			
35 *	18.4	20.0	23	40 x 0.85	1.0 / 1.0	26.2	0.77
50 *	19.7	21.3	33	39 x 1.03	1.0 / 1.0	27.9	0.94
70 *	21.2	22.8	46	32 x 1.35	1.0 / 1.0	30.0	1.17
95 *	22.9	24.5	61	27 x 1.69	1.0 / 1.0	32.4	1.43
120	24.3	25.9	69	48 x 1.35	1.0 / 1.0	33.1	1.61
150	25.7	27.3	69	48 x 1.35	1.0 / 1.0	34.5	1.72
185 ^	27.4	29.0	69	48 x 1.35	1.0 / 1.1	36.4	1.89
240 ^	29.6	31.2	69	48 x 1.35	1.1 / 1.1	38.8	2.13
300	31.8	33.4	69	48 x 1.35	1.1 / 1.1	41.0	2.36
400	34.9	36.5	69	48 x 1.35	1.2 / 1.2	44.5	2.74
500	38.0	39.6	69	48 x 1.35	1.2 / 1.2	47.6	3.11
630	41.6	43.2	69	48 x 1.35	1.3 / 1.3	51.7	3.66
800	46.2	47.8	69	48 x 1.35	1.3 / 1.4	56.5	4.31
1000	50.1	51.7	69	48 x 1.35	1.4 / 1.4	60.6	5.05

Issue: June 2019

12.7/22 (24) kV. Made to AS/NZS 1429.1

\* Short circuit rating less than 10 kA for 1 s

^ Also complies with AS/NZS 4026




Note: Subject to confirmation, similar cables can be manufactured to other specifications.

# SINGLE CORE AL 22 KV CABLES

## 10 kA for 1 s Wire Screens

Aluminium conductor  
 SCXLPE conductor screen  
 TR-XLPE insulation  
 SCXLPE insulation screen  
 Copper wire screen  
 PVC/HDPE sheath

} Triple extruded, Dry-cure

Product Sheet No. 241-24 B							
Conductor Size (mm <sup>2</sup> )	Conductor AC Resistance at 50 Hz and 90°C (Ohm/km)	Inductive Reactance at 50 Hz (Ohm/km)	Conductor to Screen Capacitance (μF/km)	Nominal PVC Duct Size (Multi Way) (mm)	Current Ratings (A)		
							
35 *	1.113	0.148	0.17	80 (NZ)	156	142	120
50 *	0.822	0.141	0.19	80 (NZ)	188	168	142
70 *	0.568	0.132	0.21	100 (NZ)	235	204	177
95 *	0.411	0.127	0.23	100 (NZ)	286	243	210
120	0.325	0.121	0.25	100 (NZ)	327	275	237
150	0.265	0.117	0.27	100 (NZ)	370	307	265
185 ^	0.211	0.112	0.29	150	425	346	305
240 ^	0.161	0.108	0.32	150	500	399	351
300	0.130	0.104	0.35	150	571	447	394
400	0.102	0.101	0.39	150	663	508	447
500	0.0800	0.097	0.43	150	768	574	505
630	0.0633	0.095	0.48	200	886	647	592
800	0.0512	0.091	0.54	200	1019	722	660
1000	0.0425	0.089	0.60	200	1143	792	723

**Issue: June 2019**  
**12.7/22 (24) kV. Made to AS/NZS 1429.1**

\* Short circuit rating less than 10 kA for 1 s

^ Also complies with AS/NZS 4026

Note: The values in this table are for installation conditions of:

Ambient Air Temperature 30 °C  
 Soil Temperature 15 °C  
 Soil Thermal Resistivity 1.2 K.m/W  
 Depth of Burial 1.0 m  
 Screens bonded both ends

# THREE CORE CU 22 KV CABLES

## 3 kA for 1 s Wire Screens

Copper conductor  
 SCXLPE conductor screen  
 TR-XLPE insulation  
 SCXLPE insulation screen  
 Copper wire screens  
 PVC/HDPE sheath

} Triple extruded, Dry-cure

<b>Product Sheet No. 243-13 A</b>							
Conductor Size (mm <sup>2</sup> )	Nominal Diameters		Wire Screens (per core)		Thickness of Sheath PVC/HDPE (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
	Insulation (mm)	Insulation Screen (mm)	Area (mm <sup>2</sup> )	No. & Size (No. x mm)			
35	18.5	20.1	7.4	13 x 0.85	1.3 / 1.4	52.9	2.76
50	19.8	21.4	7.9	14 x 0.85	1.4 / 1.4	56.0	3.28
70	21.2	22.8	8.5	15 x 0.85	1.4 / 1.5	59.2	4.04
95	22.9	24.5	9.1	16 x 0.85	1.5 / 1.5	63.1	4.99
120	24.3	25.9	9.6	17 x 0.85	1.5 / 1.6	66.6	5.90
150	25.7	27.3	10.2	18 x 0.85	1.6 / 1.6	69.8	6.85
185	27.5	29.1	10.8	19 x 0.85	1.6 / 1.7	73.9	8.10
240	29.7	31.3	11.3	20 x 0.85	1.7 / 1.8	79.1	10.05
300	32.0	33.6	12.5	22 x 0.85	1.8 / 1.9	84.4	12.10
400	35.3	36.9	13.6	24 x 0.85	1.9 / 2.0	92.0	14.70

**Issue: June 2019**  
**12.7/22 (24) kV. Made to AS/NZS 1429.1**

Note: Subject to confirmation, similar cables can be manufactured to other specifications.

# THREE CORE CU 22 KV CABLES

## 3 kA for 1 s Wire Screens

Copper conductor

SCXLPE conductor screen




TR-XLPE insulation

SCXLPE insulation screen

Triple extruded, Dry-cure

Copper wire screens

PVC/HDPE sheath

Product Sheet No. 243-13 B							
Conductor Size (mm <sup>2</sup> )	Conductor AC Resistance at 50 Hz and 90°C (Ohm/km)	Inductive Reactance at 50 Hz (Ohm/km)	Conductor to Screen Capacitance (μF/km)	Nominal PVC Duct Size (Single Way) (mm)	Current Ratings (A)		
							
35	0.668	0.138	0.17	80 (NZ)	177	170	144
50	0.494	0.131	0.19	100 (NZ)	212	201	173
70	0.342	0.122	0.21	100 (NZ)	261	245	210
95	0.247	0.116	0.23	100 (NZ)	317	293	251
120	0.196	0.111	0.25	100 (NZ)	363	333	285
150	0.159	0.108	0.27	100 (NZ)	411	373	319
185	0.128	0.103	0.29	150	469	421	366
240	0.0981	0.099	0.32	150	549	486	423
300	0.0792	0.096	0.35	150	625	547	476
400	0.0633	0.093	0.40	150	718	620	539

**Issue: June 2019**  
**12.7/22 (24) kV. Made to AS/NZS 1429.1**

Note: The values in this table are for installation conditions of:

Ambient Air Temperature 30 °C

Soil Temperature 15 °C

Soil Thermal Resistivity 1.2 K.m/W

Depth of Burial 1.0 m

# THREE CORE CU 22 KV CABLES

## 10 kA for 1 s Wire Screens

Copper conductor

SCXLPE conductor screen

TR-XLPE insulation

SCXLPE insulation screen

} Triple extruded, Dry-cure

Copper wire screens

PVC/HDPE sheath

### Product Sheet No. 243-14 A

Conductor Size (mm <sup>2</sup> )	Nominal Diameters		Wire Screens (per core)		Thickness of Sheath PVC/HDPE (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
	Insulation (mm)	Insulation Screen (mm)	Area (mm <sup>2</sup> )	No. & Size (No. x mm)			
35 *	18.5	20.1	11.3	20 x 0.85	1.3 / 1.4	52.9	2.87
50 *	19.8	21.4	16.5	29 x 0.85	1.4 / 1.4	56.0	3.51
70	21.2	22.8	22.7	40 x 0.85	1.4 / 1.5	59.2	4.44
95	22.9	24.5	22.7	40 x 0.85	1.5 / 1.5	63.4	5.40
120	24.3	25.9	22.7	40 x 0.85	1.5 / 1.6	66.6	6.25
150	25.7	27.3	22.7	40 x 0.85	1.6 / 1.6	69.8	7.20
185	27.5	29.1	22.7	40 x 0.85	1.6 / 1.7	73.9	8.45
240	29.7	31.3	22.7	40 x 0.85	1.7 / 1.8	79.1	10.35
300	32.0	33.6	22.7	40 x 0.85	1.8 / 1.9	84.4	12.40
400	35.3	36.9	22.7	40 x 0.85	1.9 / 2.0	92.0	15.25

Issue: June 2019

12.7/22 (24) kV. Made to AS/NZS 1429.1

\* Short circuit rating less than 10 kA for 1 s

Note: Subject to confirmation, similar cables can be manufactured to other specifications.






# THREE CORE CU 22 KV CABLES

## 10 kA for 1 s Wire Screens

Copper conductor  
 SCXLPE conductor screen  
 TR-XLPE insulation  
 SCXLPE insulation screen  
 Copper wire screens  
 PVC/HDPE sheath

} Triple extruded, Dry-cure

<b>Product Sheet No. 243-14 B</b>							
Conductor Size (mm <sup>2</sup> )	Conductor AC Resistance at 50 Hz and 90°C (Ohm/km)	Inductive Reactance at 50 Hz (Ohm/km)	Conductor to Screen Capacitance (μF/km)	Nominal PVC Duct Size (Single Way) (mm)	Current Ratings (A)		
							
35 *	0.668	0.138	0.17	80 (NZ)	177	170	144
50 *	0.494	0.131	0.19	100 (NZ)	212	201	173
70	0.342	0.122	0.21	100 (NZ)	261	245	210
95	0.247	0.116	0.23	100 (NZ)	317	293	251
120	0.196	0.111	0.25	100 (NZ)	363	333	285
150	0.159	0.108	0.27	100 (NZ)	411	373	319
185	0.128	0.103	0.29	150	469	421	366
240	0.0981	0.099	0.32	150	549	486	423
300	0.0792	0.096	0.35	150	625	547	476
400	0.0633	0.093	0.40	150	717	620	539

**Issue: June 2019**  
**12.7/22 (24) kV. Made to AS/NZS 1429.1**

\* Short circuit rating less than 10 kA for 1 s

Note: The values in this table are for installation conditions of:

Ambient Air Temperature 30 °C  
 Soil Temperature 15 °C  
 Soil Thermal Resistivity 1.2 K.m/W  
 Depth of Burial 1.0 m

# THREE CORE AL 22 KV CABLES

## 3 kA for 1 s Wire Screens

Aluminium conductor

SCXLPE conductor screen

TR-XLPE insulation

SCXLPE insulation screen

} Triple extruded, Dry-cure

Copper wire screens

PVC/HDPE sheath

<b>Product Sheet No. 243-23 A</b>							
Conductor Size (mm <sup>2</sup> )	Nominal Diameters		Wire Screens (per core)		Thickness of Sheath PVC/HDPE (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
	Insulation (mm)	Insulation Screen (mm)	Area (mm <sup>2</sup> )	No. & Size (No. x mm)			
35 ^	18.4	20.0	7.4	13 x 0.85	1.3 / 1.4	52.7	2.07
50	19.7	21.3	7.9	14 x 0.85	1.4 / 1.4	55.7	2.36
70	21.2	22.8	8.5	15 x 0.85	1.4 / 1.5	59.2	2.73
95 ^	22.9	24.5	9.1	16 x 0.85	1.5 / 1.5	63.1	3.18
120	24.3	25.9	9.6	17 x 0.85	1.5 / 1.6	66.3	3.58
150	25.7	27.3	10.2	18 x 0.85	1.6 / 1.6	69.5	4.02
185 ^	27.4	29.0	10.8	19 x 0.85	1.6 / 1.7	73.4	4.57
240 ^	29.6	31.2	11.3	20 x 0.85	1.7 / 1.8	78.5	5.40
300	31.8	33.4	12.5	22 x 0.85	1.8 / 1.9	84.0	6.30
400	34.9	36.5	13.6	24 x 0.85	1.9 / 2.0	91.1	7.55

**Issue: June 2019**  
**12.7/22 (24) kV. Made to AS/NZS 1429.1**

^ Also complies with AS/NZS 4026

Note: Subject to confirmation, similar cables can be manufactured to other specifications.

# THREE CORE AL 22 KV CABLES

## 3 kA for 1 s Wire Screens

Aluminium conductor

SCXLPE conductor screen




TR-XLPE insulation

SCXLPE insulation screen

} Triple extruded, Dry-cure

Copper wire screens

PVC/HDPE sheath

Product Sheet No. 243-23 B							
Conductor Size (mm <sup>2</sup> )	Conductor AC Resistance at 50 Hz and 90°C (Ohm/km)	Inductive Reactance at 50 Hz (Ohm/km)	Conductor to Screen Capacitance (μF/km)	Nominal PVC Duct Size (Single Way) (mm)	Current Ratings (A)		
							
35 ^	1.11	0.139	0.17	80 (NZ)	136	132	111
50	0.822	0.131	0.19	100 (NZ)	164	156	134
70	0.568	0.122	0.21	100 (NZ)	203	190	163
95 ^	0.411	0.116	0.23	100 (NZ)	246	227	195
120	0.325	0.111	0.25	100 (NZ)	282	259	221
150	0.265	0.108	0.27	100 (NZ)	319	289	247
185 ^	0.211	0.104	0.29	150	365	327	285
240 ^	0.161	0.099	0.32	150	428	379	330
300	0.130	0.096	0.35	150	487	427	371
400	0.102	0.093	0.39	150	564	488	424

**Issue: June 2019**  
**12.7/22 (24) kV. Made to AS/NZS 1429.1**

^ Also complies with AS/NZS 4026

Note: The values in this table are for installation conditions of:

Ambient Air Temperature 30 °C

Soil Temperature 15 °C

Soil Thermal Resistivity 1.2 K.m/W

Depth of Burial 1.0 m

# THREE CORE AL 22 KV CABLES

## 10 kA for 1 s Wire Screens

Aluminium conductor

SCXLPE conductor screen

TR-XLPE insulation

SCXLPE insulation screen

} Triple extruded, Dry-cure

Copper wire screens

PVC/HDPE sheath

<b>Product Sheet No. 243-24 A</b>							
Conductor Size (mm <sup>2</sup> )	Nominal Diameters		Wire Screens (per core)		Thickness of Sheath PVC/HDPE (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
	Insulation (mm)	Insulation Screen (mm)	Area (mm <sup>2</sup> )	No. & Size (No. x mm)			
35 *	18.4	20.0	7.9	14 x 0.85	1.3 / 1.4	52.7	2.09
50 *	19.7	21.3	10.8	19 x 0.85	1.4 / 1.4	55.7	2.44
70 *	21.2	22.8	15.3	27 x 0.85	1.4 / 1.5	59.2	2.92
95 *	22.9	24.5	20.4	36 x 0.85	1.5 / 1.5	63.1	3.50
120	24.3	25.9	22.7	40 x 0.85	1.5 / 1.6	66.3	3.95
150	25.7	27.3	22.7	40 x 0.85	1.6 / 1.6	69.5	4.37
185 ^	27.4	29.0	22.7	40 x 0.85	1.6 / 1.7	73.4	4.90
240 ^	29.6	31.2	22.7	40 x 0.85	1.7 / 1.8	78.8	5.70
300	31.8	33.4	22.7	40 x 0.85	1.8 / 1.9	84.0	6.55
400	34.9	36.5	22.7	40 x 0.85	1.9 / 2.0	91.1	7.80

**Issue: June 2019**  
**12.7/22 (24) kV. Made to AS/NZS 1429.1**

\* Short circuit rating less than 10 kA for 1 s

^ Also complies with AS/NZS 4026

Note: Subject to confirmation, similar cables can be manufactured to other specifications.

# THREE CORE AL 22 KV CABLES

## 10 kA for 1 s Wire Screens

Aluminium conductor

SCXLPE conductor screen

TR-XLPE insulation




SCXLPE insulation screen

Triple extruded, Dry-cure

Copper wire screens

PVC/HDPE sheath

### Product Sheet No. 243-24 B

Conductor Size (mm <sup>2</sup> )	Conductor AC Resistance at 50 Hz and 90°C (Ohm/km)	Inductive Reactance at 50 Hz (Ohm/km)	Conductor to Screen Capacitance (μF/km)	Nominal PVC Duct Size (Single Way) (mm)	Current Ratings (A)		
							
35 *	1.11	0.139	0.17	80 (NZ)	136	132	111
50 *	0.822	0.131	0.19	100 (NZ)	164	156	134
70 *	0.568	0.122	0.21	100 (NZ)	203	190	163
95 *	0.411	0.116	0.23	100 (NZ)	246	227	195
120	0.325	0.111	0.25	100 (NZ)	282	259	221
150	0.265	0.108	0.27	100 (NZ)	319	289	247
185 ^	0.211	0.104	0.29	150	365	327	285
240 ^	0.161	0.099	0.32	150	427	379	330
300	0.130	0.096	0.35	150	487	427	371
400	0.102	0.093	0.39	150	564	488	424

Issue: June 2019

12.7/22 (24) kV. Made to AS/NZS 1429.1

\* Short circuit rating less than 10 kA for 1 s

^ Also complies with AS/NZS 4026

Note: The values in this table are for installation conditions of:

Ambient Air Temperature 30 °C

Soil Temperature 15 °C

Soil Thermal Resistivity 1.2 K.m/W

Depth of Burial 1.0 m

# SINGLE CORE CU 33 KV CABLES

## 3 kA for 1 s Wire Screens

Copper conductor  
 SCXLPE conductor screen  
 TR-XLPE insulation  
 SCXLPE insulation screen  
 Copper wire screens  
 PVC/HDPE sheath

} Triple extruded, Dry-cure

<b>Product Sheet No. 251-13 A</b>							
Conductor Size (mm <sup>2</sup> )	Nominal Diameters		Wire Screen		Thickness of Sheath PVC/HDPE (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
	Insulation (mm)	Insulation Screen (mm)	Area (mm <sup>2</sup> )	No. & Size (No. x mm)			
50	24.6	26.2	20	36 x 0.85	1.0 / 1.0	32.4	1.33
70	26.0	27.6	20	36 x 0.85	1.0 / 1.0	33.8	1.57
95	27.7	29.3	20	36 x 0.85	1.0 / 1.1	35.7	1.88
120	29.1	30.7	20	36 x 0.85	1.0 / 1.1	37.1	2.16
150	30.5	32.1	20	36 x 0.85	1.1 / 1.1	38.7	2.47
185	32.3	33.9	20	36 x 0.85	1.1 / 1.1	40.5	2.88
240	34.5	36.1	20	36 x 0.85	1.1 / 1.2	42.9	3.49
300	36.8	38.4	20	36 x 0.85	1.2 / 1.2	45.4	4.16
400	40.1	41.7	20	36 x 0.85	1.2 / 1.3	49.0	5.10
500	43.5	45.1	20	36 x 0.85	1.3 / 1.3	52.6	6.15
630	47.1	48.7	20	36 x 0.85	1.3 / 1.4	56.4	7.60

**Issue: June 2019**  
**19/33 (36) kV. Made to AS/NZS 1429.1**




Note: Subject to confirmation, similar cables can be manufactured to other specifications.

# SINGLE CORE CU 33 KV CABLES

## 3 kA for 1 s Wire Screens

Copper conductor  
 SCXLPE conductor screen  
 TR-XLPE insulation  
 SCXLPE insulation screen  
 Copper wire screens  
 PVC/HDPE sheath

} Triple extruded, Dry-cure

<b>Product Sheet No. 251-13 B</b>							
Conductor Size (mm <sup>2</sup> )	Conductor AC Resistance at 50 Hz and 90°C (Ohm/km)	Inductive Reactance at 50 Hz (Ohm/km)	Conductor to Screen Capacitance (μF/km)	Nominal PVC Duct Size (Multi Way) (mm)	Current Ratings (A)		
							
50	0.494	0.149	0.14	100 (NZ)	246	216	188
70	0.342	0.139	0.16	100 (NZ)	304	263	228
95	0.247	0.133	0.17	100 (NZ)	370	314	272
120	0.196	0.128	0.19	150	425	356	315
150	0.159	0.124	0.20	150	482	398	352
185	0.127	0.119	0.22	150	552	448	396
240	0.0977	0.114	0.24	150	649	518	457
300	0.0786	0.110	0.26	150	743	582	514
400	0.0625	0.106	0.29	150	860	659	581
500	0.0501	0.102	0.32	200	993	744	682
630	0.0406	0.098	0.36	200	1139	835	764

**Issue: June 2019**  
**19/33 (36) kV. Made to AS/NZS 1429.1**

Note: The values in this table are for installation conditions of:

Ambient Air Temperature 30 °C  
 Soil Temperature 15 °C  
 Soil Thermal Resistivity 1.2 K.m/W  
 Depth of Burial 1.0 m  
 Screens bonded both ends

# SINGLE CORE CU 33 KV CABLES

## 10 kA for 1 s Wire Screens

Copper conductor  
 SCXLPE conductor screen  
 TR-XLPE insulation  
 SCXLPE insulation screen  
 Copper wire screens  
 PVC/HDPE sheath

} Triple extruded, Dry-cure

<b>Product Sheet No. 251-14 A</b>							
Conductor Size (mm <sup>2</sup> )	Nominal Diameters		Wire Screen		Thickness of Sheath PVC/HDPE (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
	Insulation (mm)	Insulation Screen (mm)	Area (mm <sup>2</sup> )	No. & Size (No. x mm)			
50 *	24.6	26.2	49	34 x 1.35	1.0 / 1.0	33.4	1.60
70	26.0	27.6	69	48 x 1.35	1.0 / 1.1	35.0	2.04
95	27.7	29.3	69	48 x 1.35	1.0 / 1.1	36.7	2.34
120	29.1	30.7	69	48 x 1.35	1.1 / 1.1	38.3	2.63
150	30.5	32.1	69	48 x 1.35	1.1 / 1.1	39.7	2.93
185	32.3	33.9	69	48 x 1.35	1.1 / 1.2	41.7	3.35
240	34.5	36.1	69	48 x 1.35	1.1 / 1.2	43.9	3.95
300	36.8	38.4	69	48 x 1.35	1.2 / 1.2	46.4	4.62
400	40.1	41.7	69	48 x 1.35	1.2 / 1.3	50.0	5.55
500	43.5	45.1	69	48 x 1.35	1.3 / 1.3	53.6	6.60
630	47.1	48.7	69	48 x 1.35	1.3 / 1.4	57.4	8.05

**Issue: June 2019**  
**19/33 (36) kV. Made to AS/NZS 1429.1**

\* Short circuit rating less than 10 kA for 1 s

Note: Subject to confirmation, similar cables can be manufactured to other specifications.






# SINGLE CORE CU 33 KV CABLES

## 10 kA for 1 s Wire Screens

Copper conductor  
 SCXLPE conductor screen  
 TR-XLPE insulation  
 SCXLPE insulation screen  
 Copper wire screens  
 PVC/HDPE sheath

} Triple extruded, Dry-cure

<b>Product Sheet No. 251-14 B</b>							
Conductor Size (mm <sup>2</sup> )	Conductor AC Resistance at 50 Hz and 90°C (Ohm/km)	Inductive Reactance at 50 Hz (Ohm/km)	Conductor to Screen Capacitance (μF/km)	Nominal PVC Duct Size (Multi Way) (mm)	Current Ratings (A)		
							
50 *	0.494	0.151	0.14	100 (NZ)	248	216	188
70	0.342	0.142	0.16	100 (NZ)	305	262	227
95	0.247	0.134	0.17	150	370	311	276
120	0.196	0.130	0.19	150	424	352	311
150	0.159	0.125	0.20	150	479	392	347
185	0.127	0.120	0.22	150	547	441	389
240	0.0976	0.115	0.24	150	640	506	447
300	0.0786	0.112	0.26	150	729	565	499
400	0.0625	0.107	0.29	200	839	636	583
500	0.0501	0.103	0.32	200	961	711	651
630	0.0405	0.100	0.36	200	1094	790	723

**Issue: June 2019**  
**19/33 (36) kV. Made to AS/NZS 1429.1**

\* Short circuit rating less than 10 kA for 1 s

Note: The values in this table are for installation conditions of:

Ambient Air Temperature 30 °C  
 Soil Temperature 15 °C  
 Soil Thermal Resistivity 1.2 K.m/W  
 Depth of Burial 1.0 m  
 Screens bonded both ends

# SINGLE CORE AL 33 KV CABLES

## 3 kA for 1 s Wire Screens

Aluminium conductor

SCXLPE conductor screen

TR-XLPE insulation

SCXLPE insulation screen

} Triple extruded, Dry-cure

Copper wire screens

PVC/HDPE sheath

### Product Sheet No. 251-23 A

Conductor Size (mm <sup>2</sup> )	Nominal Diameters		Wire Screen		Thickness of Sheath PVC/HDPE (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
	Insulation (mm)	Insulation Screen (mm)	Area (mm <sup>2</sup> )	No. & Size (No. x mm)			
50	24.5	26.1	20	36 x 0.85	1.0 / 1.0	32.3	1.03
70	26.0	27.6	20	36 x 0.85	1.0 / 1.0	33.8	1.14
95	27.7	29.3	20	36 x 0.85	1.0 / 1.1	35.7	1.28
120	29.1	30.7	20	36 x 0.85	1.0 / 1.1	37.1	1.40
150	30.5	32.1	20	36 x 0.85	1.1 / 1.1	38.7	1.54
185	32.2	33.8	20	36 x 0.85	1.1 / 1.1	40.4	1.71
240	34.4	36.0	20	36 x 0.85	1.1 / 1.2	42.8	1.96
300	36.6	38.2	20	36 x 0.85	1.2 / 1.2	45.2	2.23
400	39.7	41.3	20	36 x 0.85	1.2 / 1.3	48.6	2.61
500	42.8	44.4	20	36 x 0.85	1.3 / 1.3	51.9	3.04
630	46.4	48.0	20	36 x 0.85	1.3 / 1.4	55.7	3.58
800	51.0	52.6	20	36 x 0.85	1.4 / 1.4	60.5	4.28
1000	54.9	56.5	21	37 x 0.85	1.5 / 1.5	64.8	5.05

Issue: June 2019

19/33 (36) V. Made to AS/NZS 1429.1

Note: Subject to confirmation, similar cables can be manufactured to other specifications.

# SINGLE CORE AL 33 KV CABLES

## 3 kA for 1 s Wire Screens

Aluminium conductor

SCXLPE conductor screen




TR-XLPE insulation

SCXLPE insulation screen

Triple extruded, Dry-cure

Copper wire screens

PVC/HDPE sheath

Product Sheet No. 251-23 B							
Conductor Size (mm <sup>2</sup> )	Conductor AC Resistance at 50 Hz and 90°C (Ohm/km)	Inductive Reactance at 50 Hz (Ohm/km)	Conductor to Screen Capacitance (μF/km)	Nominal PVC Duct Size (Multi Way) (mm)	Current Ratings (A)		
							
50	0.822	0.150	0.14	100 (NZ)	190	167	146
70	0.568	0.139	0.16	100 (NZ)	236	204	177
95	0.411	0.133	0.17	100 (NZ)	287	244	211
120	0.325	0.128	0.19	150	330	277	245
150	0.265	0.124	0.20	150	374	309	274
185	0.211	0.119	0.22	150	430	350	309
240	0.161	0.114	0.24	150	507	405	357
300	0.129	0.110	0.26	150	580	456	402
400	0.101	0.107	0.29	150	677	521	459
500	0.0797	0.103	0.32	200	787	593	544
630	0.0630	0.099	0.35	200	914	674	617
800	0.0509	0.095	0.39	200	1057	759	694
1000	0.0421	0.093	0.43	200	1195	841	767

**Issue: June 2019**  
**19/33 (36) kV. Made to AS/NZS 1429.1**

Note: The values in this table are for installation conditions of:

Ambient Air Temperature 30 °C

Soil Temperature 15 °C

Soil Thermal Resistivity 1.2 K.m/W

Depth of Burial 1.0 m

Screens bonded both ends

# SINGLE CORE AL 33 KV CABLES

## 10 kA for 1 s Wire Screens

Aluminium conductor

SCXLPE conductor screen

TR-XLPE insulation

SCXLPE insulation screen

} Triple extruded, Dry-cure

Copper wire screens

PVC/HDPE sheath

### Product Sheet No. 251-24 A

Conductor Size (mm <sup>2</sup> )	Nominal Diameters		Wire Screen		Thickness of Sheath PVC/HDPE (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
	Insulation (mm)	Insulation Screen (mm)	Area (mm <sup>2</sup> )	No. & Size (No. x mm)			
50 *	24.5	26.1	33	39 x 1.03	1.0 / 1.0	32.7	1.14
70 *	26.0	27.6	46	32 x 1.35	1.0 / 1.1	35.0	1.39
95 *	27.7	29.3	62	43 x 1.35	1.0 / 1.1	36.7	1.68
120	29.1	30.7	69	48 x 1.35	1.1 / 1.1	38.3	1.88
150	30.5	32.1	69	48 x 1.35	1.1 / 1.1	39.7	2.00
185	32.2	33.8	69	48 x 1.35	1.1 / 1.2	41.6	2.18
240	34.4	36.0	69	48 x 1.35	1.1 / 1.2	43.8	2.42
300	36.6	38.2	69	48 x 1.35	1.2 / 1.2	46.2	2.69
400	39.7	41.3	69	48 x 1.35	1.2 / 1.3	49.6	3.07
500	42.8	44.4	69	48 x 1.35	1.3 / 1.3	52.9	3.50
630	46.4	48.0	69	48 x 1.35	1.3 / 1.4	56.7	4.05
800	51.0	52.6	69	48 x 1.35	1.4 / 1.5	61.7	4.76
1000	54.9	56.5	69	48 x 1.35	1.5 / 1.5	65.8	5.55

Issue: June 2019

19/33 (36) kV. Made to AS/NZS 1429.1

\* Short circuit rating less than 10 kA for 1 s

Note: Subject to confirmation, similar cables can be manufactured to other specifications.

# SINGLE CORE AL 33 KV CABLES

## 10 kA for 1 s Wire Screens

Aluminium conductor

SCXLPE conductor screen




TR-XLPE insulation

SCXLPE insulation screen

Triple extruded, Dry-cure

Copper wire screens

PVC/HDPE sheath

Product Sheet No. 251-24 B							
Conductor Size (mm <sup>2</sup> )	Conductor AC Resistance at 50 Hz and 90°C (Ohm/km)	Inductive Reactance at 50 Hz (Ohm/km)	Conductor to Screen Capacitance (μF/km)	Nominal PVC Duct Size (Multi Way) (mm)	Current Ratings (A)		
							
50 *	0.822	0.151	0.14	100 (NZ)	191	168	146
70 *	0.568	0.142	0.16	100 (NZ)	238	204	178
95 *	0.411	0.134	0.17	150	288	243	215
120	0.325	0.130	0.19	150	331	275	244
150	0.265	0.125	0.20	150	374	307	272
185	0.211	0.121	0.22	150	429	346	306
240	0.161	0.115	0.24	150	504	399	353
300	0.129	0.112	0.26	150	575	448	395
400	0.101	0.108	0.29	150	668	509	449
500	0.0797	0.104	0.32	200	772	576	528
630	0.0630	0.100	0.35	200	891	650	595
800	0.0508	0.097	0.39	200	1023	726	663
1000	0.0421	0.094	0.43	200	1149	798	727

**Issue: June 2019**  
**19/33 (36) kV. Made to AS/NZS 1429.1**

\* Short circuit rating less than 10 kA for 1 s

Note: The values in this table are for installation conditions of:

Ambient Air Temperature 30 °C

Soil Temperature 15 °C

Soil Thermal Resistivity 1.2 K.m/W

Depth of Burial 1.0 m

Screens bonded both ends

# THREE CORE CU 33 KV CABLES

Copper conductor  
 SCXLPE conductor screen  
 TR-XLPE insulation  
 SCXLPE insulation screen  
 Copper wire screens  
 PVC/HDPE sheath

} Triple extruded, Dry-cure




<b>Product Sheet No. 253-11 A</b>							
Conductor Size (mm <sup>2</sup> )	Nominal Diameters		Wire Screens (per core)		Thickness of Sheath PVC/HDPE (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
	Insulation (mm)	Insulation Screen (mm)	Area (mm <sup>2</sup> )	No. & Size (No. x mm)			
<b>3 kA for 1 s Wire Screens</b>							
50	24.6	26.2	9.6	17 x 0.85	1.5 / 1.6	66.9	4.15
70	26.0	27.6	10.2	18 x 0.85	1.6 / 1.7	70.4	4.99
95	27.7	29.3	10.8	19 x 0.85	1.7 / 1.7	74.5	6.00
120	29.1	30.7	11.3	20 x 0.85	1.7 / 1.8	77.8	6.90
150	30.5	32.1	11.9	21 x 0.85	1.8 / 1.8	81.0	7.95
185	32.3	33.9	12.5	22 x 0.85	1.8 / 1.9	85.1	9.25
240	34.5	36.1	13.1	23 x 0.85	1.9 / 2.0	90.2	11.25
300	36.8	38.4	14.2	25 x 0.85	2.0 / 2.0	95.4	13.40
400							
<b>10 kA for 1 s Wire Screens</b>							
50 *	24.6	26.2	16.5	29 x 0.85	1.6 / 1.6	67.1	4.37
70	26.0	27.6	22.7	40 x 0.85	1.6 / 1.7	70.4	5.35
95	27.7	29.3	22.7	40 x 0.85	1.7 / 1.7	74.5	6.35
120	29.1	30.7	22.7	40 x 0.85	1.7 / 1.8	77.8	7.25
150	30.5	32.1	22.7	40 x 0.85	1.8 / 1.8	81.0	8.25
185	32.3	33.9	22.7	40 x 0.85	1.8 / 1.9	85.1	9.55
240	34.5	36.1	22.7	40 x 0.85	1.9 / 2.0	90.2	11.50
300	36.8	38.4	22.7	40 x 0.85	2.0 / 2.0	95.4	13.60
400							
<b>Issue: June 2019</b>							
<b>19/33 kV. (36) Made to AS/NZS 1429.1</b>							

\* Short circuit rating less than 10 kA for 1 s

Note: Subject to confirmation, similar cables can be manufactured to other specifications.

# THREE CORE CU 33 KV CABLES

Copper conductor  
 SCXLPE conductor screen } Triple extruded, Dry-cure  
 TR-XLPE insulation }  
 SCXLPE insulation screen }  
 Copper wire screens  
 PVC/HDPE sheath

<b>Product Sheet No. 253-11 B</b>							
Conductor Size (mm <sup>2</sup> )	Conductor AC Resistance at 50 Hz and 90°C (Ohm/km)	Inductive Reactance at 50 Hz (Ohm/km)	Conductor to Screen Capacitance (μF/km)	Nominal PVC Duct Size (Single Way) (mm)	Current Ratings (A)		
							
<b>3 kA for 1 s Wire Screens</b>							
50	0.494	0.143	0.14	100 (NZ)	212	200	173
70	0.342	0.133	0.16	100 (NZ)	262	244	211
95	0.247	0.126	0.17	150	317	292	256
120	0.196	0.122	0.19	150	364	331	290
150	0.159	0.118	0.20	150	411	372	325
185	0.128	0.113	0.22	150	470	420	367
240	0.0978	0.108	0.24	150	550	486	424
300	0.0789	0.104	0.26	150	626	547	478
400							
<b>10 kA for 1 s Wire Screens</b>							
50 *	0.494	0.143	0.14	100 (NZ)	212	200	173
70	0.342	0.133	0.16	100 (NZ)	262	244	211
95	0.247	0.126	0.17	150	317	292	256
120	0.196	0.122	0.19	150	364	331	290
150	0.159	0.118	0.20	150	411	372	325
185	0.128	0.113	0.22	150	470	420	367
240	0.0978	0.108	0.24	150	550	486	424
300	0.0789	0.104	0.26	150	626	547	478
400							
<b>Issue: June 2019</b>							
<b>19/33 (36) kV. Made to AS/NZS 1429.1</b>							

\* Short circuit rating less than 10 kA for 1 s

Note: The values in this table are for installation conditions of:

Ambient Air Temperature 30 °C  
 Soil Temperature 15 °C  
 Soil Thermal Resistivity 1.2 K.m/W  
 Depth of Burial 1.0 m

# THREE CORE AL 33 KV CABLES

Aluminium conductor  
 SCXLPE conductor screen  
 TR-XLPE insulation  
 SCXLPE insulation screen  
 Copper wire screens  
 PVC/HDPE sheath

} Triple extruded, Dry-cure

<b>Product Sheet No. 253-21 A</b>							
Conductor Size (mm <sup>2</sup> )	Nominal Diameters		Wire Screens (per core)		Thickness of Sheath PVC/HDPE (mm)	Nominal Overall Diameter (mm)	Linear Mass (kg/m)
	Insulation (mm)	Insulation Screen (mm)	Area (mm <sup>2</sup> )	No. & Size (No. x mm)			
<b>3 kA for 1 s Wire Screens</b>							
50	24.5	26.1	9.6	17 x 0.85	1.5 / 1.6	66.7	3.22
70	26.0	27.6	10.2	18 x 0.85	1.6 / 1.7	70.4	3.67
95	27.7	29.3	10.8	19 x 0.85	1.7 / 1.7	74.2	4.18
120	29.1	30.7	11.3	20 x 0.85	1.7 / 1.8	77.5	4.63
150	30.5	32.1	11.9	21 x 0.85	1.8 / 1.8	80.7	5.10
185	32.2	33.8	12.5	22 x 0.85	1.8 / 1.9	84.9	5.70
240	34.4	36.0	13.1	23 x 0.85	1.9 / 2.0	90.0	6.60
300	36.6	38.2	14.2	25 x 0.85	2.0 / 2.0	95.0	7.55
400							
<b>10 kA for 1 s Wire Screens</b>							
50 *	24.5	26.1	10.8	19 x 0.85	1.6 / 1.6	66.9	3.28
70 *	26.0	27.6	15.3	27 x 0.85	1.6 / 1.7	70.4	3.82
95 *	27.7	29.3	20.4	36 x 0.85	1.7 / 1.7	74.2	4.45
120	29.1	30.7	22.7	40 x 0.85	1.7 / 1.8	77.5	4.94
150	30.5	32.1	22.7	40 x 0.85	1.8 / 1.8	80.7	5.40
185	32.2	33.8	22.7	40 x 0.85	1.8 / 1.9	84.9	6.00
240	34.4	36.0	22.7	40 x 0.85	1.9 / 2.0	90.0	6.90
300	36.6	38.2	22.7	40 x 0.85	2.0 / 2.0	95.0	7.75
400							
<b>Issue: June 2019</b>							
<b>19/33 (36) kV. Made to AS/NZS 1429.1</b>							




\* Short circuit rating less than 10 kA for 1 s

Note: Subject to confirmation, similar cables can be manufactured to other specifications.



# THREE CORE AL 33 KV CABLES

Aluminium conductor  
 SCXLPE conductor screen } Triple extruded, Dry-cure  
 TR-XLPE insulation }  
 SCXLPE insulation screen }  
 Copper wire screens  
 PVC/HDPE sheath

<b>Product Sheet No. 253-21 B</b>							
Conductor Size (mm <sup>2</sup> )	Conductor AC Resistance at 50 Hz and 90°C (Ohm/km)	Inductive Reactance at 50 Hz (Ohm/km)	Conductor to Screen Capacitance (μF/km)	Nominal PVC Duct Size (Single Way) (mm)	Current Ratings (A)		
							
<b>3 kA for 1 s Wire Screens</b>							
50	0.822	0.143	0.14	100 (NZ)	164	155	134
70	0.568	0.133	0.16	100 (NZ)	203	189	163
95	0.411	0.126	0.17	150	246	226	198
120	0.325	0.122	0.19	150	283	257	226
150	0.265	0.118	0.20	150	319	288	252
185	0.211	0.113	0.22	150	365	326	285
240	0.161	0.108	0.24	150	428	378	330
300	0.130	0.105	0.26	150	488	427	372
400							
<b>10 kA for 1 s Wire Screens</b>							
50 *	0.822	0.143	0.14	100 (NZ)	164	155	134
70 *	0.568	0.133	0.16	100 (NZ)	203	189	163
95 *	0.411	0.126	0.17	150	246	226	198
120	0.325	0.122	0.19	150	283	257	226
150	0.265	0.118	0.20	150	319	288	252
185	0.211	0.113	0.22	150	365	326	285
240	0.161	0.108	0.24	150	428	378	330
300	0.130	0.105	0.26	150	488	427	372
400							
<b>Issue: June 2019</b>							
<b>19/33 (36) kV. Made to AS/NZS 1429.1</b>							

\* Short circuit rating less than 10 kA for 1 s

Note: The values in this table are for installation conditions of:

Ambient Air Temperature 30 °C  
 Soil Temperature 15 °C  
 Soil Thermal Resistivity 1.2 K.m/W  
 Depth of Burial 1.0 m

# NOTES

## SECTION FIVE – AERIALS

	<b>PAGE</b>
<b>Explanatory Information</b>	<b>2-7</b>
Thermal Characteristics	2
Electrical Characteristics	4
Physical and Mechanical Characteristics	5
Bare Overhead Conductors	7
<b>Product Sheets</b>	<b>8-21</b>
AAC Aerial Conductors	8
AAAC Aerial Conductors	10
ACSR Aerial Conductors	12
Hard Drawn Cu Aerial Conductors	14
PVC Insulated Hard Drawn Cu Aerial Cables	16
PVC Insulated AAC Aerial Cables	18
Al Aerial Bundled Cables (ABC)	20
<b>Notes</b>	<b>22</b>

# THERMAL CHARACTERISTICS

## Continuous Current Carrying Capacity

The continuous current carrying capacity of a conductor depends on the permissible conductor temperature rise above ambient air temperature. For the calculation of current ratings of bare overhead conductors, ambient air temperatures between 20°C and 40°C are usually considered.

The maximum permissible continuous operating temperature of an overhead conductor is limited by the permanent effects of high temperatures on the strength of the conductor material. Aluminium wire may be operated indefinitely at temperatures of up to 75°C without significant annealing occurring. Therefore, this temperature is taken as the continuous operating temperature for bare aluminium and aluminium alloy conductors.

For aluminium and aluminium alloy conductors, a maximum operating temperature limit of 100°C is recommended, resulting in approximately 3% loss of strength after 1000 hours of operation. Under emergency operating conditions with higher temperatures, the effect of annealing should be considered. The loss of strength for an AAC or AAAC/1120 conductor operated at 150°C for 10 hours is equivalent to the loss of strength for the same conductor operated at 100°C for 7000 hours. The effect is less significant with steel-reinforced conductors, where the steel provides most of the strength of the conductor and is essentially unaffected by temperature. However, to allow for the effects on grease and fittings, a maximum operating temperature limit of 120°C is recommended in this case.

The maximum load capacity of a long line is usually dictated by consideration of system stability, permissible voltage regulation, or the cost of energy losses. However, the maximum load capacity of a short line may be determined by the maximum permissible operating temperature of the conductor. The maximum permissible operating temperature is that which results in the greatest permissible sag (allowing for creep) or that which results in the maximum allowable permanent loss of tensile strength due to annealing.

The conductor temperature depends on the current load, the electrical characteristics of the conductor, and the atmospheric parameters such as wind and sun. Assuming these factors to be fairly constant, the conductor temperature does not change significantly. In this situation, the heat supplied to the conductor is balanced by the heat dissipated and the thermal condition of the conductor is then defined as "steady state". At such a steady state, with the conductor at maximum permissible temperature, a heat balance equation can be used to calculate the continuous current carrying capacity of a conductor.

The formulae used for the calculations are generally in accordance with those published by V. T. Morgan.

# THERMAL CHARACTERISTICS (CONT.)

## Ambient Temperature

For dry conductors the choice of ambient temperature has little influence on the increase of the calculated current carrying capacity for a given temperature rise. For example, for temperature rises higher than 30°C, the increase in the current carrying capacity for a given temperature rise above an ambient of 20°C is within 2% of the value obtained with the same temperature rise above an ambient of 35°C. Rain has a major effect on the current carrying capacity of a conductor, and the rating of a wet conductor is higher than that of a dry one. For conductors with a wet surface, the choice of ambient temperature significantly influences the current carrying capacity.

## Solar Radiation

Many factors can influence the effect of solar radiation. The altitude of the sun, the clearness ratio of the sky, the incidence of the solar beam and the reflectance of the sun from the ground, affect the magnitude of the solar heat input into the conductor. However, small changes in solar radiation intensity have little effect on the current carrying capacity. An increase in solar radiation intensity from 1000 W/m<sup>2</sup> to 1200 W/m<sup>2</sup> decreases the rating of a conductor by about 2%. A value of 1000 W/m<sup>2</sup> for direct solar radiation and 100W/m<sup>2</sup> for diffuse solar radiation for summer noon conditions has been chosen as appropriate to general conditions throughout Australia and New Zealand.

## Emissivity and Solar Absorption Coefficients

Emissivity is the value between zero and unity which defines the fraction of the black-body radiation that the surface emits. Similarly, absorptivity is the value between zero and unity that defines the fraction of the incident irradiation that is absorbed by the surface. The surface condition of a conductor affects both these parameters, and for convenience they are assumed to be equal.

The Rural Weathered condition is considered to exist on old lines in clean atmospheres and may also exist as sections of new conductor in an old line arising from augmentation or alteration works.

## Air Movement

This is the most significant of all the parameters. The rate of increase of the current carrying capacity of a conductor with increasing wind velocity is greatest at low wind velocities. This is partly due to the effect of wind velocity on the radial temperature gradient in the conductor.

Wind direction also affects the current carrying capacity of a conductor. However, it would be difficult to take the variability of the wind into account because of its dependence on many factors, including local topography and climate.

In view of this and of the lack of comprehensive meteorological data across the country, current carrying capacities have been calculated for the theoretical extreme condition of still air and for 1.0 metre/second.

# ELECTRICAL CHARACTERISTICS

## AC Resistance

The electrical resistance of a conductor with alternating current is greater than its resistance with direct current. For all-aluminium conductors, the increased resistance is due mainly to skin effect, which causes the current to concentrate in the outer portion of the conductor. Non-uniformity of current distribution is also caused by a proximity effect, which results from electromagnetic fields from nearby conductors. However, for normal spacing of overhead lines this effect is small and can be ignored.

For steel-reinforced conductors the current that follows the spiral of the helically applied aluminium wires around the steel core produces a longitudinal magnetic flux in the steel core. This alternating flux causes both hysteresis and eddy current losses, increasing the effective resistance of the conductor to alternating current. The magnetic flux in the steel varies with current and is most significant when the number of aluminium layers is odd, because there is incomplete cancellation of the magnetic flux in the steel core.

Skin effect and, in the case of steel-reinforced conductors with single and three layers of aluminium, hysteresis and eddy current effects, were taken into consideration in determining the AC resistance.

## Inductive Reactance

The inductive reactance of stranded conductors in an overhead line is calculated by considering the flux linkages caused by current flowing in the conductors. To simplify the calculation, it is usually considered to consist of two components: the conductor component of reactance resulting from the magnetic flux, and the spacing component of reactance resulting from the magnetic flux to the equivalent return conductor.

The conductor component depends on the number of strands and the geometry of the conductor. The spacing component takes into consideration the spacing between conductors and the geometry of the circuit. The reactance of an overhead line is found by adding the two components.

For steel-reinforced conductors, the magnetic flux in the steel core depends on the amount of current flowing in the conductors and is most significant when the number of aluminium layers is odd. However, the magnetic properties of the steel core are highly non-linear, and the conductor component of reactance can be accurately determined only from tests. The values shown in the tables of electrical performance data in the following sections are sufficiently accurate for most practical installations.

Values for inductive reactance to 300 mm horizontal spacing are shown in the following Product Sheets.

# PHYSICAL & MECHANICAL CHARACTERISTICS

## Sag and Tension

The general theory of sag-tension calculations is based on the fact that a conductor suspended between two points assumes the shape of a catenary. The basic relationship between sag and tension can be established from knowledge of the stress-strain characteristics of a conductor. Factors which will subsequently affect the sag and tension are thermal elongation of the conductor due to changes in temperature, creep with time under load, and increased loadings due to wind and ice. These factors affect the length of the conductor and consequently the sag and tension characteristics.

The physical and mechanical performance characteristics required for sag-tension calculations are shown in the product sheets which follow, and the factors which affect the length of a stranded conductor are briefly explained in the following sections.

Suitable formulae for selecting the appropriate tension are published in AS/NZS 7000:2010, Overhead Line Design - Detailed Procedures.

## Stress-Strain Characteristics

The stress-strain behaviour of a stranded conductor depends on the properties of the component wires and the construction of the conductor, including the number of layers and the lay length of the wires.

Stress-strain tests are used to establish the behaviour of a stranded conductor during the initial loading period, and a relationship for its elastic behaviour in its final state. The test procedure used to obtain the stress-strain characteristics is to load and hold the conductor at 30%, 50% and 70% of its calculated breaking load with load-holding periods of 30 minutes, 1 hour and 1 hour respectively and the conductor is unloaded at the end of each holding period.

From the initial loading curve where the conductor is loaded to 30% of its breaking load and held for 30 minutes, the amount of geometric settlement of the component wires, the initial creep and the initial modulus of elasticity can be determined.

Subsequent loading and unloading of the conductor at 50% and 70% of its breaking load with load holding periods of 1 hour, ensures that the component wires are settled and that most of the initial creep has been removed. This leaves the conductor in its final state and the final unloading of the conductor is used to determine the final modulus of elasticity.

The final modulus of elasticity is used for sag-tension calculations to determine the behaviour of a conductor which has been in service for some time and has been subjected to high tensions due to low temperatures, wind and in some cases ice loading.

At some high temperature, all the load is transferred to the steel and the thermal elongation of the composite conductor is identical to the thermal elongation of the steel core alone. In practice, for normal operating conditions, it is sufficiently accurate to assume a direct relationship between thermal elongation and the coefficient of linear expansion of the composite conductor. The coefficient of linear expansion for the composite conductor may be calculated, taking into account the material properties and the areas of each component making up the conductor.

# PHYSICAL & MECHANICAL CHARACTERISTICS (CONT.)

## Thermal Elongation

Variations in temperature will change the length of a conductor and this change in length is known as thermal elongation or thermal strain.

For homogeneous AAC, AAAC and hard drawn copper conductors the thermal elongation is directly related to the coefficient of linear expansion of the material.

For composite ACSR and AACSR conductors the thermal elongation is more complex to establish, due to the relationship between stresses and strains of constituent wires. The stress distribution in a composite conductor changes with temperature. Due to the lower coefficient of thermal expansion of steel compared with that of aluminium, a rise in temperature increases the proportion of the tensile load carried by the steel core.

## Creep

Creep is defined as the plastic deformation or non-recoverable extension of conductors which occurs with time under load. It can be considered to consist of two components: initial creep and long-term creep.

Initial creep is the result of settling in of wires when the conductor is first subjected to maximum tension. This component of creep can be offset by pre-tensioning the conductor at a load higher than the everyday tension (EDT) before final sagging. This procedure can effectively stabilise the conductor before final sagging and also provides a consistent base for determining subsequent long-term creep. If conductors are installed at a value of the tension below that used for final sagging, full allowance for both initial and long-term creep should be made.

Long term creep depends on stress, operating temperature and time. It can be calculated from information on the material and design of the conductor. Typically, extensions of 400–500 micrometres per metre may occur over a 30-year life of a line. In order to avoid problems associated with the increase of sag resulting from creep, a number of solutions may be adopted.

One solution is to assume an imaginary lower temperature of installation which would (when the temperature is raised to the actual installation temperature) result in a thermal expansion equal in value to that of the predicted creep. For example, if the predicted creep is equal to the thermal expansion caused by a temperature increase of 20°C, then the installation temperature is assumed to be less than the actual by 20°C. This results in the line being tensioned at a higher EDT than normal at the time of installation. In the 30-year life span of the conductor, the tension will gradually decrease to the value of true EDT.

Alternatively, commercially available computer programs based on the more complex strain-summation method can be used to determine the stringing tension for any given future loading conditions and limiting constraints on one or more parameters. Determining the stringing tension is done by iteration, working forward in time.

## Everyday Tension

Aeolian vibration can damage overhead line conductors as a result of mechanical fatigue. The standard practice for preventing fatigue damage is to limit the tension of the conductor to a value that will not subject the conductor to excessive vibration under normal operating conditions.

The tension that may be applied to a conductor is usually expressed as a percentage of the conductor breaking load. As the damage from fatigue is most pronounced in the outer layers of the conductor, the safe tension is based on the allowable stress in the outer layers. Three main factors which cause vibration fatigue on conductors are considered when determining the safe allowable outer layer stress: the type of suspension arrangement used, the terrain, and the efficiency of the vibration damping system, if used. Reference should be made to AS/NZS 7000:2010, Overhead Line Design - Detailed Procedures, for EDT figures.



# BARE OVERHEAD CONDUCTORS

## Materials

Nexans offers a number of materials meeting the requirements of both Australian and International Standards.

**Aluminium 1350:** High purity electrical conductor (EC) grade aluminium (alloy 1350) has a conductivity of 61% IACS and UTS of 160–185 MPa.

**Aluminium alloy 1120:** Nexans alloy 1120 (Ductolex) has a conductivity of 59% IACS and UTS of 240–250 MPa. It provides a conductor with comparable electrical resistance and 40–50% higher strength than a similar conductor of EC grade material. This alloy can be considered a ‘high tech’ version of EC grade aluminium and offers significant advantages over older type alloys, such as alloy 6201. Steel-reinforced aluminium alloy 1120 conductors have a high strength to weight ratio, resulting in small sags on long span lengths. Fittings for alloy 1120 conductors are similar to those used for EC grade aluminium conductors.

**Copper:** Hard drawn copper wire produced from high conductivity alloy 110A has a conductivity of 97% IACS and UTS of 405–460 MPa.

**Galvanised steel:** Galvanised steel wire made from fully-killed steel with a carbon content of 0.6% has a UTS of 1.31–1.39 GPa. It is galvanised by either a hot dip or electrolytic process to give a zinc coating mass of 200–260 g/m<sup>2</sup>.

## Construction

The wires in all bare conductors are stranded concentrically with successive layers having an opposite direction of lay, the outermost layer being right-handed. When required, a larger central wire (king wire) is included in a conductor. The diameter of this wire is based on conductor design considerations and is usually 5% greater than the surrounding wires. The incorporation of a king wire is often an advantage for ACSR type conductors, as it ensures that the surrounding layer of wires fits firmly on the central wire.

ACSR conductors may be subjected to corrosive conditions such as high pollution found in industrial areas or salt spray in coastal areas. The application of high melting point grease over the steel wires provides additional protection against corrosion. Aluminium alloy 1120 conductors are becoming more popular as replacements for steel-reinforced conductors in areas of high corrosion risk.

Property of Materials					
Property	Unit	Aluminium	Aluminium Alloy 1120 (Ductolex)	Copper	Galvanised Steel
Density at 20°C	kg/m <sup>3</sup>	2700	2700	8890	7800
Conductivity at 20°C	% IACS	61	59	97	10.1
Resistivity at 20°C	μΩ.m	0.0283	0.0293	0.01777	0.17
Constant-Mass Temperature Coefficient of Resistance	per °C	0.00403	0.00390	0.00381	0.0044
Ultimate Tensile Stress	MPa	160–185	230–250	405–460	1310–1390
Modulus of Elasticity	GPa	68	68	124	193
Coefficient of Linear Expansion	per °C	23.0 x 10 <sup>-6</sup>	23.0 x 10 <sup>-6</sup>	17 x 10 <sup>-6</sup>	11.5 x 10 <sup>-6</sup>

# AAC AERIAL CONDUCTORS

Aluminium conductor

<b>Product Sheet No. 310-01 A</b>					
<b>Code Name</b>	<b>Stranding (mm)</b>	<b>Cross Sectional Area (mm<sup>2</sup>)</b>	<b>Nominal Overall Diameter (mm)</b>	<b>Mass (kg/km)</b>	<b>Breaking Load (kN)</b>
Namu	7/2.11	24.5	6.33	66.9	4.07
Poko	7/2.36	30.6	7.08	83.7	5.09
Ladybird	7/2.79	42.8	8.37	117	6.92
Kutu	7/3.00	49.5	9.00	135	7.98
Fly	7/3.40	63.6	10.2	174	9.98
Rango	7/3.66	73.6	11.0	201	11.2
Grasshopper	7/3.91	84.1	11.7	230	12.8
Wasp	7/4.39	106	13.2	290	16.1
Beetle	19/2.67	106	13.4	292	17.2
Weke	7/4.72	122	14.2	335	18.6
Bee	7/4.90	132	14.7	361	20.1
Cricket	7/5.36	158	16.1	432	24.0
Weta	19/3.35	167	16.8	460	26.2
Pluto	19/3.75	210	18.8	576	31.9
Mata	19/3.86	222	19.3	611	33.8
Cockroach	19/4.22	266	21.1	731	40.4
Butterfly	19/4.65	323	23.3	888	49.1
Cicada	37/4.65	628	32.6	1730	95.6
<b>Issue: June 2019</b>					
<b>Made to AS 1531</b>					

Notes:

1. Coefficient of linear expansion  $23.0 \times 10^{-6}/^{\circ}\text{C}$ .
2. Modulus of elasticity:  
65 GPa for seven (7) and nineteen (19) wire conductors.  
64 GPa for thirty seven (37) wire conductors.

# AAC AERIAL CONDUCTORS

Aluminium conductor

<b>Product Sheet No. 310-01 B</b>				
<b>Code Name</b>	<b>Calculated DC Resistance at 20°C (Ohm/km)</b>	<b>Reactance at 50Hz with 300 mm Spacing (Ohm/km)</b>	<b>Current Rating Still Air (Amps)</b>	<b>Current Rating 1 m/s (Amps)</b>
Namu	1.17	0.321	85	164
Poko	0.936	0.314	98	189
Ladybird	0.670	0.303	121	232
Kutu	0.579	0.299	132	253
Fly	0.451	0.291	155	295
Rango	0.389	0.286	170	323
Grasshopper	0.342	0.282	184	350
Wasp	0.271	0.275	213	403
Beetle	0.271	0.271	213	404
Weke	0.234	0.270	233	441
Bee	0.217	0.268	244	461
Cricket	0.181	0.262	275	515
Weta	0.172	0.257	286	533
Pluto	0.137	0.250	333	612
Mata	0.130	0.248	345	632
Cockroach	0.108	0.242	390	707
Butterfly	0.0895	0.236	443	792
Cicada	0.0460	0.214	689	1178
<b>Issue: June 2019</b>				
<b>Made to AS 1531</b>				

Note: Current ratings are based on an ambient temperature of 30°C, a maximum conductor temperature of 75°C, rural weathered, summer noon and intensity of solar radiation 1000 W/m<sup>2</sup>.

# AAAC AERIAL CONDUCTORS

1120 Aluminium alloy conductor

<b>Product Sheet No. 310-02 A</b>					
<b>Code Name</b>	<b>Stranding (mm)</b>	<b>Cross Sectional Area (mm<sup>2</sup>)</b>	<b>Nominal Overall Diameter (mm)</b>	<b>Mass (kg/km)</b>	<b>Breaking Load (kN)</b>
Chlorine	7/2.50	34.4	7.50	94.3	8.18
Chromium	7/2.75	41.6	8.25	113	9.91
Fluorine	7/3.00	49.5	9.00	135	11.8
Helium	7/3.75	77.3	11.3	211	17.6
Hydrogen	7/4.50	111	13.5	304	24.3
Iodine	7/4.75	124	14.3	339	27.1
Krypton	19/3.25	158	16.3	433	37.4
Lutetium	19/3.50	183	17.5	503	41.7
Neon	19/3.75	210	18.8	576	47.8
Nitrogen	37/3.00	262	21.0	721	62.2
Sulfur	61/3.75	674	33.8	1860	145
<b>Issue: June 2019</b>					
<b>Made to AS 1531</b>					

Notes:

1. Coefficient of linear expansion  $23.0 \times 10^{-6}/^{\circ}\text{C}$ .
2. Modulus of elasticity:  
65 GPa for seven (7) and nineteen (19) wire conductors.  
64 GPa for thirty-seven (37) and sixty-one (61) wire conductors.
3. For the greased versions of the above conductors, the grease used will be Type 20A150 complying with BS EN 50326.

# AAAC AERIAL CONDUCTORS

1120 Aluminium alloy conductor

<b>Product Sheet No. 310-02 B</b>				
<b>Code Name</b>	<b>Calculated DC Resistance at 20°C (Ohm/km)</b>	<b>Reactance at 50Hz with 300 mm Spacing (Ohm/km)</b>	<b>Current Rating Still Air (Amps)</b>	<b>Current Rating 1 m/s (Amps)</b>
Chlorine	0.864	0.310	104	200
Chromium	0.713	0.304	117	224
Fluorine	0.599	0.299	131	250
Helium	0.383	0.285	173	328
Hydrogen	0.266	0.273	217	410
Iodine	0.239	0.270	231	438
Krypton	0.189	0.259	271	507
Lutetium	0.163	0.254	299	555
Neon	0.142	0.250	328	603
Nitrogen	0.114	0.242	381	690
Sulfur	0.0444	0.212	711	1210

**Issue: June 2019**  
**Made to AS 1531**

Note: Current ratings are based on an ambient temperature of 30°C, a maximum conductor temperature of 75°C, rural weathered, summer noon and intensity of solar radiation 1000 W/m<sup>2</sup>.

# ACSR AERIAL CONDUCTORS

Aluminium conductor

Galvanised steel reinforced

<b>Product Sheet No. 310-03 A</b>								
Code Name	Number of Strands/Wire Diameter (mm)		Equivalent Aluminium Cross-Sectional Area (mm <sup>2</sup> )	Nominal Overall Diameter (mm)	Mass (kg/km)	Breaking Load (kN)	Modulus of Elasticity (GPa)	Coefficient of Linear Expansion (x 10 <sup>-6</sup> /°C)
	Aluminium	Steel						
Magpie	3/2.11	4/2.11	12.7	6.33	139	17.4	136	13.9
Squirrel	6/2.11	1/2.11	20.7	6.33	84.8	7.49	83	19.3
Gopher	6/2.36	1/2.36	26.0	7.08	106	9.37	83	19.3
Ferret	6/3.00	1/3.00	41.8	9.00	171	14.9	83	19.3
Mink	6/3.66	1/3.66	62.2	11.0	255	21.6	83	19.3
Raccoon	6/4.09	1/4.09	77.7	12.3	318	27.0	83	19.3
Dog	6/4.72	7/1.57	103	14.2	396	32.9	80	19.9
Dingo	18/3.35	1/3.35	155	16.8	505	35.4	71	21.4
Wolf	30/2.59	7/2.59	155	18.1	724	67.4	88	18.4
Jaguar	18/3.86	1/3.86	207	19.3	671	46.0	71	21.4
Goat	30/3.71	7/3.71	317	26.0	1490	135	88	18.4
Zebra	54/3.18	7/3.18	420	28.6	1620	131	78	19.9
Cardinal	54/3.38	7/3.38	474	30.4	1830	149	78	19.9
Moose	54/3.53	7/3.53	517	31.8	1990	159	78	19.9
Pawpaw	54/3.75	19/2.25	584	33.8	2240	178	78	20.0
Issue: June 2019								
Made to AS 3607								

Note: The grease used within these conductors is Type 20A150 complying with BS EN 50326.

# ACSR AERIAL CONDUCTORS

Aluminium conductor

Galvanised steel reinforced

<b>Product Sheet No. 310-03 B</b>				
<b>Code Name</b>	<b>Calculated DC Resistance at 20°C (Ohm/km)</b>	<b>Reactance at 50Hz with 300 mm Spacing (Ohm/km)</b>	<b>Current Rating Still Air (Amps)</b>	<b>Current Rating 1 m/s (Amps)</b>
Magpie	2.23	0.349	59	113
Squirrel	1.37	0.322	75	145
Gopher	1.09	0.315	86	167
Ferret	0.677	0.299	117	223
Mink	0.455	0.287	152	285
Raccoon	0.364	0.280	175	326
Dog	0.274	0.271	210	387
Dingo	0.182	0.257	274	494
Wolf	0.183	0.252	280	501
Jaguar	0.137	0.248	336	616
Goat	0.0893	0.229	462	814
Zebra	0.0674	0.222	544	942
Cardinal	0.0597	0.219	590	1014
Moose	0.0547	0.216	626	1068
Pawpaw	0.0485	0.212	678	1148
<b>Issue: June 2019</b>				
<b>Made to AS 3607</b>				

Note: Current ratings are based on an ambient temperature of 30°C, a maximum conductor temperature of 75°C, rural weathered, summer noon and intensity of solar radiation 1000 W/m<sup>2</sup>.

# HARD DRAWN CU AERIAL CONDUCTORS

Copper conductor

<b>Product Sheet No. 320-01 A</b>				
<b>Cross Sectional Area (mm<sup>2</sup>)</b>	<b>Stranding (mm)</b>	<b>Nominal Conductor Diameter (mm)</b>	<b>Mass (kg/km)</b>	<b>Breaking Load (kN)</b>
6	7/1.04	3.12	53.6	2.51
7	7/1.12	3.36	62.2	2.9
10	7/1.35	4.05	90.2	4.17
16	7/1.70	5.10	143	6.5
25	7/2.14	6.42	227	10.1
35	19/1.53	7.65	314	14.1
40	19/1.63	8.15	359	16.0
50	19/1.83	9.15	451	20.0
70	19/2.14	10.7	617	26.8
95	37/1.83	12.8	882	39.0

**Issue: June 2019**  
**Made to AS 1746**

Notes:

1. Coefficient of linear expansion  $17.0 \times 10^{-6}/^{\circ}\text{C}$ .
2. Modulus of elasticity:
  - 119 GPa for seven (7) wire conductors.
  - 118 GPa for nineteen (19) wire conductors.
  - 117 GPa for thirty-seven (37) wire conductors.



# HARD DRAWN CU AERIAL CONDUCTORS

Copper conductor

<b>Product Sheet No. 320-01 B</b>				
<b>Cross Sectional Area (mm<sup>2</sup>)</b>	<b>Calculated DC Resistance at 20°C (Ohm/km)</b>	<b>Reactance at 50Hz with 300 mm Spacing (Ohm/km)</b>	<b>Current Rating Still Air (Amps)</b>	<b>Current Rating 1 m/s (Amps)</b>
6	3.03	0.365	44	87
7	2.61	0.36	49	96
10	1.80	0.349	61	120
16	1.13	0.334	82	160
25	0.716	0.320	110	212
35	0.516	0.306	135	260
40	0.455	0.302	146	281
50	0.361	0.295	169	323
70	0.264	0.285	206	392
95	0.186	0.273	256	486
<b>Issue: June 2019</b>				
<b>Made to AS 1746</b>				

Note: Current ratings are based on an ambient temperature of 30°C, a maximum conductor temperature of 75°C, rural weathered, summer noon and intensity of solar radiation 1000 W/m<sup>2</sup>.

# PVC INSULATED HARD DRAWN CU AERIAL CABLES

Copper conductor

PVC insulation

<b>Product Sheet No. 330-01 A</b>						
<b>Cross Sectional Area (mm<sup>2</sup>)</b>	<b>Stranding (mm)</b>	<b>Conductor Diameter (mm)</b>	<b>Insulation Thickness (mm)</b>	<b>Nominal Overall Diameter (mm)</b>	<b>Mass (kg/km)</b>	<b>Breaking Load (kN)</b>
6	7/1.04	3.12	1.0	5.3	80	2.3
10	7/1.35	4.05	1.0	6.3	120	3.9
16	7/1.70	5.10	1.0	7.3	180	5.9
25	19/1.35	6.75	1.2	9.3	300	10.4
35	19/1.53	7.65	1.2	10.3	370	12.7
50	19/1.83	9.15	1.4	12.2	510	17.3
70	19/2.14	10.7	1.4	13.8	710	25.0
95	37/1.83	12.8	1.6	16.2	980	32.8

**Issue: June 2019**  
**Made to AS/NZS 5000.1**

Notes:

1. Coefficient of linear expansion  $17.0 \times 10^{-6}/^{\circ}\text{C}$ .
2. Modulus of elasticity:
  - 112 GPa for seven (7) wire conductors.
  - 110 GPa for nineteen (19) wire conductors.
  - 108 GPa for thirty-seven (37) wire conductors.

# PVC INSULATED HARD DRAWN CU AERIAL CABLES

Copper conductor

PVC insulation

<b>Product Sheet No. 330-01 B</b>				
<b>Cross Sectional Area (mm<sup>2</sup>)</b>	<b>Calculated DC Resistance at 20°C (Ohm/km)</b>	<b>Inductive Reactance at 50Hz with 300 mm Spacing (Ohm/km)</b>	<b>Current Rating Still Air (Amps)</b>	<b>Current Rating 1 m/s (Amps)</b>
6	3.17	0.365	45	81
10	1.88	0.349	63	110
16	1.18	0.334	84	147
25	0.749	0.314	115	194
35	0.540	0.306	141	235
50	0.399	0.295	172	281
70	0.276	0.285	218	353
95	0.198	0.273	266	421

**Issue: June 2019**  
**Made to AS/NZS 5000.1**

Note: Current ratings are based on an ambient temperature of 30°C, a maximum conductor temperature of 75°C and intensity of solar radiation 1000 W/m<sup>2</sup>.

# PVC INSULATED AAC AERIAL CABLES

Aluminium conductor

PVC insulation

<b>Product Sheet No. 330-02 A</b>						
<b>Code Name</b>	<b>Stranding (mm)</b>	<b>Cross Sectional Area (mm<sup>2</sup>)</b>	<b>Insulation Thickness (mm)</b>	<b>Nominal Overall Diameter (mm)</b>	<b>Mass (kg/km)</b>	<b>Breaking Load (kN)</b>
Namu	7/2.11	24.5	1.2	8.85	119	4.07
Poko	7/2.36	30.6	1.3	9.75	154	5.09
Ladybird	7/2.79	42.8	1.4	11.4	200	6.92
Kutu	7/3.00	49.5	1.4	12.0	224	7.98
Fly	7/3.40	63.6	1.4	13.2	276	9.98
Rango	7/3.66	73.6	1.4	14.0	314	11.2
Wasp	7/4.39	106	1.6	16.6	443	16.1
Beetle	19/2.67	106	1.6	16.8	437	17.2
Weke	7/4.72	122	1.8	18.0	520	18.6
Weta	19/3.35	167	1.8	20.7	650	26.2

**Issue: June 2019**  
**Generally made to AS/NZS 5000.1**

Notes:

1. Coefficient of linear expansion  $23.0 \times 10^{-6}/^{\circ}\text{C}$ .
2. Modulus of elasticity 65 GPa.

# PVC INSULATED AAC AERIAL CABLES

Aluminium conductor

PVC insulation

<b>Product Sheet No. 330-02 B</b>				
<b>Code Name</b>	<b>Calculated DC Resistance at 20°C (Ohm/km)</b>	<b>Reactance at 50Hz with 300mm Spacing (Ohm/km)</b>	<b>Current Rating Still Air (Amps)</b>	<b>Current Rating 1 m/s (Amps)</b>
Namu	1.17	0.321	90	152
Poko	0.936	0.314	104	174
Ladybird	0.670	0.303	130	212
Kutu	0.579	0.299	142	232
Fly	0.451	0.291	168	271
Rango	0.389	0.286	185	297
Wasp	0.271	0.275	234	368
Beetle	0.271	0.271	235	369
Weke	0.234	0.270	258	399
Weta	0.172	0.257	317	484
<b>Issue: June 2019</b>				
<b>Generally made to AS/NZS 5000.1</b>				

Note: Current ratings are based on an ambient temperature of 30°C, a maximum conductor temperature of 75°C, rural weathered, summer noon and intensity of solar radiation 1000 W/m<sup>2</sup>.

# AL AERIAL BUNDLED CABLES (ABC)

Aluminium conductor

XLPE insulation

## Product Sheet No. 330-03 A (Two Core)

Cross Sectional Area (mm <sup>2</sup> )	Conductor Diameter (mm)	Insulation Thickness (mm)	Nominal Overall Diameter of Bundle (mm)	Mass (kg/km)	Breaking Load (kN)
25	5.99	1.3	18.4	200	7.0
35	6.90	1.3	20.6	260	9.8
50	8.05	1.5	23.8	350	14.0
95	11.40	1.7	31.8	680	26.6

Issue: June 2019

Made to AS/NZS 3560.1

## Product Sheet No. 330-04 A (Three Core)

Cross Sectional Area (mm <sup>2</sup> )	Conductor Diameter (mm)	Insulation Thickness (mm)	Nominal Overall Diameter of Bundle (mm)	Mass (kg/km)	Breaking Load (kN)
35	6.90	1.3	22.2	390	14.7

Issue: June 2019

Made to AS/NZS 3560.1

## Product Sheet No. 330-05 A (Four Core)

Cross-sectional Area (mm <sup>2</sup> )	Conductor Diameter (mm)	Insulation Thickness (mm)	Nominal Overall Diameter of Bundle (mm)	Mass (kg/km)	Breaking Load (kN)
25	5.99	1.3	22.2	400	14.0
35	6.90	1.3	24.9	520	19.6
50	8.05	1.5	28.7	700	28.0
70	9.69	1.5	32.8	960	39.2
95	11.40	1.7	38.4	1350	53.2
120	12.90	1.7	42.2	1660	67.2
150	14.35	1.7	45.6	2020	84.0

Issue: June 2019

Made to AS/NZS 3560.1

Notes:

1. Coefficient of linear expansion  $23 \times 10^{-6}/^{\circ}\text{C}$ .
2. Modulus of elasticity 59 GPa up to and including 50 mm<sup>2</sup> and 56 GPa for conductors above 50 mm<sup>2</sup>.
3. Subject to confirmation these cables can be manufactured with pilots.

## AL AERIAL BUNDLED CABLES (ABC)

Aluminium conductor

XLPE insulation

### Product Sheet No. 330-03 B (Two Core)

Cross Sectional Area (mm <sup>2</sup> )	Calculated DC Resistance at 20°C (Ohm/km)	Maximum AC Resistance at 80°C (Ohm/km)	Positive Sequence Reactance at 50Hz (Ohm/km)	Current Rating (Amps)
25	1.20	1.49	0.102	118
35	0.868	1.08	0.0982	140
50	0.641	0.796	0.0924	168
95	0.320	0.398	0.0868	258

Issue: June 2019

Made to AS/NZS 3560.1

### Product Sheet No. 330-04 B (Three Core)

Cross Sectional Area (mm <sup>2</sup> )	Calculated DC Resistance at 20°C (Ohm/km)	Maximum AC Resistance at 80°C (Ohm/km)	Positive Sequence Reactance at 50Hz (Ohm/km)	Current Rating (Amps)
35	0.868	1.08	0.0982	134

Issue: June 2019

Made to AS/NZS 3560.1

### Product Sheet No. 330-05 B (Four Core)

Cross Sectional Area (mm <sup>2</sup> )	Calculated DC Resistance at 20°C (Ohm/km)	Maximum AC Resistance at 80°C (Ohm/km)	Positive Sequence Reactance at 50Hz (Ohm/km)	Current Rating (Amps)
25	1.20	1.49	0.102	109
35	0.868	1.08	0.0982	134
50	0.641	0.796	0.0924	157
70	0.443	0.551	0.0893	196
95	0.320	0.398	0.0868	241
120	0.253	0.315	0.0844	280
150	0.206	0.257	0.0844	314

Issue: June 2019

Made to AS/NZS 3560.1

Note: Current ratings are based on an ambient temperature of 30°C, a maximum conductor temperature of 80°C, wind speed of 1 m/s and intensity of solar radiation 1000 W/m<sup>2</sup>.

---

# NOTES